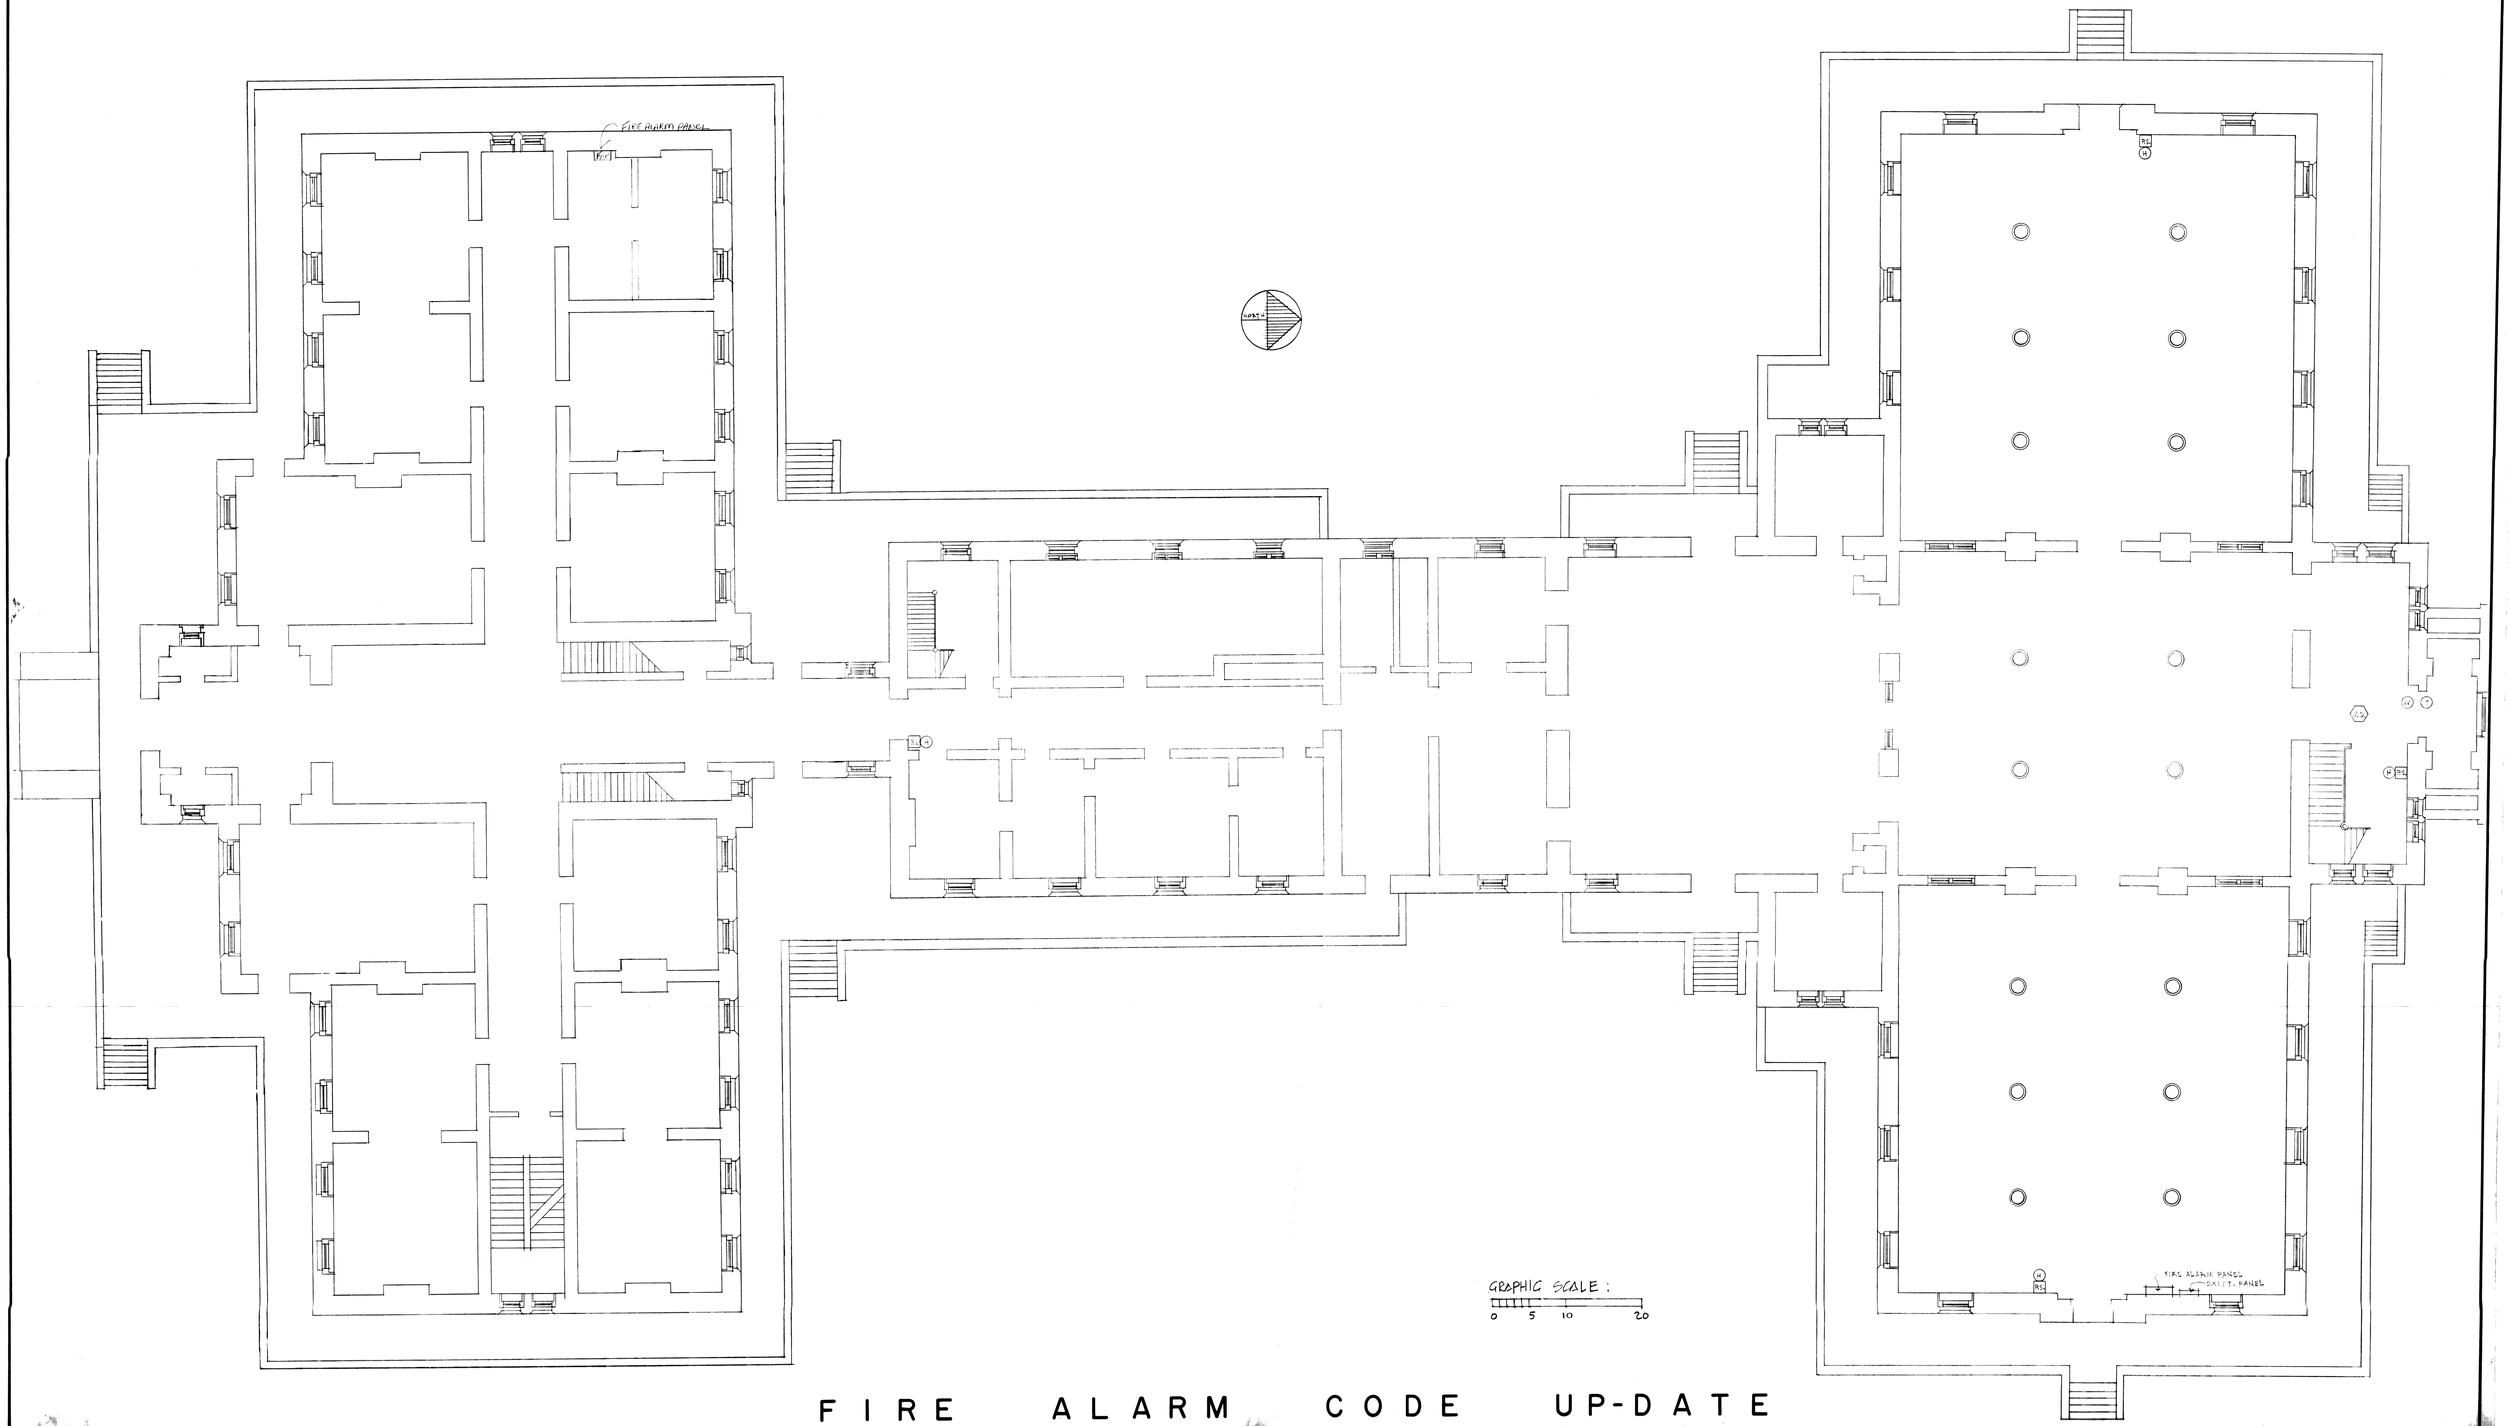

FIRE ALARM CODE UP-DATE

SHERMAN · BUILDING

BASEMENT · FLOOR

U. S. S. A. H.

DATE: _____ DESIGN: M.E.
SCALE: 1/8" = 1'-0" CHK.: _____
DRAWN: A.V. Hit. REVIEW: _____
SHEET 1 OF 5 APPROVED: _____

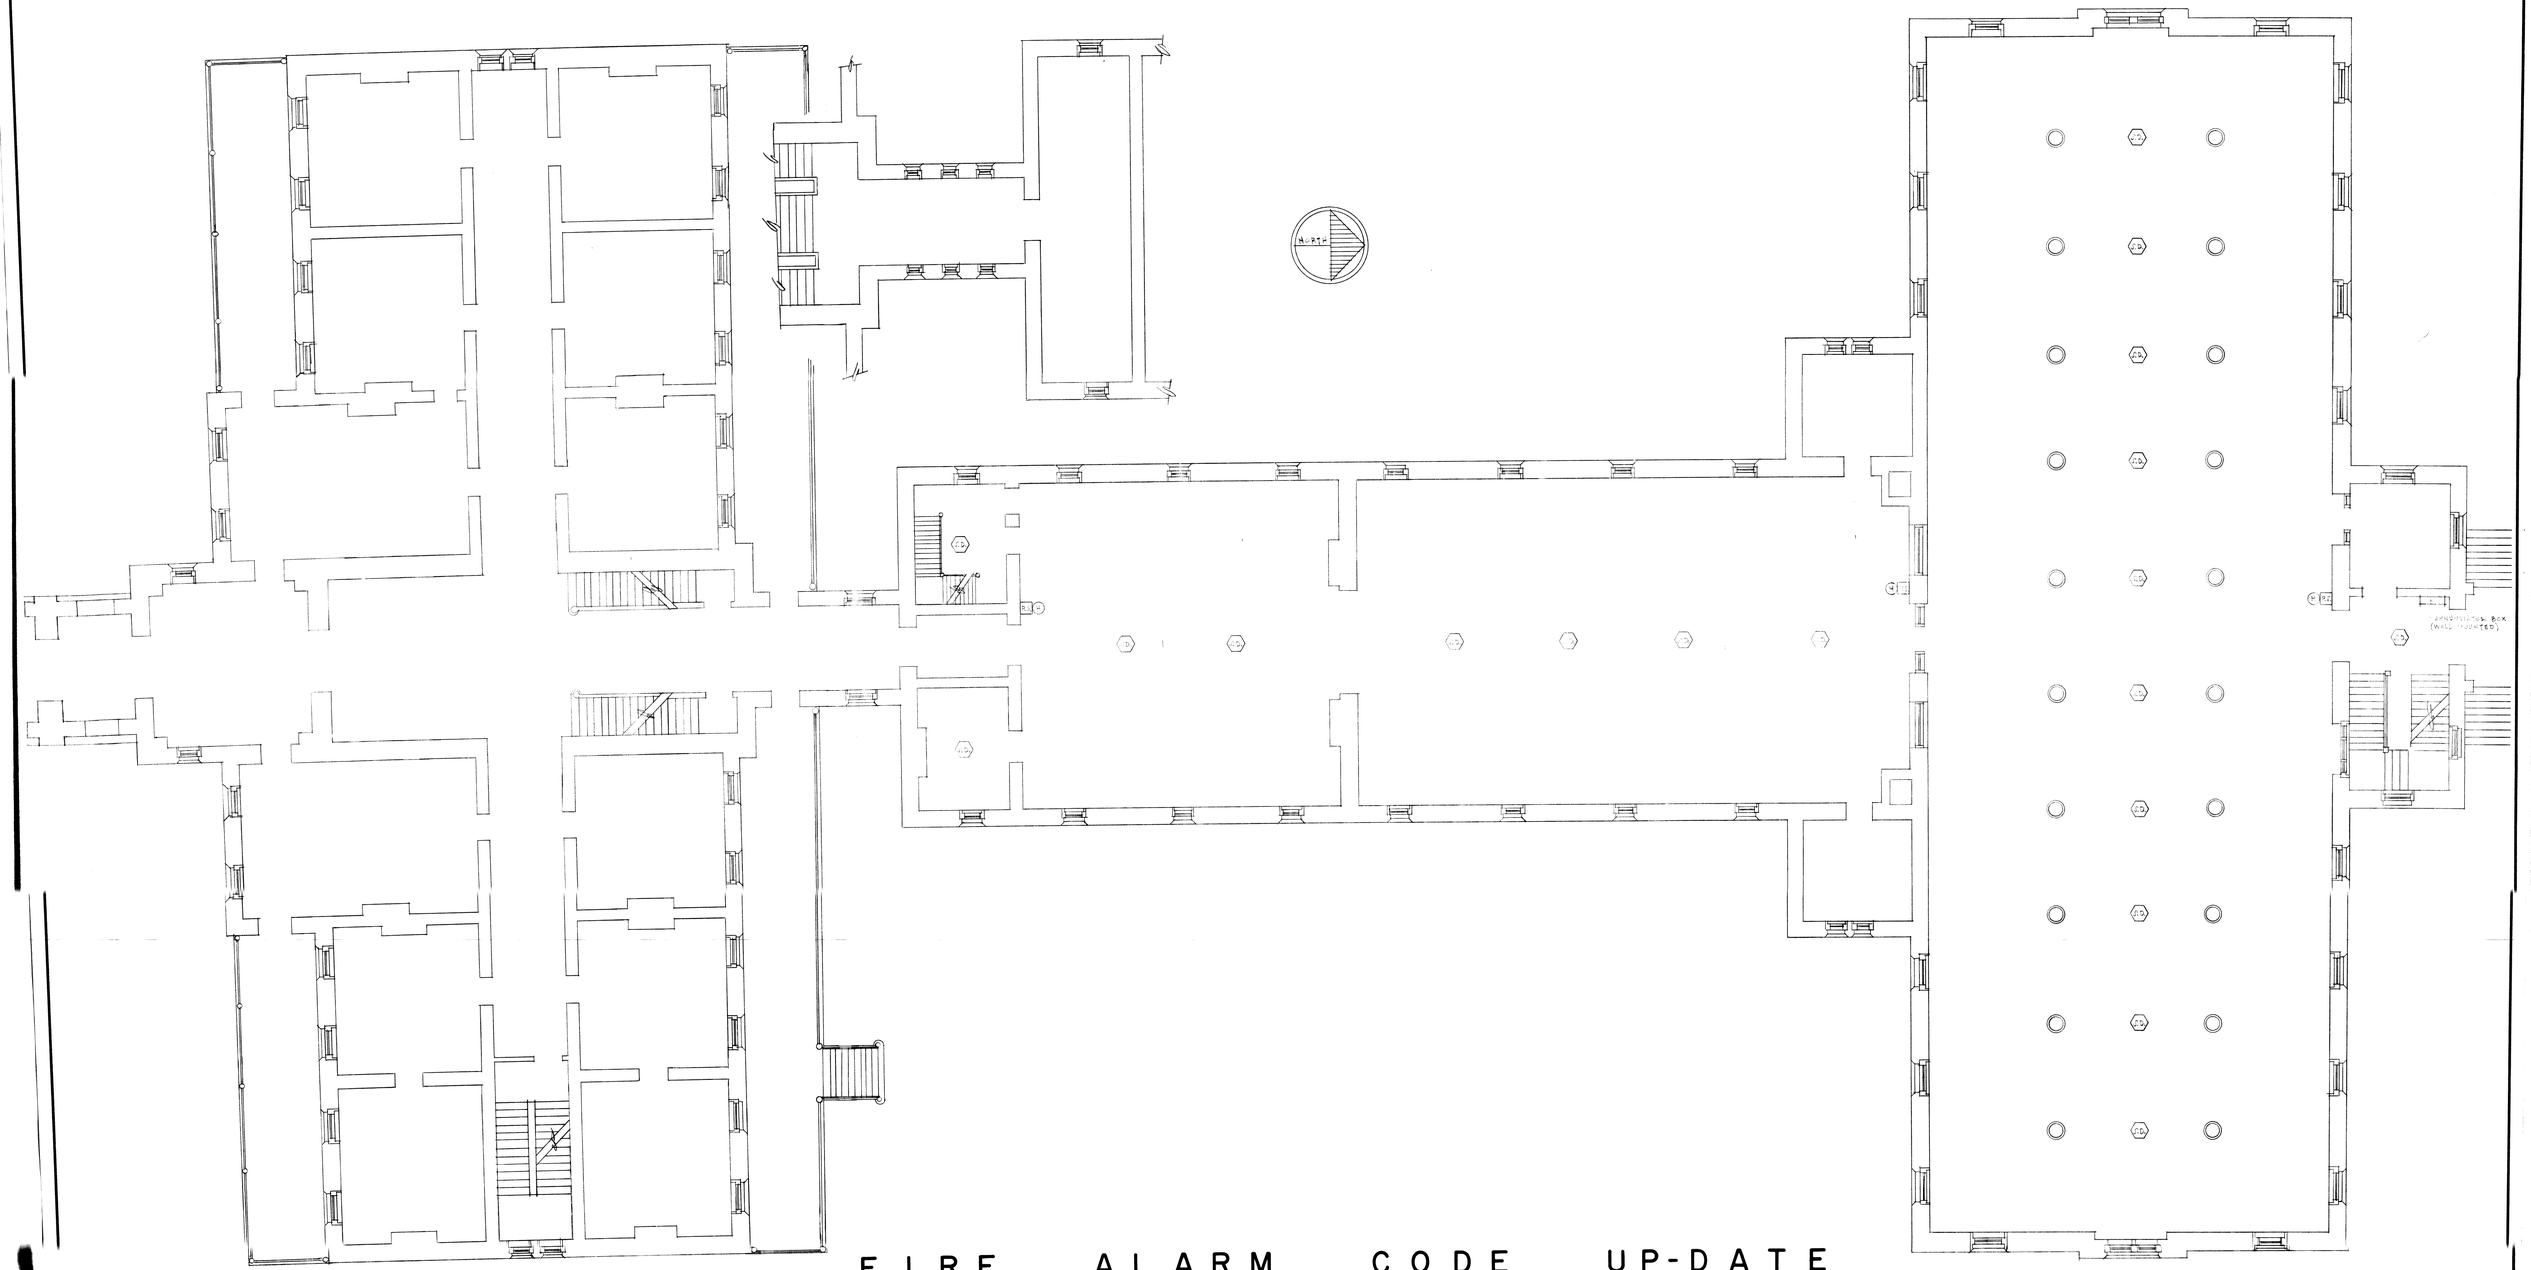

FIRE ALARM CODE UP-DATE

SHERMAN · BUILDING

FIRST · FLOOR

U. S. S. A. H.

DATE: _____ DESIGN: R.E.
SCALE: 1/8"=1'-0" CHK.: _____
DRAWN: A.C. HH. REVIEW: _____
SHEET 1 OF 5 APPROVED: _____

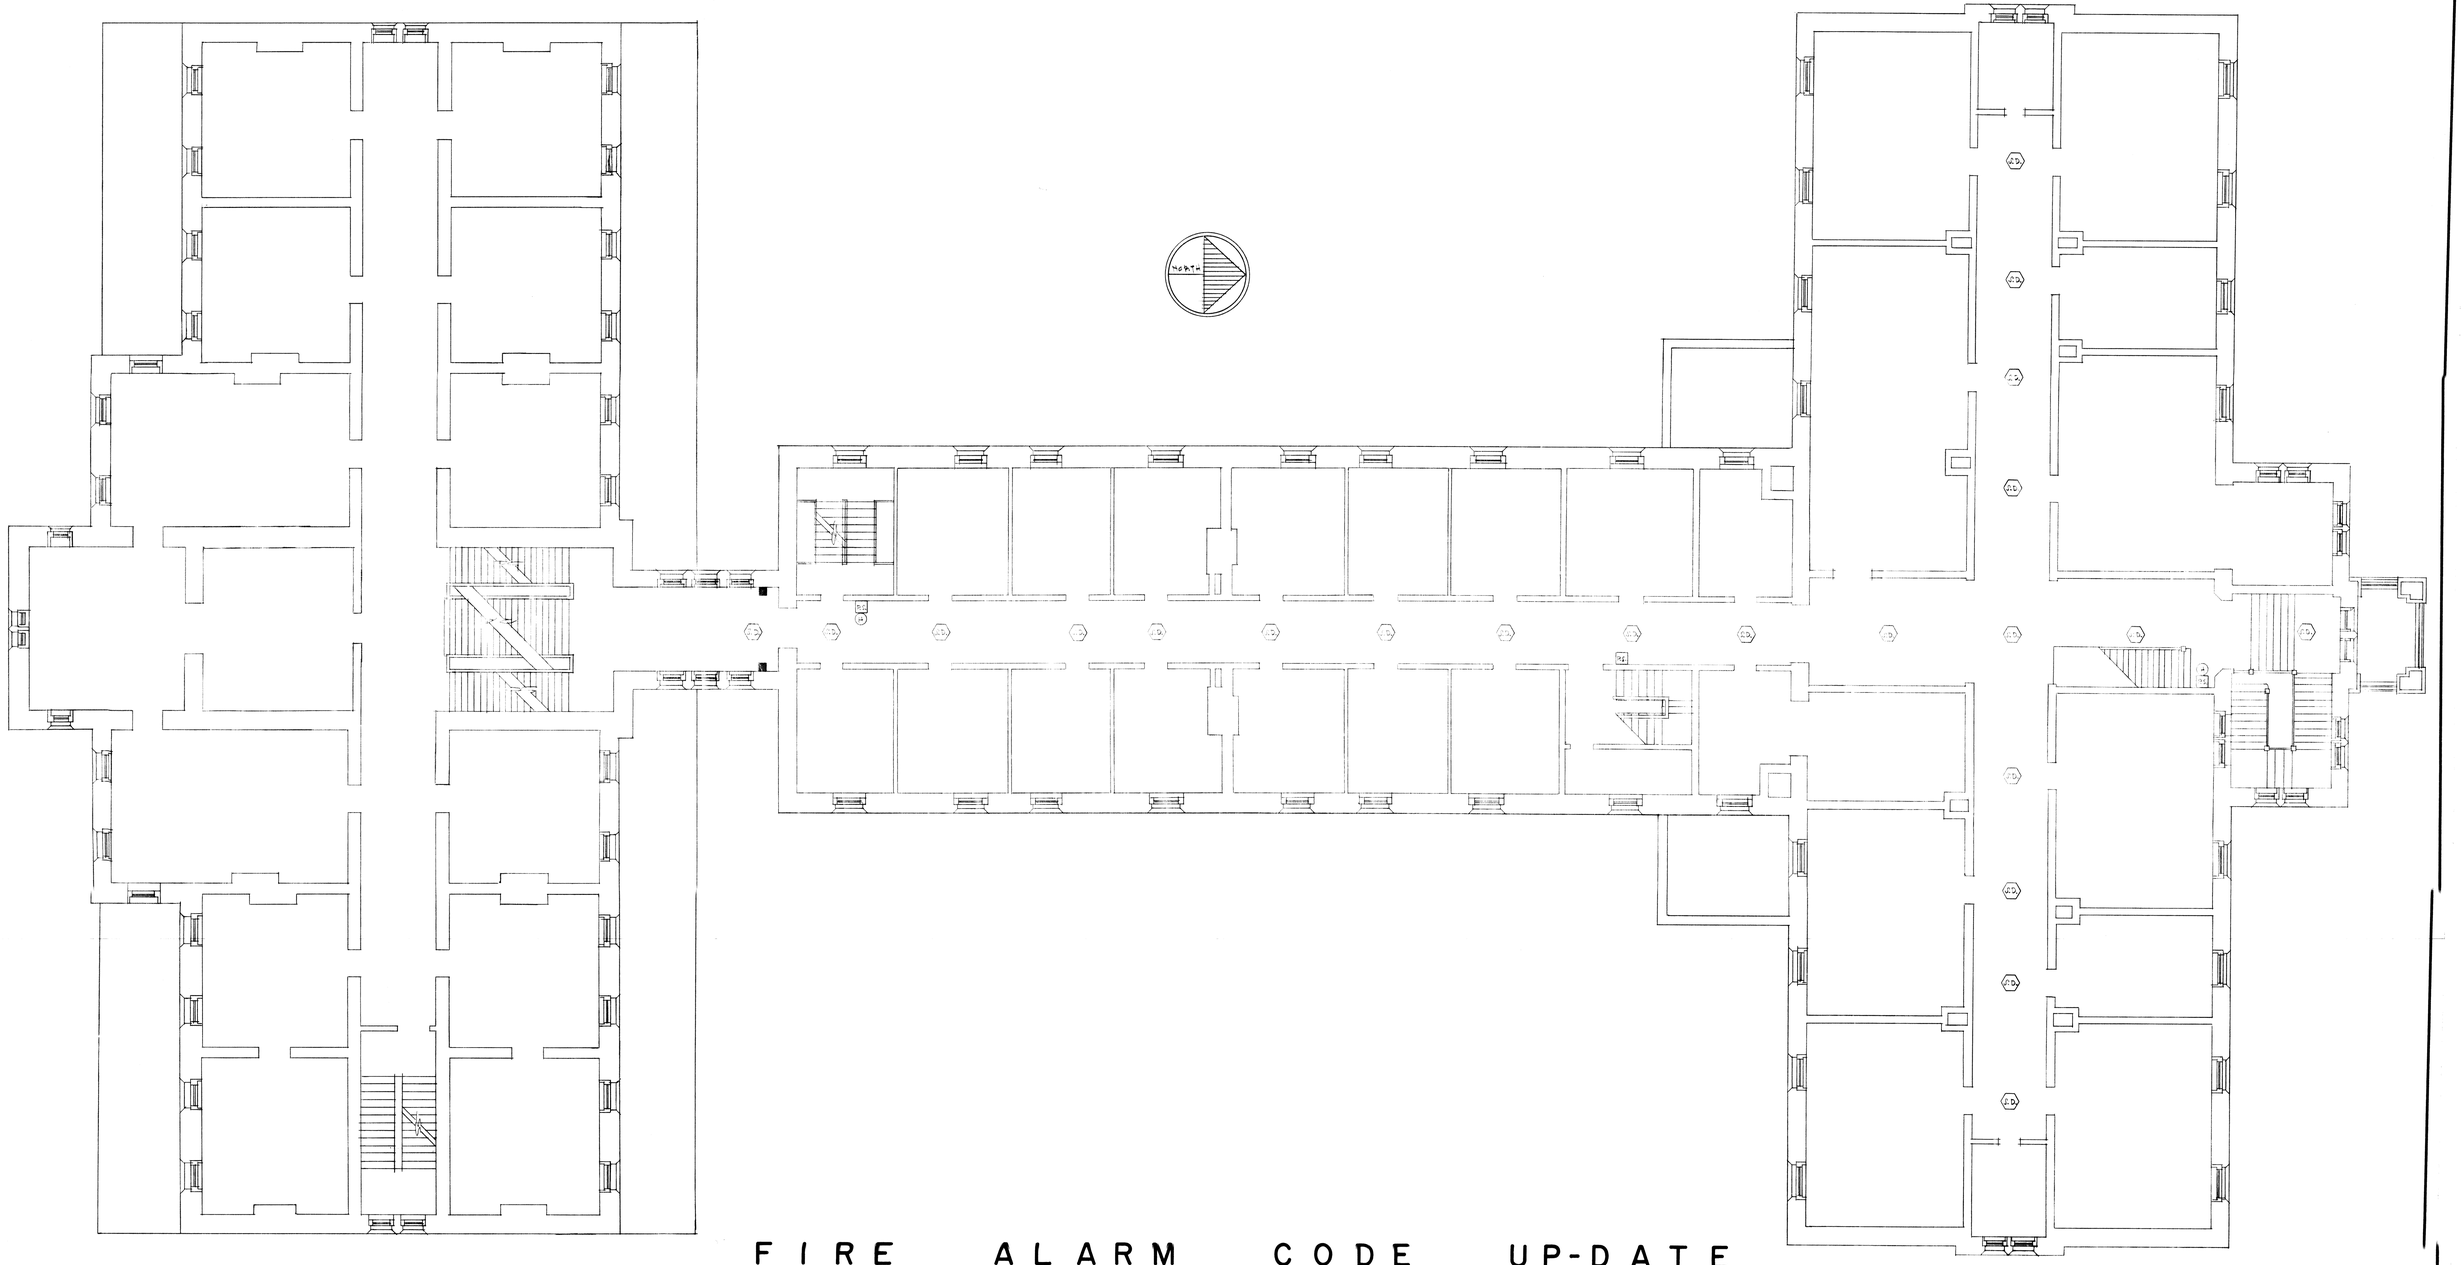

U. S. S. A. H.

FIRE ALARM CODE UP-DATE

SHERMAN · BUILDING

SECOND · FLOOR

DATE: _____ DESIGN: P.E.

SCALE: 1/8" = 1'-0" CHK.: _____

DRAWN: A.G. HH. REVIEW: _____

SHEET 3 OF 5 APPROVED: _____

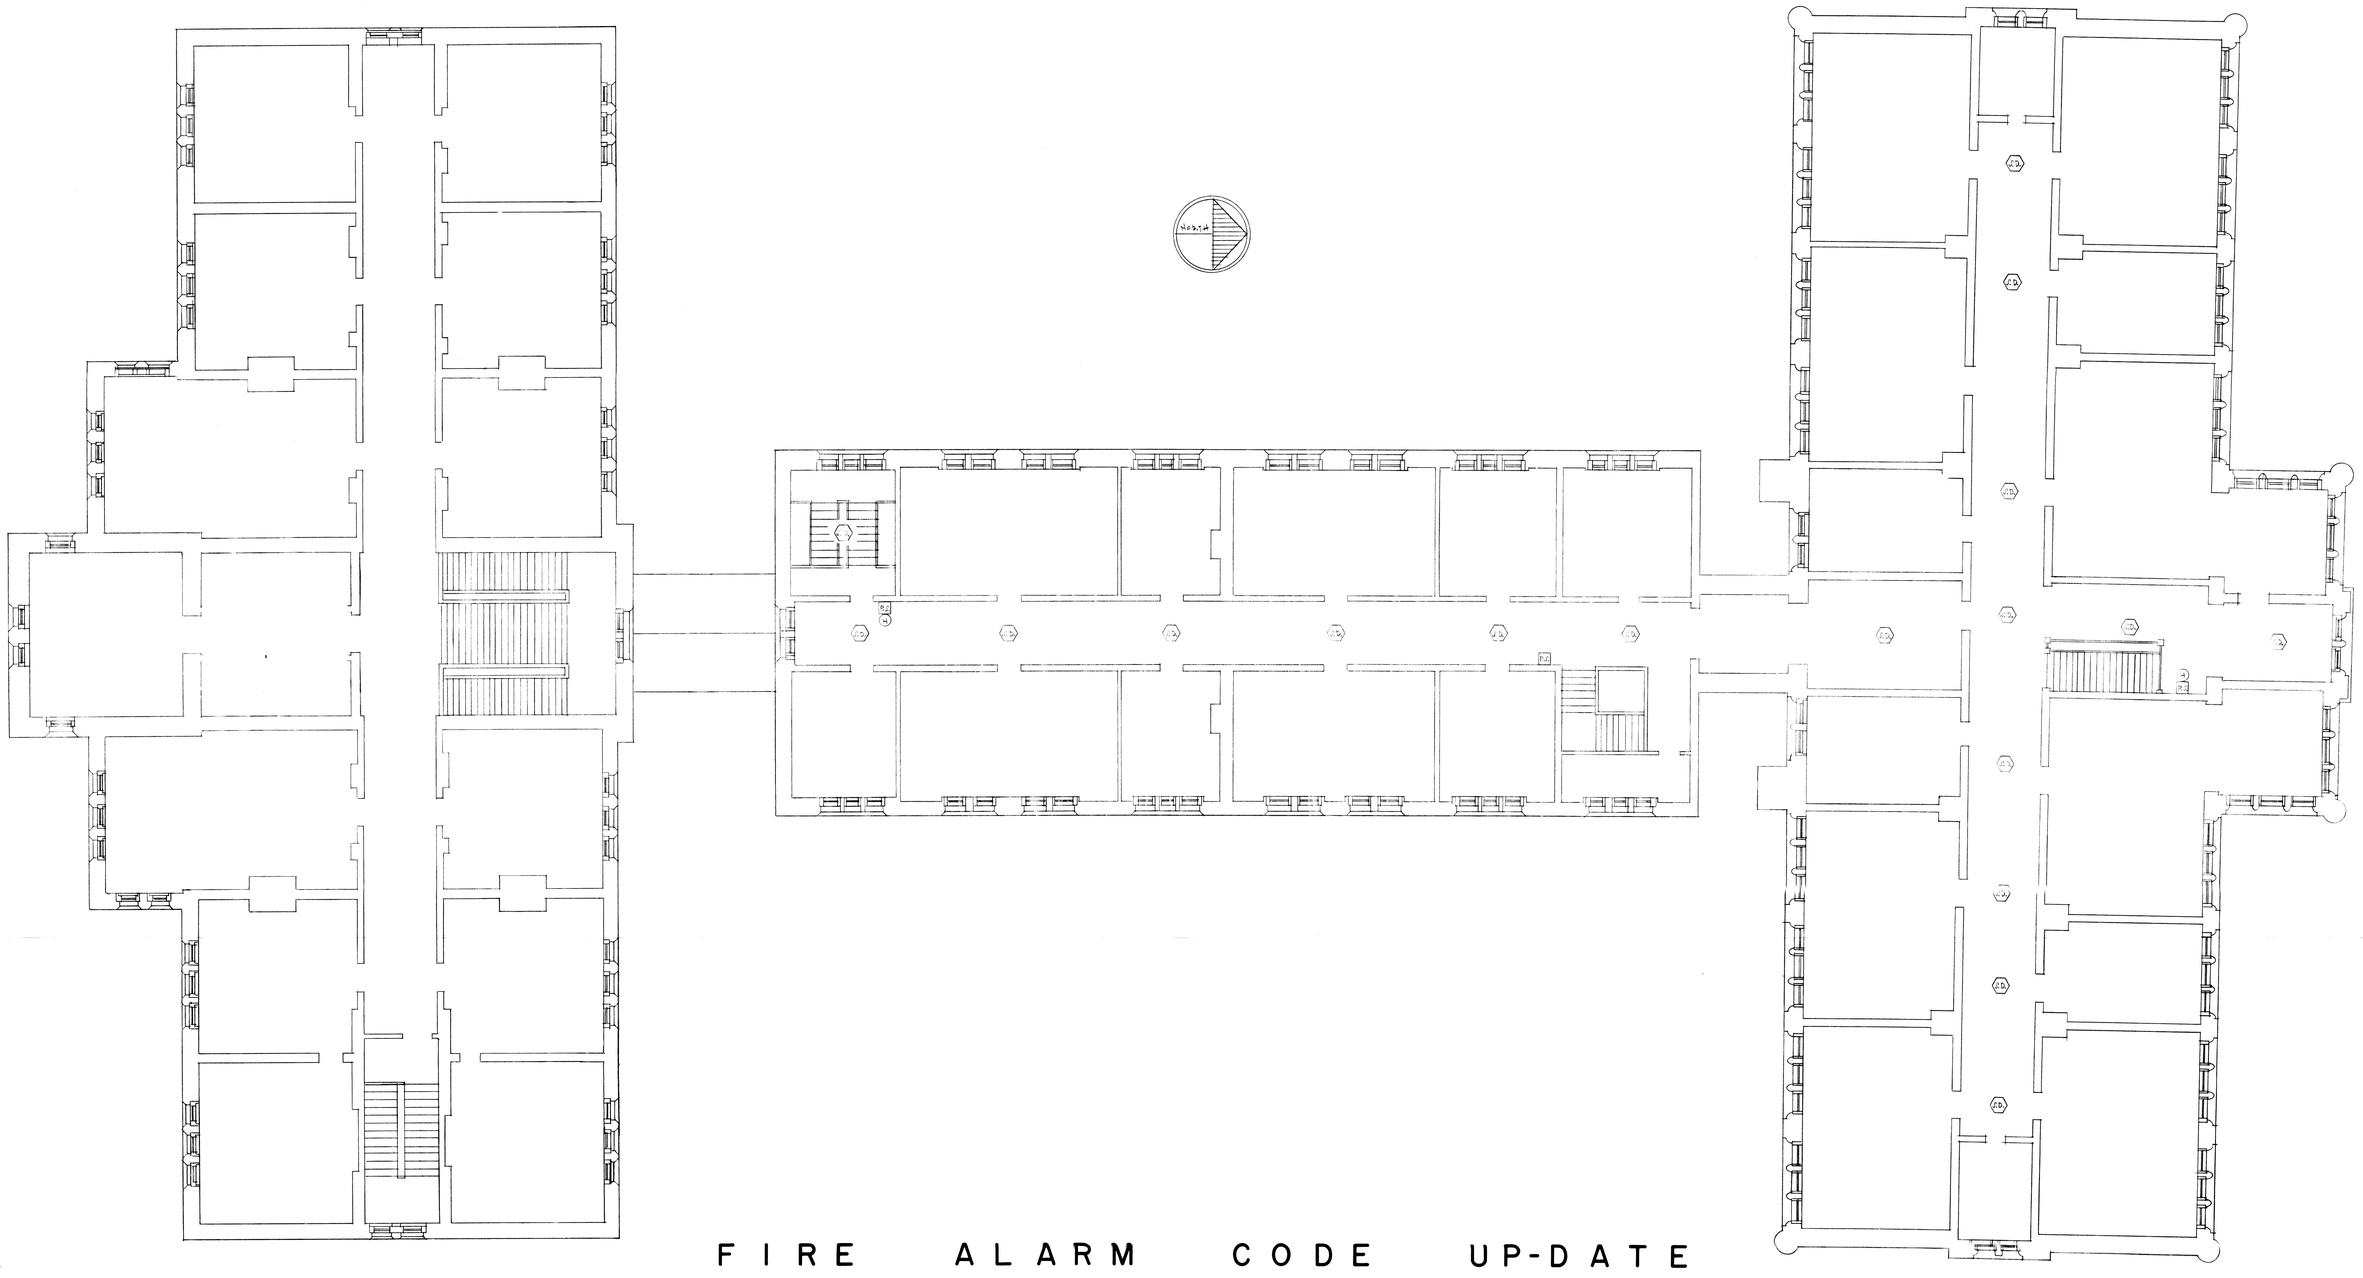

FIRE ALARM CODE UP-DATE

SHERMAN · BUILDING

THIRD · FLOOR

U. S. S. A. H.

DATE: _____ DESIGN: R.E.
SCALE: 1/8" = 1'-0" CHK.: _____
DRAWN: A.G. HH. REVIEW: _____
SHEET 4 OF 5 APPROVED: _____

LEGEND

- (SD) SMOKE DETECTOR
- (HD) HEAT DETECTOR
- (W) WATER FLOW
- (T) TAMPER
- PS PULL STATION
- (H) HORN
- DOOR MAGNET

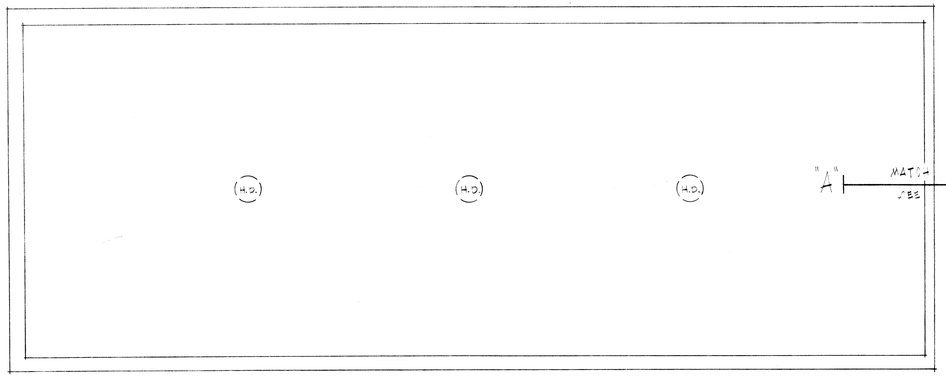

ANNEX ATTIC PLAN

EXISTING HEAT DETECTORS SCALE: 1/8" = 1'-0"

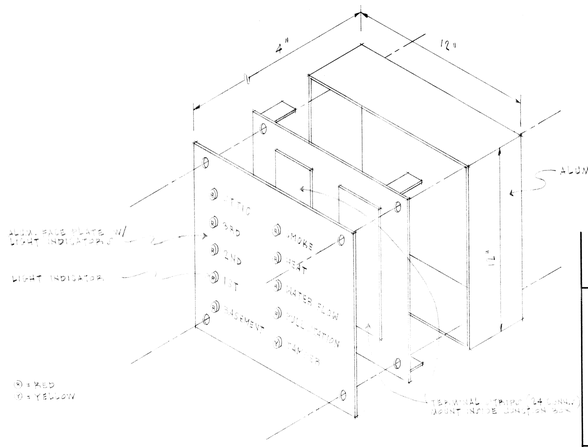

WALL MOUNT ANNUNCIATOR PANEL BOX

SCALE: 1/4" = 1"

WIRE INDEX	
ZONE ALARM CODE	CODE
2 - BROWN	HEAT DETECTOR
1 - RED 1 - BLACK	SMOKE DETECTOR
2 - PINK	TAMPER
2 - VIOLET	WATER FLOW
2 - BLUE	PULL STATION
1 - YELLOW 1 - ORANGE	HORN

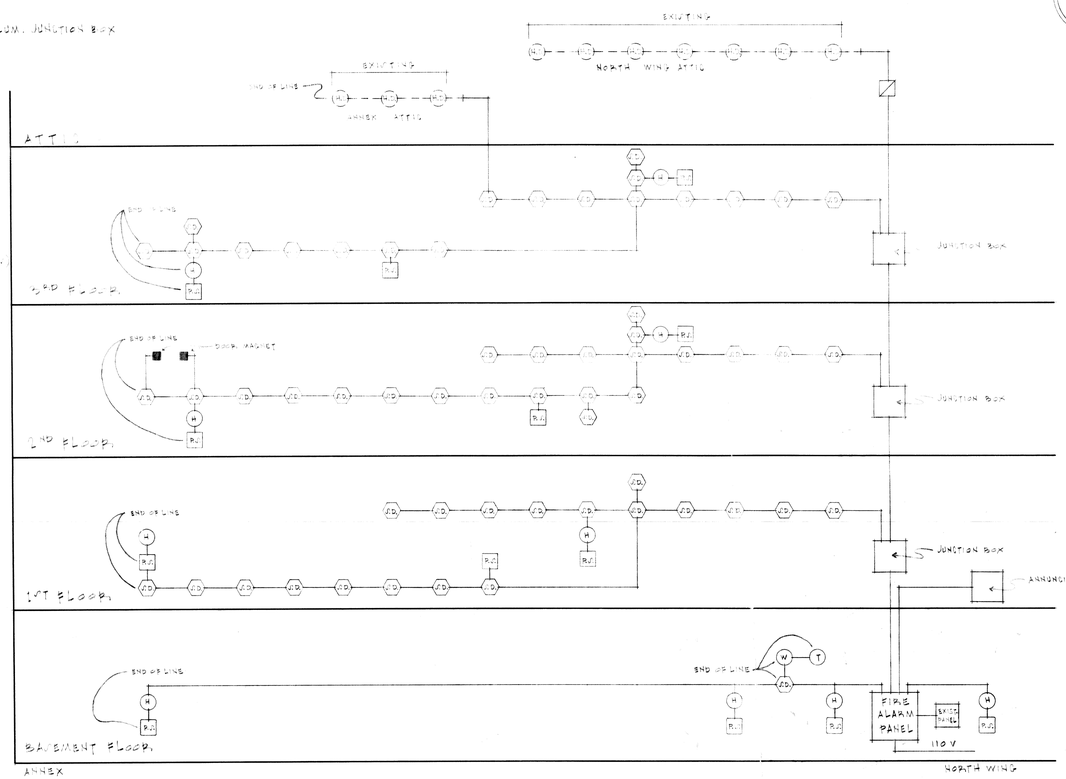

RISER DIAGRAM

NO SCALE

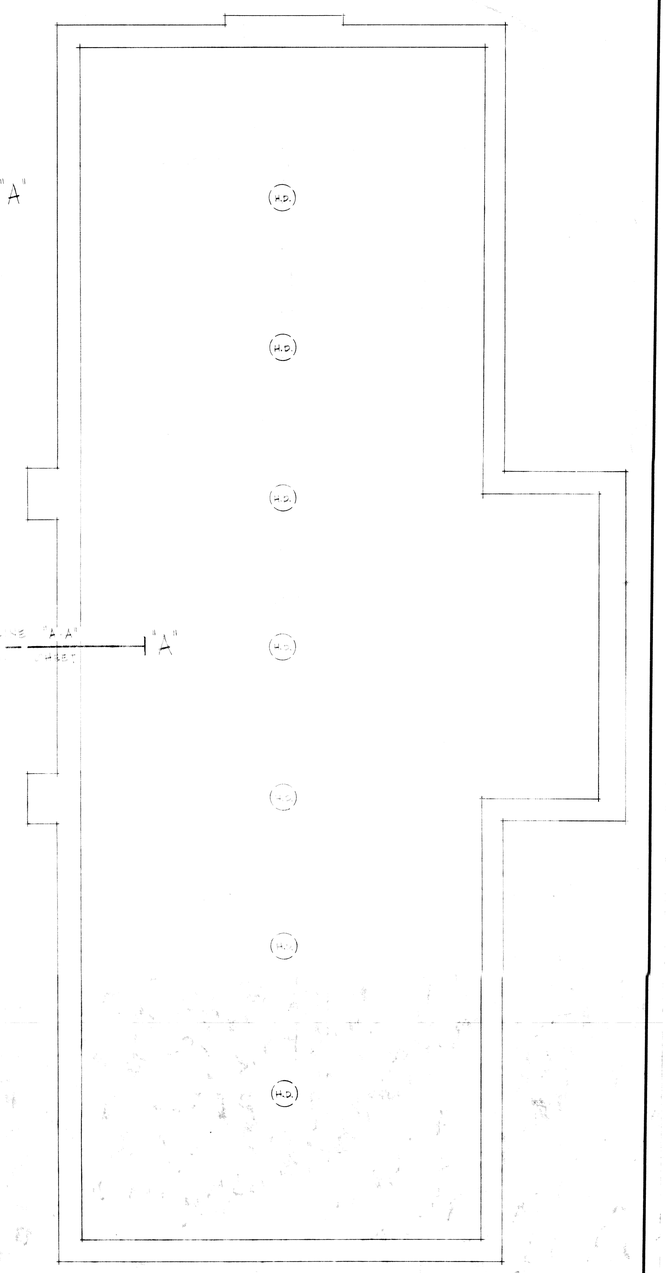

NORTH WING ATTIC PLAN

EXISTING HEAT DETECTORS SCALE: 1/8" = 1'-0"

FIRE ALARM CODE UP-DATE

SHERMAN · BUILDING

ATTIC FL. & RISER DIAGRAM

U. S. S. A. H.

DATE: _____ DESIGN: R.E.

SCALE: AS SHOWN CHK.: _____

DRAWN: A.G. HH. REVIEW: _____

SHEET 5 OF 5 APPROVED: _____