FIRE ALARM LEGEND

(SD)	SMOKE DETECTOR (PROVIDE SMOKE DETECTOR WITH SOUNDER BASE FOR ALL DWELLING UNITS)
M DD	NON-SYSTEM DUCT SMOKE DETECTOR MONITOR MODULE
15 (SA) WP	SPEAKER STROBE - 15 CANDELA OR OTHER RATING (WP - WEATHER PROOF DEVICE)
15 (L) WP	STROBE - 15 CANDELA OR OTHER RATING (WP - WEATHER PROOF DEVICE)
63 F WP	MANUAL FIRE ALARM PULL STATION (WP - WEATHER PROOF DEVICE)
(S) WP	SPEAKER (WP - WEATHER PROOF DEVICE)
63 (HD) WP	HEAT DETECTOR (WP - WEATHERPROOF DEVICE)
M FP	FIRE PUMP MONITOR MODULE
M DD	NON-SYSTEM DUCT SMOKE DETECTOR MONITOR MODULE AND/OR RELAY CONTROL 63
DD AHU	AIR HANDLER UNIT DUCT SMOKE DETECTOR, INCLUDING ANY REQUIRED MONITOR MODULES AND CONTROL MODULES 63
DD FDS	DUCT SMOKE DETECTOR FOR FIRE-SMOKE DAMPER
K	KITCHEN HOOD SUPPRESSION MONITOR MODULE
4	HIGH-LOW AIR PRESSURE SUPERVISORY SWITCH (PROVIDE REQUIRED MONITOR/RELAY MODULES)
W	WATERFLOW SWITCH (PROVIDE REQUIRED MONITOR/RELAY MODULES)
P	PRESSURE TYPE WATERFLOW SWITCH (PROVIDE REQUIRED MONITOR/RELAY MODULES)
2	SPRINKLER VALVE SUPERVISORY SWITCH (PROVIDE REQUIRED MONITOR/RELAY MODULES)
FD	FIRE DEPARTMENT TELEPHONE JACK
DH	DOOR HOLDER MONITOR MODULE
FACP	MAIN FIRE ALARM CONTROL PANEL
RFAA	REMOTE FIRE ALARM ANNUNCIATOR CONTROL PANEL

FIRE ALARM ABBREVIATIONS

A/E	ARCHITECT/ENGINEER	MM	MILLIMETER
AFF	ABOVE FINISHED FLOOR	MTG	MOUNTING
APPROX	APPROXIMATE, APPROXIMATELY	NEC	NATIONAL ELECTRIC CODE
AVG	AVERAGE	NEMA	NATIONAL ELECTRIC MANUFACTURRS ASSOCIATION
BLDG	BUILDING	NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
CKT	CIRCUIT	NIC	NOT IN CONTRACT
CLG	CEILING	NTS	NOT TO SCALE
DC	DIRECT CURRENT	OD	OUTSIDE DIAMETER
DEG C	DEGREES CELSIUS	PNL	PANEL
DWG	DRAWING	PWR	POWER
EA	EACH	QTY	QUANTITY
ETC	ETCETERA; AND SO FORTH	REQD	REQUIRED
EXIST	EXISTING	RM	ROOM
FLR	FLOOR	RMC	RIGID METAL CONDUIT
GALV	GALVANIZED	SPEC	SPECIFICATION
GRD	GROUND	STD	STANDARD
HP	HORSEPOWER	SYM	SYMMETRICAL
HT	HEIGHT	TEMP	TEMPORARY
HVAC	HEATING; VENTILATING & AIR CONDITIONING	TYP	TYPICAL
HZ	HERTZ	UL	UNDERWRITER'S LABORATORY
ID	INSIDE DIAMETER	UPS	UNINTERRUPTIBLE POWER SUPPLY
JB	JUNCTION BOX	UON	UNLESS OTHERWISE NOTED
KW	KILOWATT	V	VOLT
MAX	MAXIMUM	VA	VOLT AMPERE
MEZZ	MEZZANINE	VERT	VERTICAL
MFR	MANUFACTURER	W	WIRE
MIN	MINIMUM	WP	WEATHERPROOF

GENERAL NOTES

THE FOLLOWING PROJECT GENERAL NOTES SHALL APPLY TO ALL DRAWINGS:

1. FIRE ALARM SYSTEM DESIGN
   1.1. PROVIDE A COMPLETELY SUPERVISED INTELLIGENT, DIGITAL, ADDRESSABLE VOICE ALARM AND DETECTION AS SHOWN AND DESCRIBED WITHIN THE SPECIFICATIONS. THE SYSTEM SHALL INCLUDE MANUAL FIRE REPORTING, AUTOMATIC SMOKE DETECTION, AUTOMATIC SPRINKLER SYSTEM ALARM MONITORING AND SUPERVISION, AUTOMATIC ELEVATOR RECALL, CONTROL DOOR HOLDER CLOSER COMBINATIONS, UNLOCK DOORS, ELEVATOR CONTROL, AND VISIBLE WARNING STROBES.
   1.2. THIS SYSTEM SHALL SEND SIGNALS TO THE OWNERS MAIN FIRE ALARM BASE SYSTEM AND/OR CITY/DISTRICT'S FIRE DEPARTMENT.
   1.3. DESIGN AND INSTALLATION SHALL BE PERFORMED BY A CERTIFIED FIRE ALARM CONTRACTOR WHO IS LICENSED AND EXPERIENCED IN THE DESIGN AND INSTALLATION OF FIRE ALARM SYSTEMS (3 YEARS MINIMUM). FURNISH ACCEPTABLE EVIDENCE IF NECESSARY.
2. APPLICABLE CODES:
   NFPA 72
   INTERNATIONAL BUILDING CODE
   INTERNATIONAL FIRE CODE
3. CONTRACTOR IS EXPECTED, AS A REQUIREMENT OF THEIR QUALIFICATIONS, TO UTILIZE THEIR KNOWLEDGE AND EXPERIENCE TO ANTICIPATE AND INCLUDE IN THE COST OF ANY WORK THAT MAY BE REQUIRED, BUT IS NOT SPECIFICALLY EXPRESSED IN THE BID DOCUMENTS.
4. THE CONTRACTOR SHALL PROVIDE ALL LABOR, MATERIAL, TOOLS, EQUIPMENT, SERVICES AND RELATED ACCESSORIES FOR A COMPLETE INSTALLATION OF ALL FIRE ALARM WORK AS INDICATED IN THE CONTRACT DOCUMENTS, INCLUDING THE DRAWINGS AND SPECIFICATIONS.
5. ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE CONTRACT DOCUMENTS, IN A NEAT AND WORKMANLIKE MANNER CONSISTENT WITH RECOGNIZED GOOD PRACTICE. ALL ITEMS SHALL BE U.L. APPROVED AND LISTED & ISO9001 APPROVED WHERE APPLICABLE.
6. ITEMS OMITTED FROM EITHER THE SPECIFICATIONS OR THE DRAWINGS, BUT SHOWN OR DESCRIBED IN THE OTHER TRADES, AND ALL ITEMS NECESSARY TO MAKE THE FIRE ALARM SYSTEM COMPLETE AND WORKABLE SHALL FORM A PART OF THE WORK.
7. ALL REQUIRED CONDUITS AND WIRING WHICH ARE PHYSICALLY NOT SHOWN ON PLAN DRAWINGS, BUT INDICATED ON SCHEDULES, RISER DIAGRAMS, DETAILS, ETC., AND WIRING ON DEVICES AND EQUIPMENT SHALL BE PROVIDED AND INSTALLED.
8. CHECK ALL CIVIL, ARCHITECTURAL, STRUCTURAL, MECHANICAL, PLUMBING, ELECTRICAL, COMMUNICATION, SECURITY, AND OTHER TRADES WORK TO VERIFY EXACT SPACE CONDITIONS AND FOR POSSIBLE INTERFERENCE CAUSED BY CONDITIONS IN THE FIELD. NO ALLOWANCE SHALL SUBSEQUENTLY BE MADE TO THE CONTRACTOR BY REASON OF HIS FAILURE TO HAVE MADE SUCH EXAMINATIONS OR OF ANY ERROR ON HIS PART.
9. UNLESS OTHERWISE INDICATED, ALL MOUNTING ELEVATIONS ARE ABOVE FINISHED FLOOR TO CENTER OF EQUIPMENT.
10. THIS PLAN IS CONSIDERED DIAGRAMMATIC ONLY. THE CONTRACTOR SHALL RUN ALL CONDUITS CONCEALED IN FLOOR SLAB, WALLS OR COLUMNS, EXCEPT IN ELECTRICAL, TELECOMMUNICATION, SECURITY ROOMS, TRANSFORMER VAULTS AND MECHANICAL ROOMS WHERE CONDUITS CAN RUN EXPOSED.
11. ALL PENETRATIONS OF SMOKE TIGHT PARTITIONS AND BARRIERS MUST BE SEALED WITH CODE-APPROVED FIRE STOPPING MATERIALS. PROVIDE FIRESTOPPING RATINGS BASED ON THE FOLLOWING: 63
    11.1. CORRIDORS, MECHANICAL ROOMS, ELECTRICAL ROOMS, ELEVATOR LOBBIES, LINEN/TRASH ROOMS, AREA OF REFUGE, DWELLING UNIT SEPARATION, SMOKE COMPARTMENT SEPARATION AND SPRINKLER/FIRE PUMP ROOMS = 1-HR.
    11.2. SHAFTS, HORIZONTAL EXITS, STAIRS, AND FLOOR/CEILING PENETRATIONS = 2-HR.
12. ALL SPARE CONDUITS SHALL BE CAPPED AT EACH END AND INCLUDE A POLYPROPYLENE OR MONOFILAMENT PULLWIRE. PROVIDE A LABEL ON ALL SPARE CONDUIT IDENTIFYING EACH END.
13. PROVIDE AND INSTALL GROUNDING TYPE EXPANSION FITTINGS OR OTHER APPROVED METHODS TO ALLOW FOR EXPANSION, CONTRACTION, AND DEFLECTION WHERE CONDUITS CROSS EXPANSION JOINTS. DUCT BANK UNDER FLOOR SHALL UTILIZE WATER TIGHT EXPANSION FITTINGS.
14. FOLLOW MANUFACTURER'S RECOMMENDATION FOR INSTALLATION OF ALL EQUIPMENT.
15. CONTRACTOR SHALL REMOVE ALL TEMPORARY EQUIPMENT, WIRING, CONDUITS, LIGHTING, ETC. AFTER COMPLETION OF WORK.
16. SYNCHRONIZATION - ALL FIRE ALARM STROBES/NOTIFICATION DEVICES IN THE LINE OF SIGHT SHALL BE SYNCHRONIZED AS PER NFPA 72. THIS SYNCHRONIZATION SHALL BE MAINTAINED IN ALL PHASES.
17. MINIMUM SIZE OF 1/2" RACEWAY SHALL BE PROVIDED, U.O.N.
18. PROVIDE A MINIMUM OF 1 WATT CIRCUIT TAP FOR SPEAKERS IN THE UTILITY AREAS SUCH AS MECHANICAL ROOMS, AND PROVIDE A MINIMUM OF 0.5 WATT PER TAP FOR ALL SPEAKERS, U.O.N.
19. PROVIDE CI (CIRCUIT INTEGRITY) CABLE FOR ALL EVACUATION TYPE CIRCUITS, THAT ENTER/EXIT A ZONE, FLOOR OR FIRE WALL.
20. LOCATION FOR CEILING MOUNTED DEVICES - LOCATION OF ALL FIRE ALARM DEVICES SHALL BE COORDINATED WITH LIGHT FIXTURES, AIR OUTLET DIFFUSERS AND OTHER OBSTRUCTIONS. SMOKE DETECTORS SHALL BE LOCATED AT LEAST 3 FEET FROM ANY DIFFUSER OR RETURN GRILLS.
21. CONTRACTOR SHALL PROVIDE TESTING OF THE FIRE ALARM SYSTEM IN ACCORDANCE WITH APPLICABLE CODES, STANDARDS, LOCAL ORDINANCES HAVING JURISDICTION, ENGINEER AND OWNER. PROVIDE ALL APPROVED EQUIPMENT FOR TESTING.
22. PRELIMINARY TESTING: CONTRACTOR SHALL PERFORM PRE-TESTING, PER NFPA 72, BEFORE PERFORMING A FINAL TEST IN THE PRESENCE OF THE AUTHORITY HAVING JURISDICTION, ENGINEER AND/OR CONTRACTING OFFICER OR HIS DESIGNATED REPRESENTATIVE
23. ALL FIRE ALARM WIRING SHALL BE IN CONDUIT.
24. ALL FIRE ALARM SYSTEM JUNCTION BOX COVERS ARE TO BE RED, WITH LETTERS "FA" APPEARING IN WHITE LETTERS.
25. FIRE ALARM CONTRACTOR SHALL PROVIDE SMOKE DETECTORS ABOVE ALL FIRE ALARM CONTROL PANELS, ANNUNCIATOR PANELS AND NAC PANELS (NOT SHOWN ON DRAWINGS).
26. FIRE ALARM SYSTEM NEEDS TO BE INTERFACED FOR RECALL AND SHUNT TRIP OF THE ELEVATORS.
27. SEE SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
28. FIRE ALARM SYSTEM DESIGN SHALL MEET THE FOLLOWING REQUIREMENTS REGARDING SURVIVABILITY:
    28.1. AT LEAST TWO VERTICAL RISERS SHALL BE INSTALLED AS REMOTE AS PRACTICABLE FROM EACH OTHER SO THAT A SINGLE FIRE WILL NOT INVOLVE BOTH RISERS.
    28.2. THE VERTICAL RISERS SHALL BE PROTECTED BY A MINIMUM 2-HOUR RATED ENCLOSURE OR AN APPROVED 2-HOUR RATED CABLE OR SYSTEM, NOT COMMON TO BOTH VERTICAL RISERS.
    28.3. THE HORIZONTAL INTERCONNECTION BETWEEN THE VERTICAL RISERS AT THE TOP AND BOTTOM SHALL BE PROTECTED BY A MINIMUM 2-HOUR RATED ENCLOSURE, OR AN APPROVED 2-HOUR CABLE OR SYSTEM, OR AN APPROVED CONSTRUCTION MATERIAL HAVING A 2-HOUR FIRE RESISTANCE RATING.
    28.4. PROVIDE AT LEAST TWO NOTIFICATION APPLIANCE CIRCUITS FOR EACH FLOOR.
    28.5. ADJACENT NOTIFCATION APPLIANCES SHALL NOT BE CONNECTED TO THE SAME NOTIFICATION APPLIANCE CIRCUITS.
29. THE FIRE ALARM SPEAKER LAYOUT IS SUBJECT TO THE AUDIBLE PERFORMANCE REQUIRED IN NFPA 72 AND THE CONTRACTOR SHALL PROVIDE THE NECESSARY AUDIBLE LEVELS THROUGHOUT THE BUILDING. THE CONTRACTOR IS PERMITTED TO DEVIATE FROM THE DESIGN HEREIN SO LONG AS THESE REQUIREMENTS ARE MET.
30. FINAL FIRE ALARM STROBE LOCATIONS ARE SUBJECT TO APPROVAL DURING THE SHOP DRAWING PHASE OF THE PROJECT. THE CONTRACTOR IS PERMITTED TO DEVIATE FROM THE DESIGN HEREIN SO LONG AS THE REQUIREMENTS FROM THE APPLICABLE CODES ARE MET.

SYSTEM SUMMARY

1. OWNER: ARMED FORCES RETIREMENT HOME/FEDERAL GOVERNMENT
2. LOCATION: GULFPORT, MS
3. SYSTEM DESCRIPTION: ADDRESSABLE FIRE ALARM SYSTEM, COMPLETE WITH AUDIBLE/VISUAL ALARMS, MANUAL FIRE ALARM PULL STATIONS, SPEAKERS, VALVE TAMPER MONITORING, WATERFLOW SWITCH MONITORING, WIRING, CONDUIT, ETC.
4. ENGINEER OF RECORD: URS CORPORATION - WASHINGTON DC
5. INTERCONNECTED RISER LOOP OR NETWORK: STYLE 7 - CLASS A
6. INITIATING DEVICE CIRCUITS: CLASS B 63
7. SIGNALING LINE CIRCUITS FOR EACH FLOOR: CLASS A
8. SIGNALING LINE CIRCUITS FOR NETWORKS: STYLE 7 - CLASS A
9. NOTIFICATION APPLIANCE CIRCUITS: CLASS B 63
10. FIRE ALARM SYSTEM SHALL BE MONITORED BY OWNERS CENTRAL STATION OR APPROVED MONITORING COMPANY. COORDINATE WITH OWNER.
11. FIRE ALARM SYSTEM INCLUDES SMOKE DETECTION AND FIRE SPRINKLER WATERFLOW MONITORING FOR ELEVATOR RECALL AND SHUNT-TRIP.
12. SEISMIC: THE CONTRACTOR SHALL PROVIDE SEISMIC BRACING AS REQUIRED BY AUTHORITY HAVING JURISDICTION, BUILDING CODE AND NFPA STANDARDS.
13. BATTERIES, EXTENDER PANELS, AND THE LIKE ARE NOT SHOWN ON THE PLANS, CONTRACTOR IS EXPECTED TO PROVIDE ALL EQUIPMENT FOR INSTALLATION IN THE SHOP DRAWINGS.
14. THIS WORK DOES NOT INCLUDE A MASS NOTIFICATION SYSTEM.
15. ALL SMOKE DETECTORS IN DWELLING UNITS SHALL BE PROVIDED WITH SOUNDER BASE FOR DWELLING UNIT ANNUNCIATION ONLY. NOT ALL SMOKE DETECTIONS SHOWN ON FLOOR PLANS. SEE TYPICAL DWELLING UNIT DETAILS FOR EXACT LOCATION.
16. PROVIDE FIRE ALARM SPEAKERS IN ALL ELEVATOR CABS AND IN EXIT STAIRS. THESE SPEAKERS SHALL ONLY ANNUNCIATE "LIVE" MESSAGES MADE FROM THE FIRE COMMAND CENTER.
17. THE FIRE ALARM SYSTEM SHALL PROVIDE ALL SIGNALS (TROUBLE, ALARM AND SUPERVISORY) TO THE BUILDING AUTOMATED SYSTEM AND SECURITY SYSTEM, AS REQUIRED.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CERTIFICATIONS

DWANE HATTENBACH
REGISTERED PROFESSIONAL
ENGINEER
16355
STATE OF MISSISSIPPI
2009.04.17

KEY PLAN

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	FIRE ALARM GENERAL INFORMATION
FILE NAME	FA-001-N0095730.DWG
FLOOR NO.	
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 0 01
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF -

PROPERTY OF THE UNITED STATES GOVERNMENT - FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

FIRE ALARM LEGEND	
SD	SMOKE DETECTOR (PROVIDE SMOKE DETECTOR WITH SOUNDER BASE FOR ALL DWELLING UNITS)
MDD	NON-SYSTEM DUCT SMOKE DETECTOR MONITOR MODULE
15SWP	SPEAKER STROBE – 15 CANDELA OR OTHER RATING (WP – WEATHER PROOF DEVICE)
15LWP	STROBE – 15 CANDELA OR OTHER RATING (WP – WEATHER PROOF DEVICE)
F	MANUAL FIRE ALARM PULL STATION
SWP	SPEAKER (WP – WEATHER PROOF DEVICE)
MFP	FIRE PUMP MONITOR MODULE
MDD	NON-SYSTEM DUCT SMOKE DETECTOR MONITOR MODULE
DDAHU	AIR HANDLER UNIT DUCT SMOKE DETECTOR
DDNS	NON-SYSTEM DUCT SMOKE DETECTOR
K	KITCHEN HOOD SUPPRESSION MONITOR MODULE
A	HIGH-LOW AIR PRESSURE SUPERVISORY SWITCH (PROVIDE REQUIRED MONITOR/RELAY MODULES)
W	WATERFLOW SWITCH (PROVIDE REQUIRED MONITOR/RELAY MODULES)
P	PRESSURE TYPE WATERFLOW SWITCH (PROVIDE REQUIRED MONITOR/RELAY MODULES)
A	SPRINKLER VALVE SUPERVISORY SWITCH (PROVIDE REQUIRED MONITOR/RELAY MODULES)
FD	FIRE DEPARTMENT TELEPHONE JACK
DH	DOOR HOLDER MONITOR MODULE
FACP	MAIN FIRE ALARM CONTROL PANEL
RFAA	REMOTE FIRE ALARM ANNUNCIATOR CONTROL PANEL

FIRE ALARM ABBREVIATIONS			
A/E	ARCHITECT/ENGINEER	MM	MILLIMETER
AFF	ABOVE FINISHED FLOOR	MTG	MOUNTING
APPROX	APPROXIMATE, APPROXIMATELY	NEC	NATIONAL ELECTRIC CODE
AVG	AVERAGE	NEMA	NATIONAL ELECTRIC MANUFACTURRS ASSOCIATION
BLDG	BUILDING	NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
CKT	CIRCUIT	NIC	NOT IN CONTRACT
CLG	CEILING	NTS	NOT TO SCALE
DC	DIRECT CURRENT	OD	OUTSIDE DIAMETER
DEG C	DEGREES CELSIUS	PNL	PANEL
DWG	DRAWING	PWR	POWER
EA	EACH	QTY	QUANTITY
ETC	ETCETERA; AND SO FORTH	REQD	REQUIRED
EXIST	EXISTING	RM	ROOM
FLR	FLOOR	RMC	RIGID METAL CONDUIT
GALV	GALVANIZED	SPEC	SPECIFICATION
GRD	GROUND	STD	STANDARD
HP	HORSEPOWER	SYM	SYMMETRICAL
HT	HEIGHT	TEMP	TEMPORARY
HVAC	HEATING; VENTILATING & AIR CONDITIONING	TYP	TYPICAL
HZ	HERTZ	UL	UNDERWRITER'S LABORATORY
ID	INSIDE DIAMETER	UPS	UNINTERRUPTIBLE POWER SUPPLY
JB	JUNCTION BOX	UON	UNLESS OTHERWISE NOTED
KW	KILOWATT	V	VOLT
MAX	MAXIMUM	VA	VOLT AMPERE
MEZZ	MEZZANINE	VERT	VERTICAL
MFR	MANUFACTURER	W	WIRE
MIN	MINIMUM	WP	WEATHERPROOF

GENERAL NOTES

THE FOLLOWING PROJECT GENERAL NOTES SHALL APPLY TO ALL DRAWINGS:

1. FIRE ALARM SYSTEM DESIGN
   1.1. PROVIDE A COMPLETELY SUPERVISED INTELLIGENT, DIGITAL, ADDRESSABLE VOICE ALARM AND DETECTION AS SHOWN AND DESCRIBED WITHIN THE SPECIFICATIONS. THE SYSTEM SHALL INCLUDE MANUAL FIRE REPORTING, AUTOMATIC SMOKE DETECTION, AUTOMATIC SPRINKLER SYSTEM ALARM MONITORING AND SUPERVISION, AUTOMATIC ELEVATOR RECALL, CONTROL DOOR HOLDER CLOSER COMBINATIONS, UNLOCK DOORS, ELEVATOR CONTROL, AND VISIBLE WARNING STROBES.
   1.2. THIS SYSTEM SHALL SEND SIGNALS TO THE OWNERS MAIN FIRE ALARM BASE SYSTEM AND/OR CITY/DISTRICT'S FIRE DEPARTMENT.
   1.3. DESIGN AND INSTALLATION SHALL BE PERFORMED BY A CERTIFIED FIRE ALARM CONTRACTOR WHO IS LICENSED AND EXPERIENCED IN THE DESIGN AND INSTALLATION OF FIRE ALARM SYSTEMS (3 YEARS MINIMUM). FURNISH ACCEPTABLE EVIDENCE IF NECESSARY.
2. APPLICABLE CODES:
   NFPA 72
   INTERNATIONAL BUILDING CODE
   INTERNATIONAL FIRE CODE
3. CONTRACTOR IS EXPECTED, AS A REQUIREMENT OF THEIR QUALIFICATIONS, TO UTILIZE THEIR KNOWLEDGE AND EXPERIENCE TO ANTICIPATE AND INCLUDE IN THE COST OF ANY WORK THAT MAY BE REQUIRED, BUT IS NOT SPECIFICALLY EXPRESSED IN THE BID DOCUMENTS.
4. THE CONTRACTOR SHALL PROVIDE ALL LABOR, MATERIAL, TOOLS, EQUIPMENT, SERVICES AND RELATED ACCESSORIES FOR A COMPLETE INSTALLATION OF ALL FIRE ALARM WORK AS INDICATED IN THE CONTRACT DOCUMENTS, INCLUDING THE DRAWINGS AND SPECIFICATIONS.
5. ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE CONTRACT DOCUMENTS, IN A NEAT AND WORKMANLIKE MANNER CONSISTENT WITH RECOGNIZED GOOD PRACTICE. ALL ITEMS SHALL BE U.L. APPROVED AND LISTED & ISO9001 APPROVED WHERE APPLICABLE.
6. ITEMS OMITTED FROM EITHER THE SPECIFICATIONS OR THE DRAWINGS, BUT SHOWN OR DESCRIBED IN THE OTHER TRADES, AND ALL ITEMS NECESSARY TO MAKE THE FIRE ALARM SYSTEM COMPLETE AND WORKABLE SHALL FORM A PART OF THE WORK.
7. ALL REQUIRED CONDUITS AND WIRING WHICH ARE PHYSICALLY NOT SHOWN ON PLAN DRAWINGS, BUT INDICATED ON SCHEDULES, RISER DIAGRAMS, DETAILS, ETC., AND WIRING ON DEVICES AND EQUIPMENT SHALL BE PROVIDED AND INSTALLED.
8. CHECK ALL CIVIL, ARCHITECTURAL, STRUCTURAL, MECHANICAL, PLUMBING, ELECTRICAL, COMMUNICATION, SECURITY, AND OTHER TRADES WORK TO VERIFY EXACT SPACE CONDITIONS AND FOR POSSIBLE INTERFERENCE CAUSED BY CONDITIONS IN THE FIELD. NO ALLOWANCE SHALL SUBSEQUENTLY BE MADE TO THE CONTRACTOR BY REASON OF HIS FAILURE TO HAVE MADE SUCH EXAMINATIONS OR OF ANY ERROR ON HIS PART.
9. UNLESS OTHERWISE INDICATED, ALL MOUNTING ELEVATIONS ARE ABOVE FINISHED FLOOR TO CENTER OF EQUIPMENT.
10. THIS PLAN IS CONSIDERED DIAGRAMMATIC ONLY. THE CONTRACTOR SHALL RUN ALL CONDUITS CONCEALED IN FLOOR SLAB, WALLS OR COLUMNS, EXCEPT IN ELECTRICAL, TELECOMMUNICATION, SECURITY ROOMS, TRANSFORMER VAULTS AND MECHANICAL ROOMS WHERE CONDUITS CAN RUN EXPOSED.
11. ALL PENETRATIONS OF SMOKE TIGHT PARTITIONS AND BARRIERS MUST BE SEALED WITH CODE-APPROVED FIRE STOPPING MATERIALS.
12. ALL SPARE CONDUITS SHALL BE CAPPED AT EACH END AND INCLUDE A POLYPROPYLENE OR MONOFILAMENT PULLWIRE. PROVIDE A LABEL ON ALL SPARE CONDUIT IDENTIFYING EACH END.
13. PROVIDE AND INSTALL GROUNDING TYPE EXPANSION FITTINGS OR OTHER APPROVED METHODS TO ALLOW FOR EXPANSION, CONTRACTION, AND DEFLECTION WHERE CONDUITS CROSS EXPANSION JOINTS. DUCT BANK UNDER FLOOR SHALL UTILIZE WATER TIGHT EXPANSION FITTINGS.
14. FOLLOW MANUFACTURER'S RECOMMENDATION FOR INSTALLATION OF ALL EQUIPMENT.
15. CONTRACTOR SHALL REMOVE ALL TEMPORARY EQUIPMENT, WIRING, CONDUITS, LIGHTING, ETC. AFTER COMPLETION OF WORK.
16. SYNCHRONIZATION – ALL FIRE ALARM STROBES/NOTIFICATION DEVICES IN THE LINE OF SIGHT SHALL BE SYNCHRONIZED AS PER NFPA 72. THIS SYNCHRONIZATION SHALL BE MAINTAINED IN ALL PHASES.
17. MINIMUM SIZE OF 1/2" RACEWAY SHALL BE PROVIDED, U.O.N.
18. PROVIDE A MINIMUM OF 1 WATT CIRCUIT TAP FOR SPEAKERS IN THE UTILITY AREAS SUCH AS MECHANICAL ROOMS, AND PROVIDE A MINIMUM OF 0.5 WATT PER TAP FOR ALL SPEAKERS, U.O.N.
19. PROVIDE CI (CIRCUIT INTEGRITY) CABLE FOR ALL EVACUATION TYPE CIRCUITS, THAT ENTER/EXIT A ZONE, FLOOR OR FIRE WALL.
20. LOCATION FOR CEILING MOUNTED DEVICES – LOCATION OF ALL FIRE ALARM DEVICES SHALL BE COORDINATED WITH LIGHT FIXTURES, AIR OUTLET DIFFUSERS AND OTHER OBSTRUCTIONS. SMOKE DETECTORS SHALL BE LOCATED AT LEAST 3 FEET FROM ANY DIFFUSER OR RETURN GRILLS.
21. CONTRACTOR SHALL PROVIDE TESTING OF THE FIRE ALARM SYSTEM IN ACCORDANCE WITH APPLICABLE CODES, STANDARDS, LOCAL ORDINANCES HAVING JURISDICTION, ENGINEER AND OWNER. PROVIDE ALL APPROVED EQUIPMENT FOR TESTING.
22. PRELIMINARY TESTING: CONTRACTOR SHALL PERFORM PRE-TESTING, PER NFPA 72, BEFORE PERFORMING A FINAL TEST IN THE PRESENCE OF THE AUTHORITY HAVING JURISDICTION, ENGINEER AND/OR CONTRACTING OFFICER OR HIS DESIGNATED REPRESENTATIVE
23. ALL FIRE ALARM WIRING SHALL BE IN CONDUIT.
24. ALL FIRE ALARM SYSTEM JUNCTION BOX COVERS ARE TO BE RED, WITH LETTERS "FA" APPEARING IN WHITE LETTERS.
25. FIRE ALARM CONTRACTOR SHALL PROVIDE SMOKE DETECTORS ABOVE ALL FIRE ALARM CONTROL PANELS, ANNUNCIATOR PANELS AND NAC PANELS (NOT SHOWN ON DRAWINGS).
26. FIRE ALARM SYSTEM NEEDS TO BE INTERFACED FOR RECALL AND SHUNT TRIP OF THE ELEVATORS.
27. SEE SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
28. FIRE ALARM SYSTEM DESIGN SHALL MEET THE FOLLOWING REQUIREMENTS REGARDING SURVIVABILITY:
    28.1. AT LEAST TWO VERTICAL RISERS SHALL BE INSTALLED AS REMOTE AS PRACTICABLE FROM EACH OTHER SO THAT A SINGLE FIRE WILL NOT INVOLVE BOTH RISERS.
    28.2. THE VERTICAL RISERS SHALL BE PROTECTED BY A MINIMUM 2-HOUR RATED ENCLOSURE OR AN APPROVED 2-HOUR RATED CABLE OR SYSTEM, NOT COMMON TO BOTH VERTICAL RISERS.
    28.3. THE HORIZONTAL INTERCONNECTION BETWEEN THE VERTICAL RISERS AT THE TOP AND BOTTOM SHALL BE PROTECTED BY A MINIMUM 2-HOUR RATED ENCLOSURE, OR AN APPROVED 2-HOUR CABLE OR SYSTEM, OR AN APPROVED CONSTRUCTION MATERIAL HAVING A 2-HOUR FIRE RESISTANCE RATING.
    28.4. PROVIDE AT LEAST TWO NOTIFICATION APPLIANCE CIRCUITS FOR EACH FLOOR.
    28.5. ADJACENT NOTIFCATION APPLIANCES SHALL NOT BE CONNECTED TO THE SAME NOTIFICATION APPLIANCE CIRCUITS.
29. THE FIRE ALARM SPEAKER LAYOUT IS SUBJECT TO THE AUDIBLE PERFORMANCE REQUIRED IN NFPA 72 AND THE CONTRACTOR SHALL PROVIDE THE NECESSARY AUDIBLE LEVELS THROUGHOUT THE BUILDING. THE CONTRACTOR IS PERMITTED TO DEVIATE FROM THE DESIGN HEREIN SO LONG AS THESE REQUIREMENTS ARE MET.
30. FINAL FIRE ALARM STROBE LOCATIONS ARE SUBJECT TO APPROVAL DURING THE SHOP DRAWING PHASE OF THE PROJECT. THE CONTRACTOR IS PERMITTED TO DEVIATE FROM THE DESIGN HEREIN SO LONG AS THE REQUIREMENTS FROM THE APPLICABLE CODES ARE MET.

SYSTEM SUMMARY

1. OWNER: ARMED FORCES RETIREMENT HOME/FEDERAL GOVERNMENT
2. LOCATION: GULFPORT, MS
3. SYSTEM DESCRIPTION: ADDRESSABLE FIRE ALARM SYSTEM, COMPLETE WITH AUDIBLE/VISUAL ALARMS, MANUAL FIRE ALARM PULL STATIONS, SPEAKERS, VALVE TAMPER MONITORING, WATERFLOW SWITCH MONITORING, WIRING, CONDUIT, ETC.
4. ENGINEER OF RECORD: URS CORPORATION – WASHINGTON DC
5. INTERCONNECTED RISER LOOP OR NETWORK: STYLE 7 – CLASS A
6. INITIATING DEVICE CIRCUITS: CLASS A
7. SIGNALING LINE CIRCUITS FOR EACH FLOOR: CLASS A
8. SIGNALING LINE CIRCUITS FOR NETWORKS: STYLE 7 – CLASS A
9. NOTIFICATION APPLIANCE CIRCUITS: CLASS A
10. FIRE ALARM SYSTEM SHALL BE MONITORED BY OWNERS CENTRAL STATION OR APPROVED MONITORING COMPANY. COORDINATE WITH OWNER.
11. FIRE ALARM SYSTEM INCLUDES SMOKE DETECTION AND FIRE SPRINKLER WATERFLOW MONITORING FOR ELEVATOR RECALL AND SHUNT-TRIP.
12. SEISMIC: THE CONTRACTOR SHALL PROVIDE SEISMIC BRACING AS REQUIRED BY AUTHORITY HAVING JURISDICTION, BUILDING CODE AND NFPA STANDARDS.
13. BATTERIES, EXTENDER PANELS, AND THE LIKE ARE NOT SHOWN ON THE PLANS, CONTRACTOR IS EXPECTED TO PROVIDE ALL EQUIPMENT FOR INSTALLATION IN THE SHOP DRAWINGS.
14. THIS WORK DOES NOT INCLUDE A MASS NOTIFICATION SYSTEM.
15. ALL SMOKE DETECTORS IN DWELLING UNITS SHALL BE PROVIDED WITH SOUNDER BASE FOR DWELLING UNIT ANNUNCIATION ONLY. NOT ALL SMOKE DETECTIONS SHOWN ON FLOOR PLANS. SEE TYPICAL DWELLING UNIT DETAILS FOR EXACT LOCATION.
16. PROVIDE FIRE ALARM SPEAKERS IN ALL ELEVATOR CABS AND IN EXIT STAIRS. THESE SPEAKERS SHALL ONLY ANNUNCIATE "LIVE" MESSAGES MADE FROM THE FIRE COMMAND CENTER.
17. THE FIRE ALARM SYSTEM SHALL PROVIDE ALL SIGNALS (TROUBLE, ALARM AND SUPERVISORY) TO THE BUILDING AUTOMATED SYSTEM AND SECURITY SYSTEM, AS REQUIRED.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans
JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

KEY PLAN

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	FIRE ALARM GENERAL INFORMATION
FILE NAME	FA-001-N0095730.DWG
FLOOR NO.	
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 0 01 DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

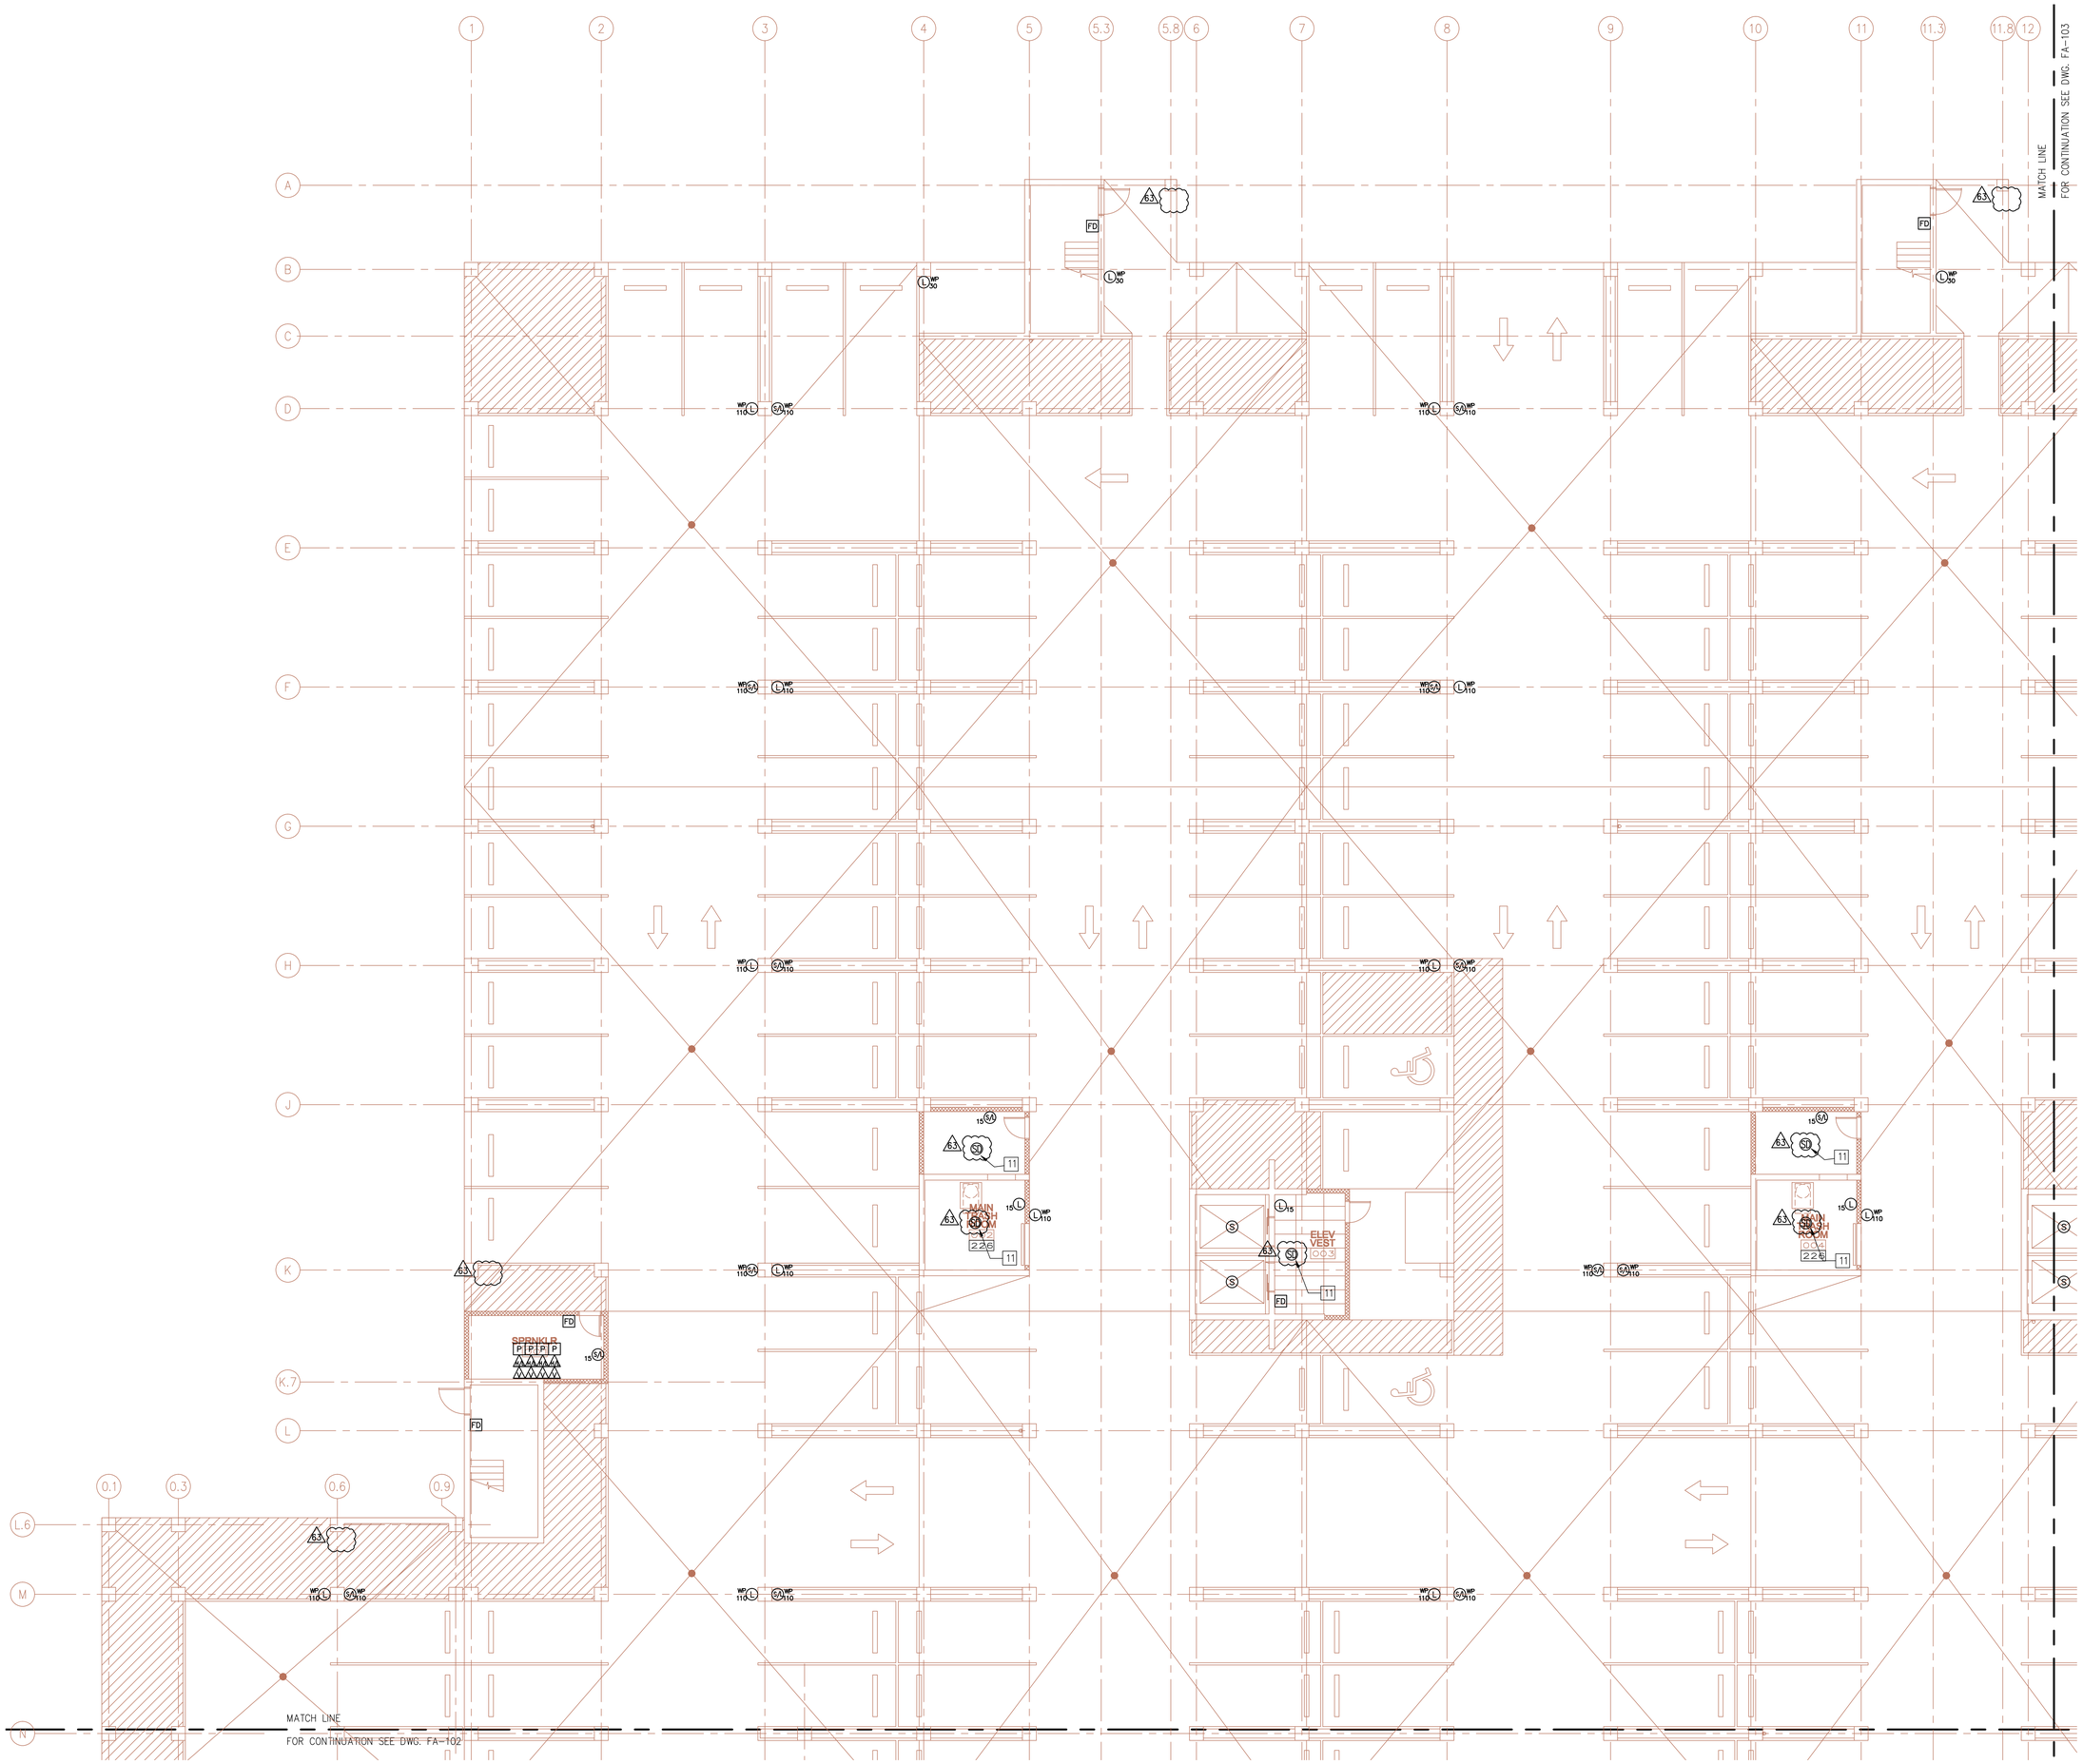

1 FA101 / FA101 — **PARTIAL GARAGE FLOOR - AREA 1 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

11 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

6.3

CERTIFICATIONS

WAYNE HATHORN — REGISTERED PROFESSIONAL ENGINEER — 16355 — STATE OF MISSISSIPPI — final — 2009.04.17

KEY PLAN



AREA 1
GARAGE FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	P1 GARAGE PLAN – AREA 1 – FIRE ALARM
FILE NAME	FA-101-M00957J0.DWG
FLOOR NO.	GARAGE FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 01
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

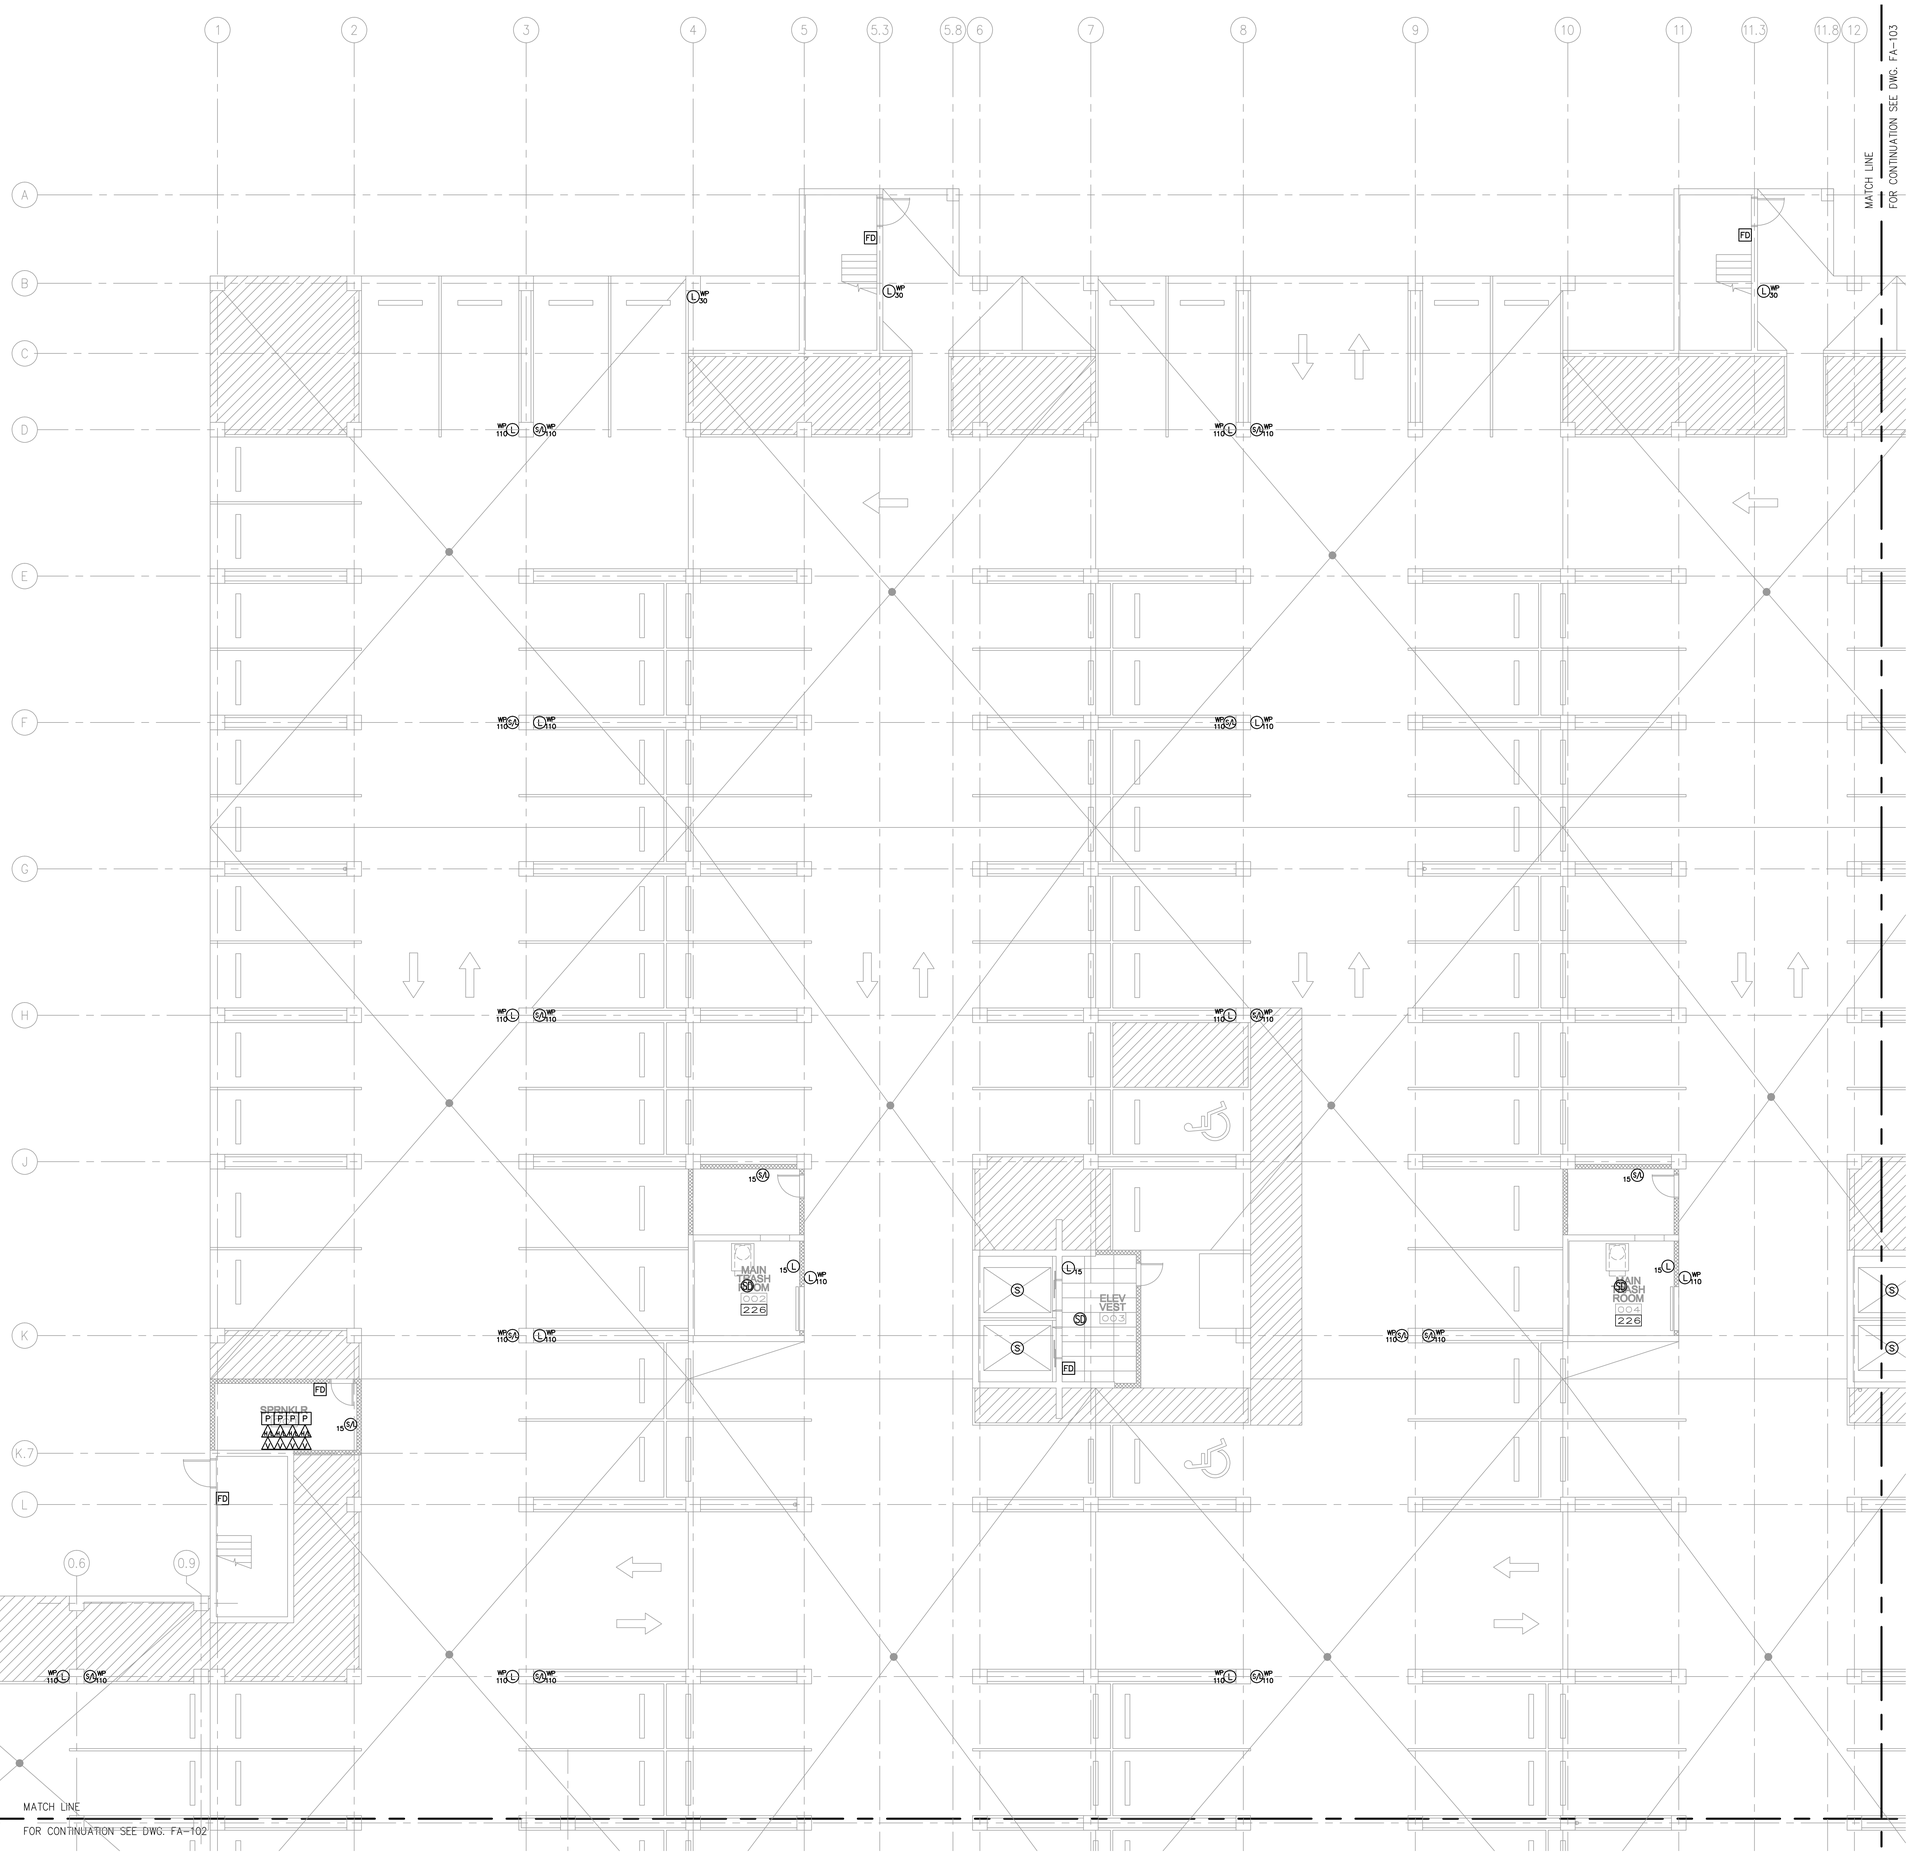

1 FA101 | FA101 **PARTIAL GARAGE FLOOR - AREA 1 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

10 PROVIDE SPEAKERS IN ELEVATOR CABS FOR LIVE FIRE ALARM MESSAGES

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

KEY PLAN

AREA 1
GARAGE FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	P1 GARAGE PLAN – AREA 1 – FIRE ALARM
FILE NAME	FA-101-N0095730.DWG
FLOOR NO.	GARAGE FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 01 DISCIPLINE SHEET TYPE SEQUENCE SHEET OF –

1 **PARTIAL GARAGE FLOOR PLAN - AREA 2 - ENTRY**
FA102A FA102A 1/8"=1'-0"

2 **PARTIAL GARAGE FLOOR PLAN - AREA 2 - ENTRY**
FA102A FA102A 1/8"=1'-0"

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

11 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

CERTIFICATIONS

JEROME HATHAWAY
REGISTERED PROFESSIONAL
ENGINEER
16355
STATE OF MISSISSIPPI
2009.04.17

KEY PLAN

AREA 2
GARAGE FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PART. GARAGE FLR PLAN -AREA 2- ENTRY
FILE NAME	FA-102A-N0095730.DWG
FLOOR NO.	GARAGE FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 02A
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF -

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

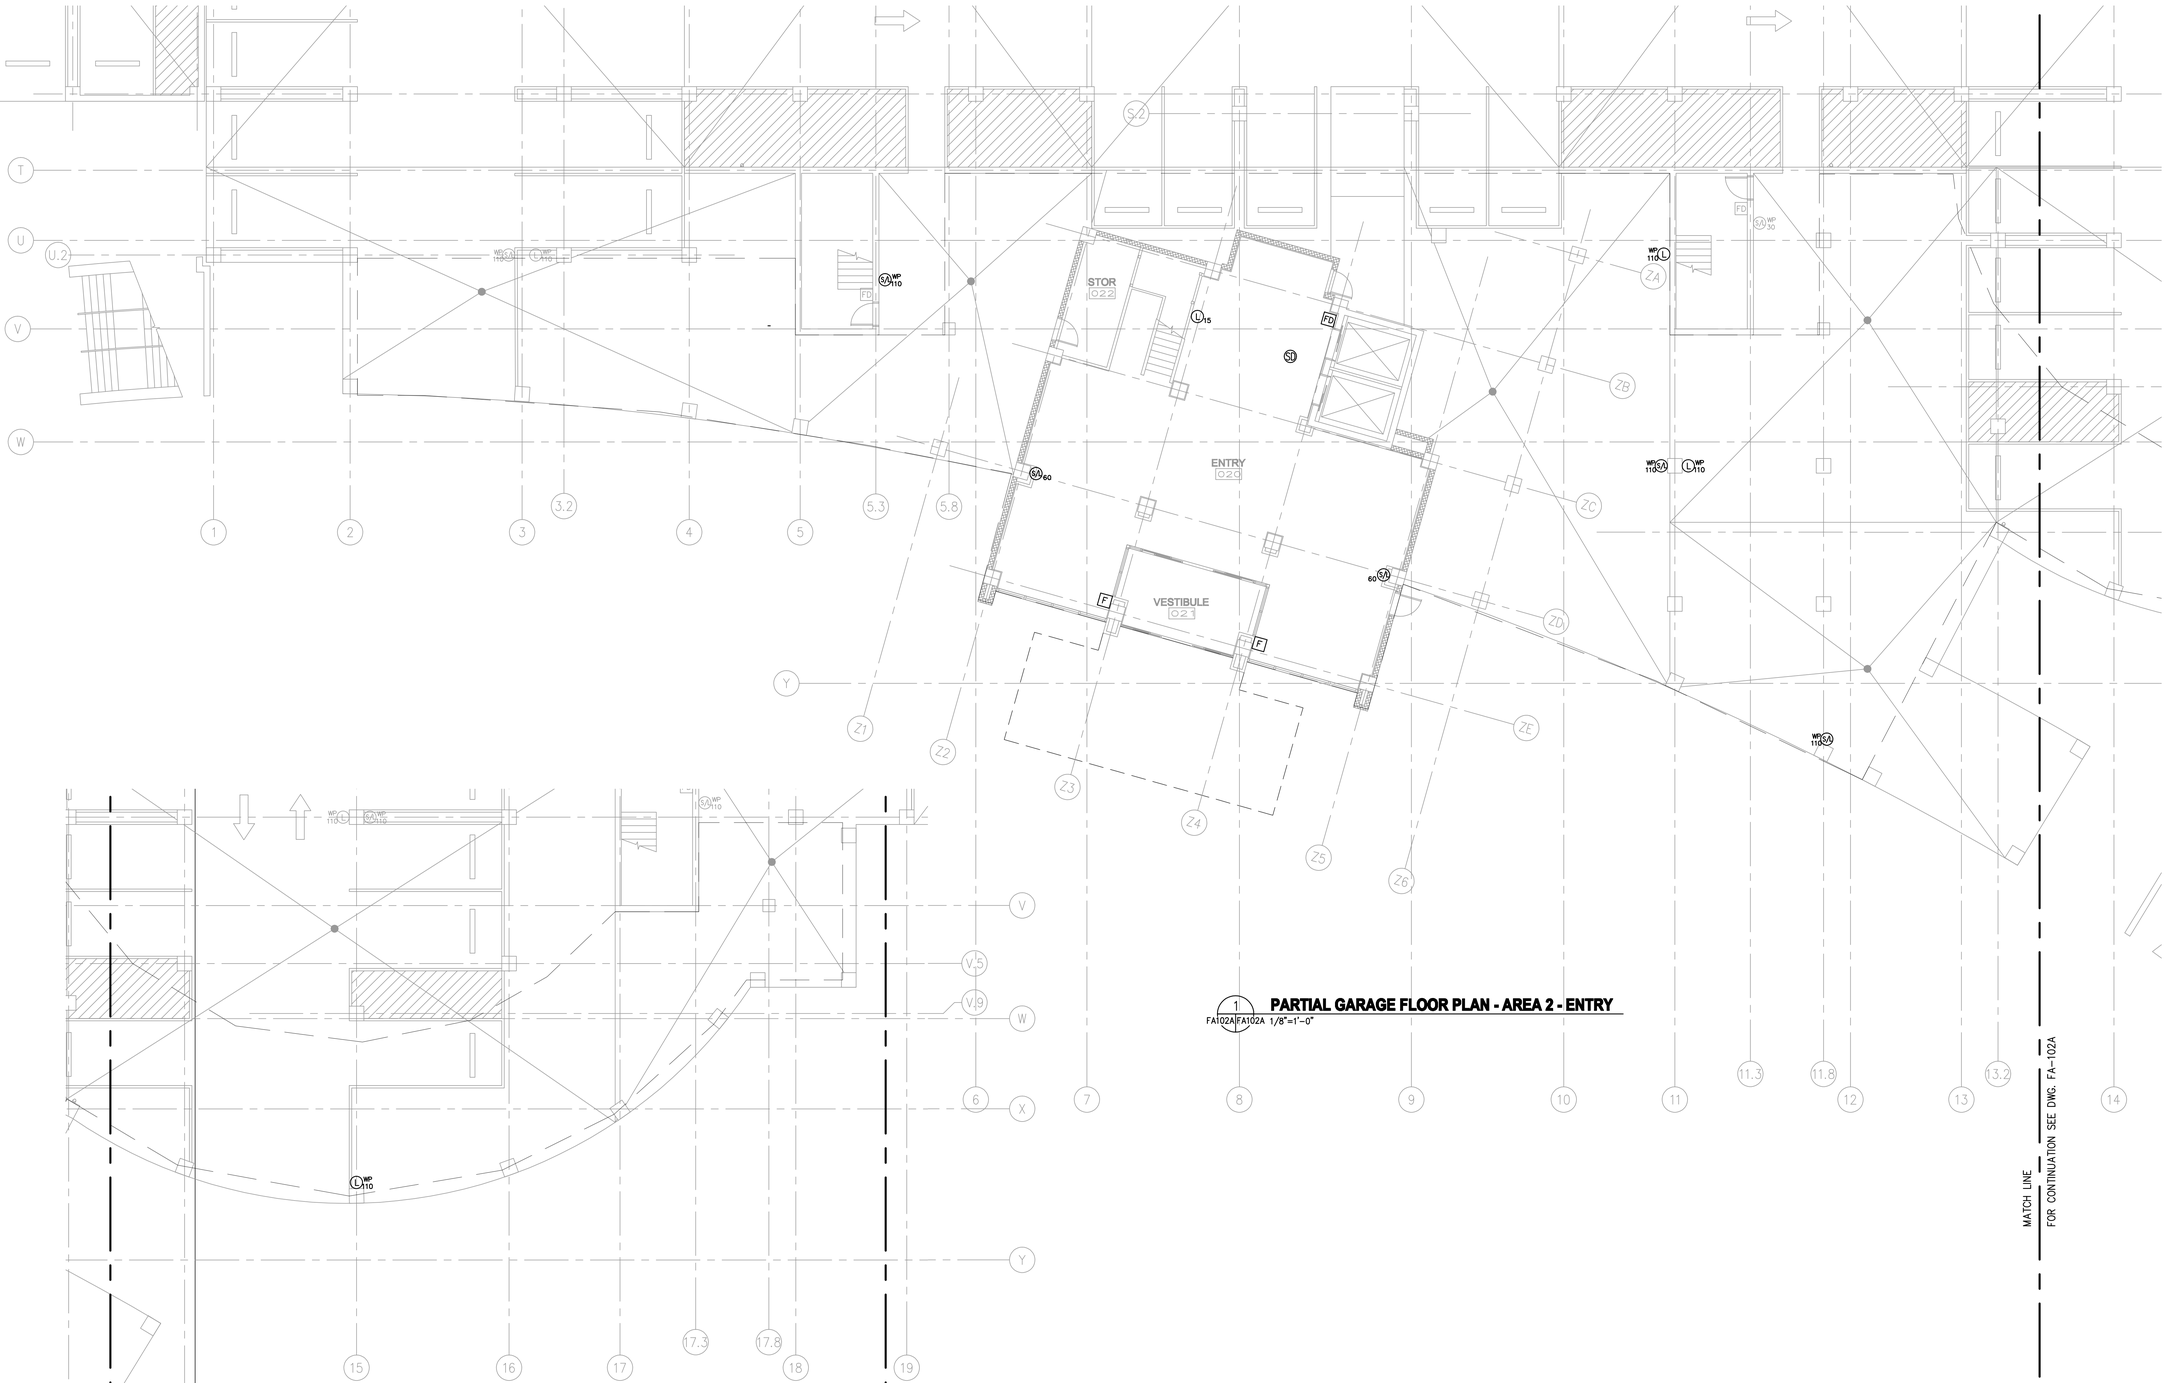

1 **PARTIAL GARAGE FLOOR PLAN - AREA 2 - ENTRY**
FA102A FA102A 1/8"=1'-0"

2 **PARTIAL GARAGE FLOOR PLAN - AREA 2 - ENTRY**
FA102A FA102A 1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

KEY PLAN

AREA 2
GARAGE FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PART. GARAGE FLR PLAN -AREA 2- ENTRY
FILE NAME	FA-102A-N0095730.DWG
FLOOR NO.	GARAGE FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 02A
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

1 FA102 / FA102 — **PARTIAL GARAGE FLOOR - AREA 2 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH
The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

PAUL HARRELL 16355 ENGINEER STATE OF MISSISSIPPI 09.08.08

KEY PLAN



AREA 2
GARAGE FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT GARAGE PLAN – AREA 2 – FIRE ALARM
FILE NAME	FA-102-N0095730.DWG
FLOOR NO.	GARAGE FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 02

DISCIPLINE SHEET TYPE SEQUENCE
SHEET OF –

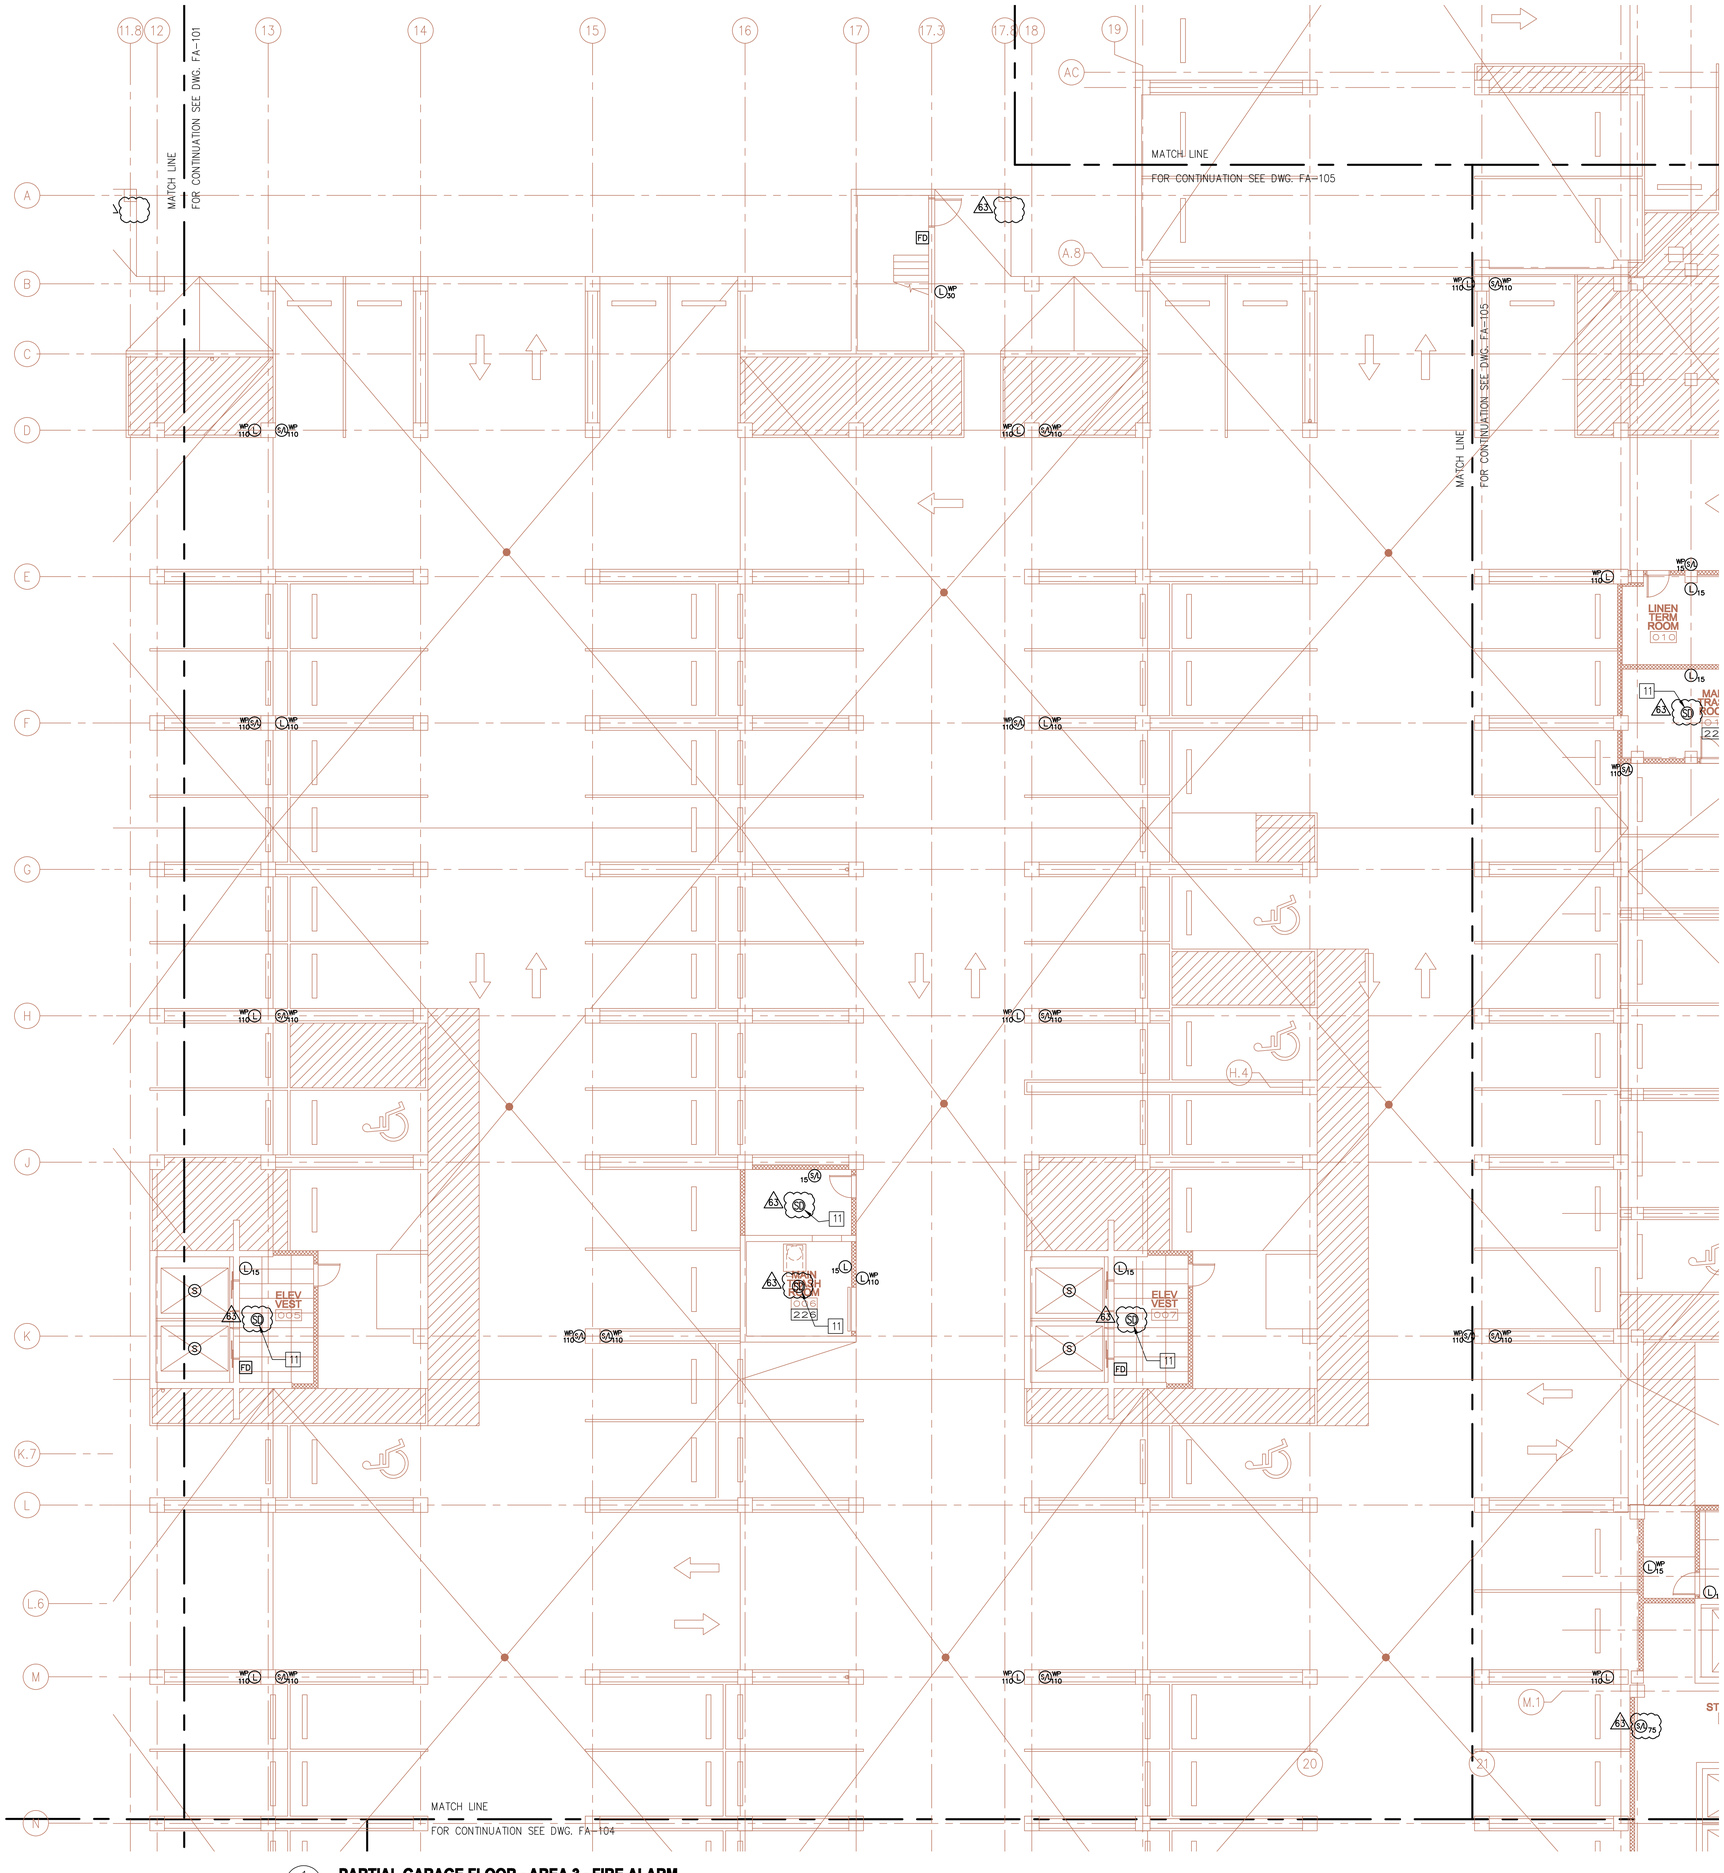

1 FA103/FA103 1/8"=1'-0"

PARTIAL GARAGE FLOOR - AREA 3 - FIRE ALARM

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

CODED NOTES:

10 PROVIDE SPEAKERS IN ELEVATOR CABS FOR LIVE FIRE ALARM MESSAGES

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CERTIFICATIONS

JOSHUA HATHORN 2009.04.17 — REGISTERED PROFESSIONAL ENGINEER — 16355 — STATE OF MISSISSIPPI

KEY PLAN

AREA 3
GARAGE FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

DRAWING SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT GARAGE PLAN – AREA 3 – FIRE ALARM
FILE NAME	FA-103-N0095730.DWG
FLOOR NO.	GARAGE FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 03 DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

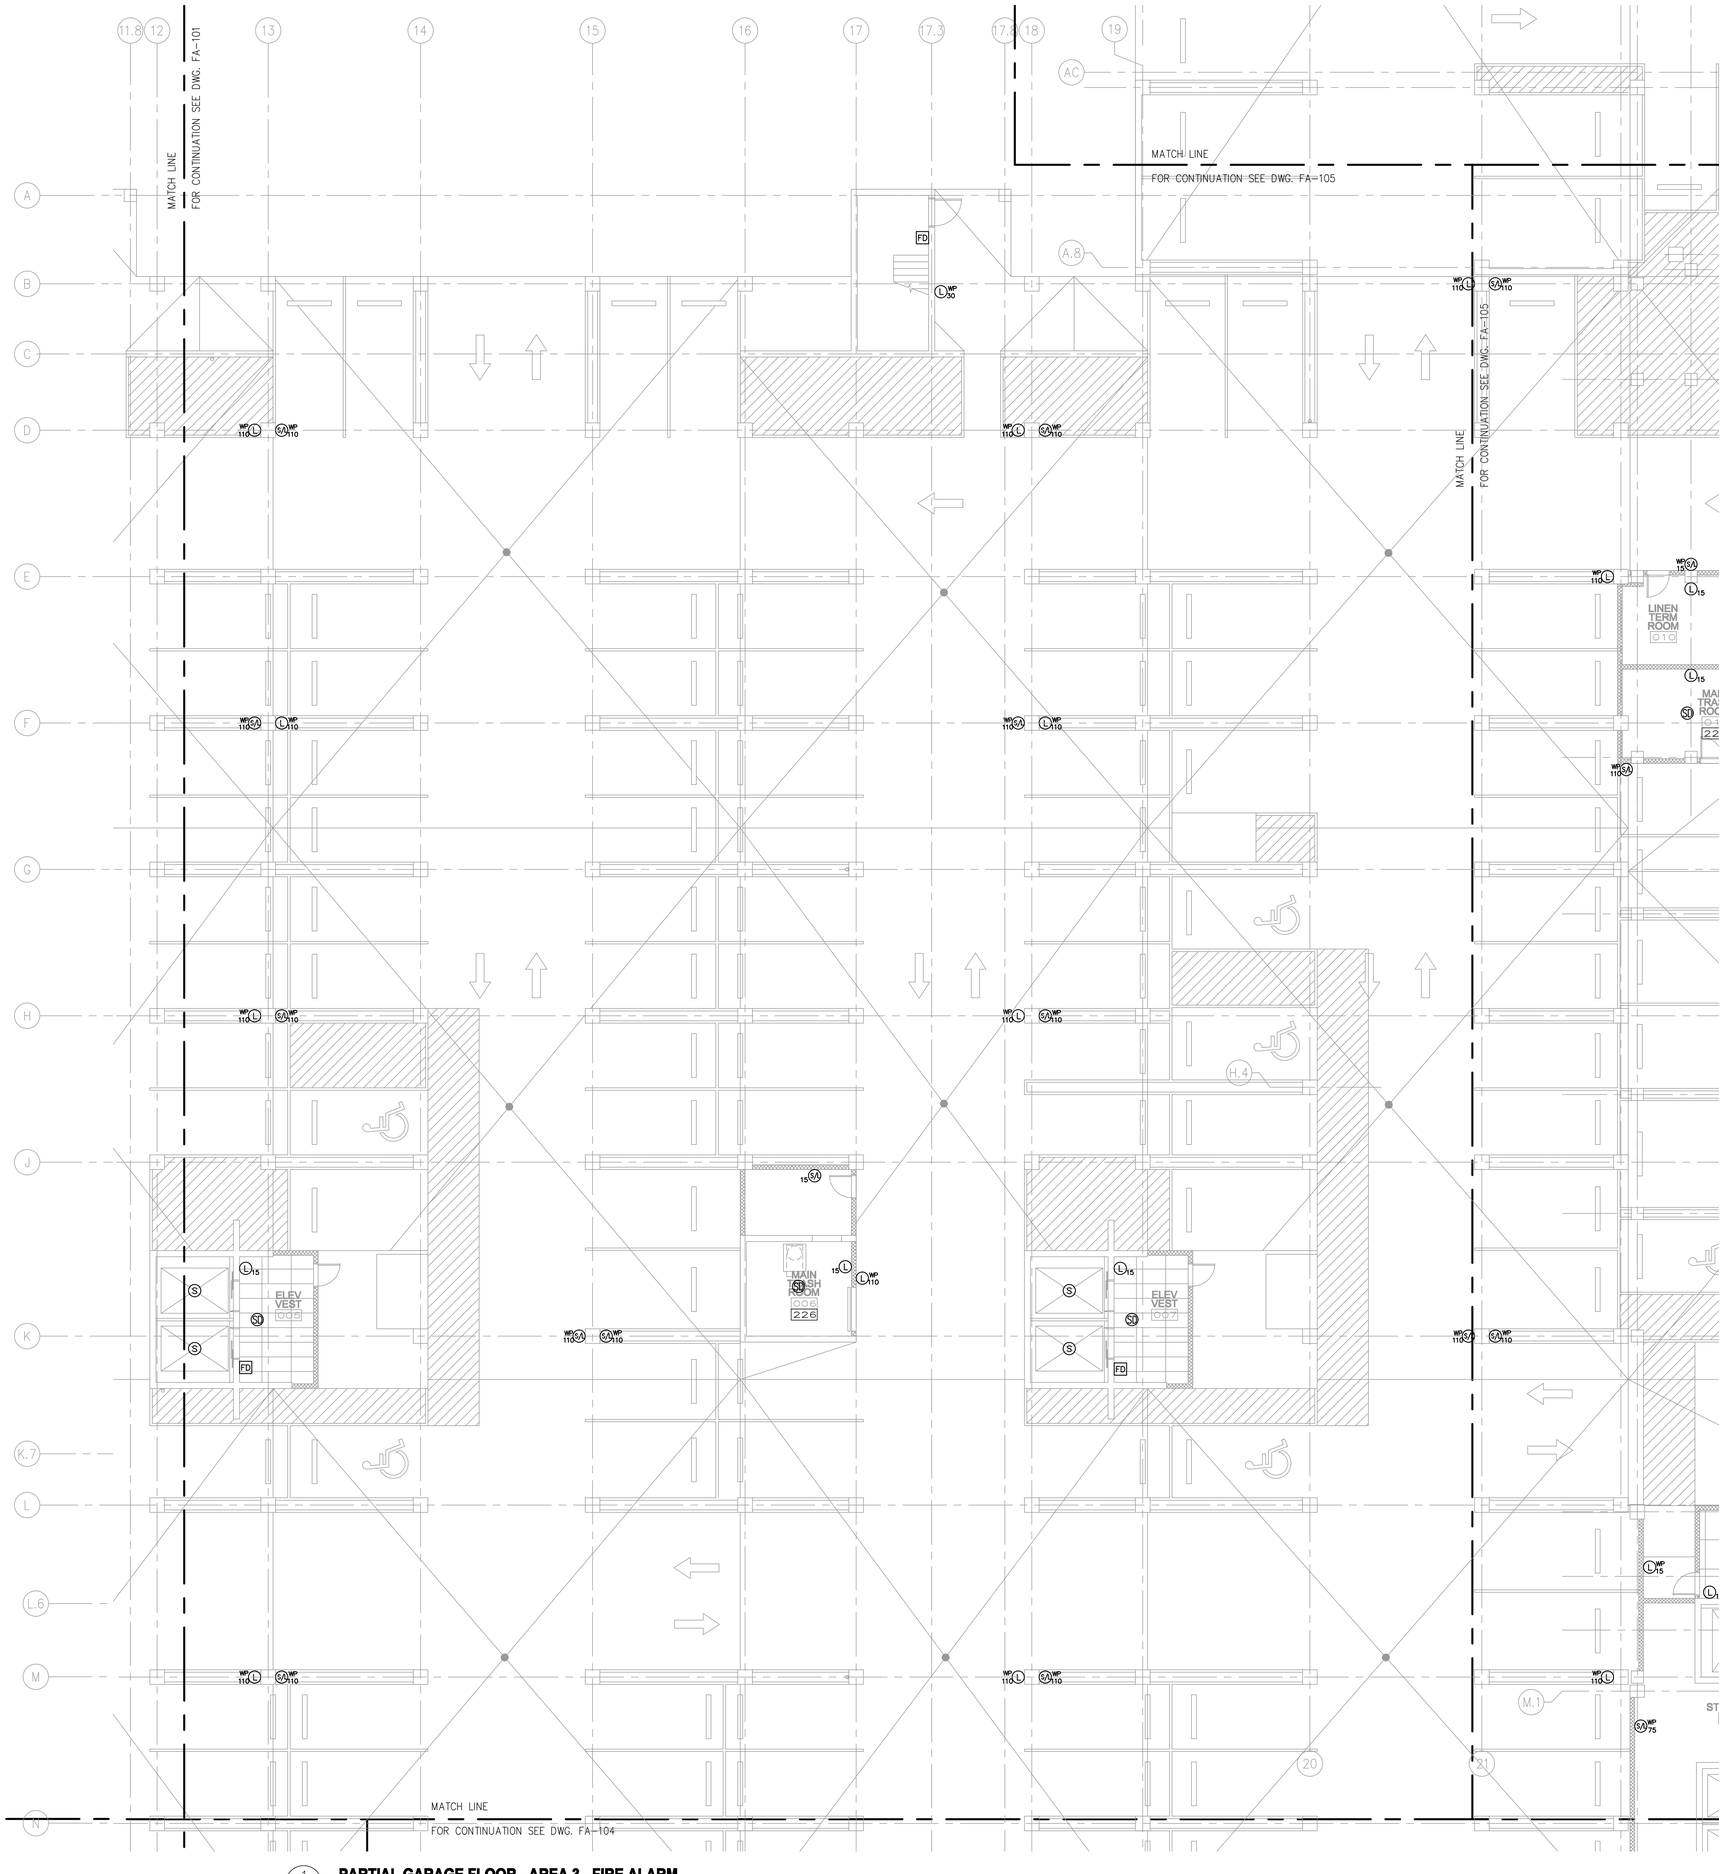

1 FA103/FA103 1/8"=1'-0"

PARTIAL GARAGE FLOOR - AREA 3 - FIRE ALARM

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

10 PROVIDE SPEAKERS IN ELEVATOR CABS FOR LIVE FIRE ALARM MESSAGES

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

KEY PLAN

AREA 3
GARAGE FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT GARAGE PLAN – AREA 3 – FIRE ALARM
FILE NAME	FA-103-N0095730.DWG
FLOOR NO.	GARAGE FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 03 DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

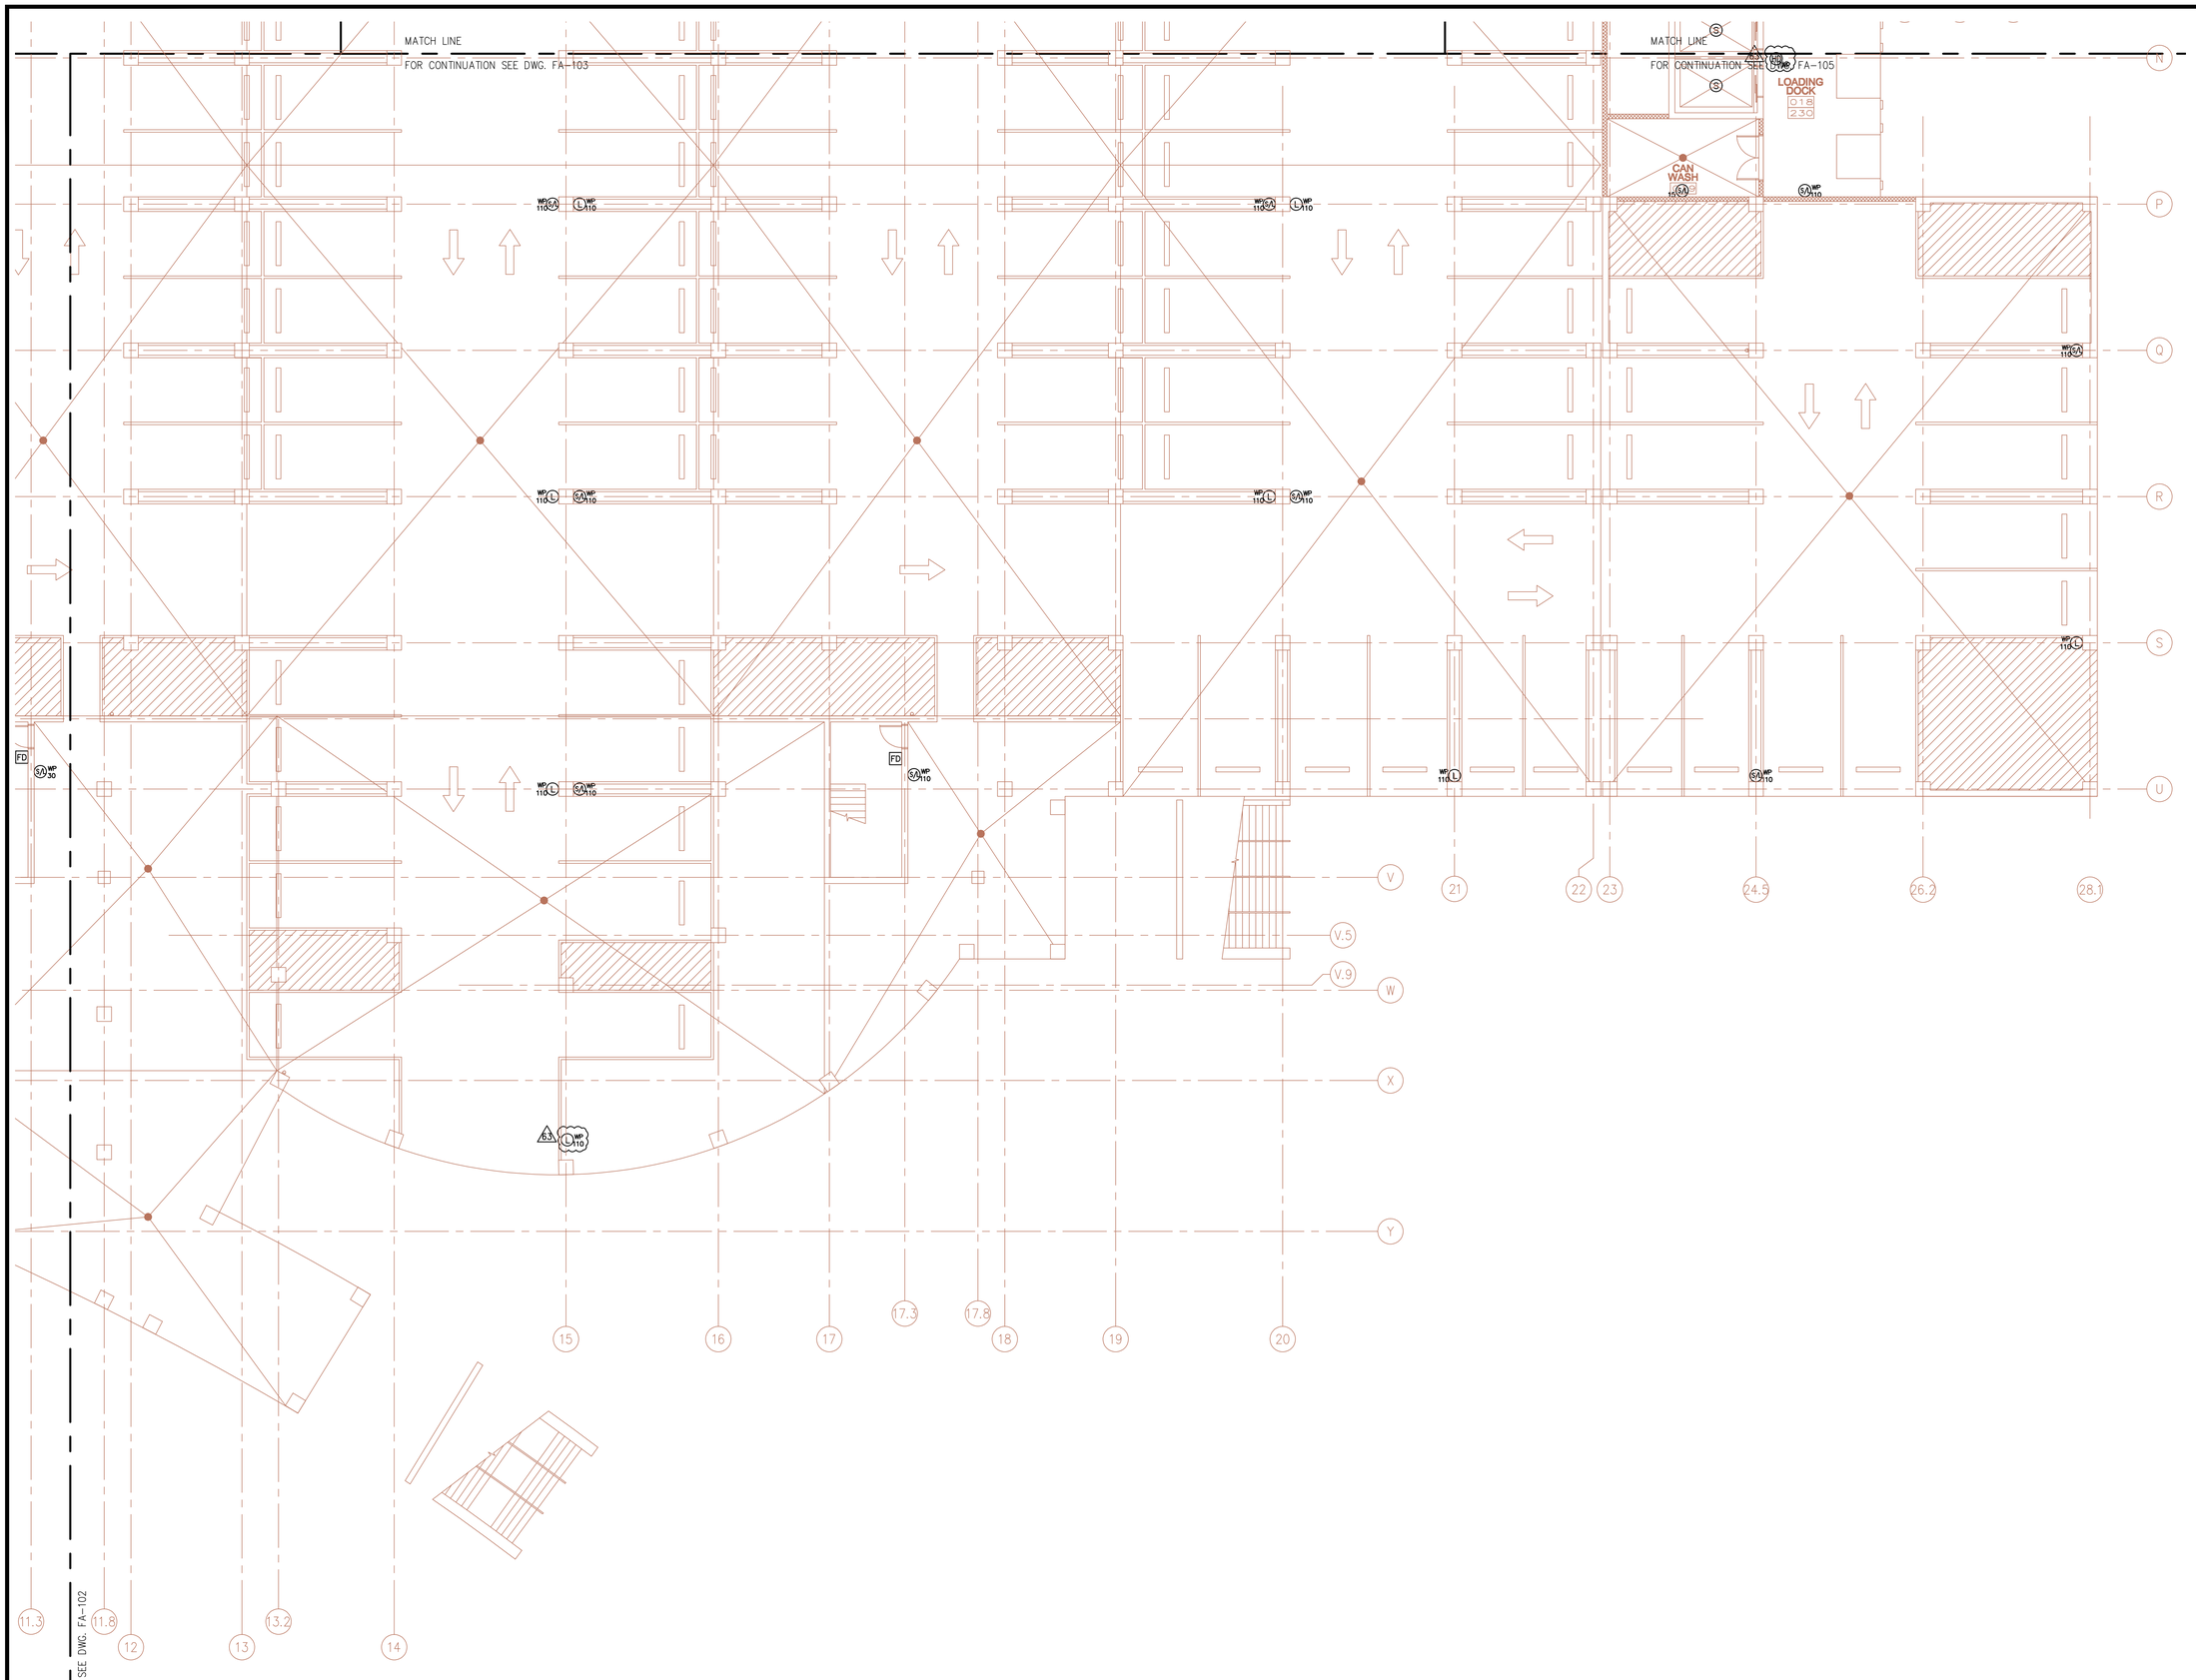

1 FA104/FA104 **PARTIAL GARAGE FLOOR - AREA 4 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

10 PROVIDE SPEAKERS IN ELEVATOR CABS FOR LIVE FIRE ALARM MESSAGES

CERTIFICATIONS

SHANE HATANAKA
REGISTERED PROFESSIONAL
ENGINEER
16355
STATE OF MISSISSIPPI
2009.04.17

KEY PLAN

N

AREA 4
GARAGE FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
2	09/08/08	ISSUED FOR CONSTRUCTION
3	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT GARAGE PLAN – AREA 4 – FIRE ALARM
FILE NAME	FA-104-N0095730.DWG
FLOOR NO.	GARAGE FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 04
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

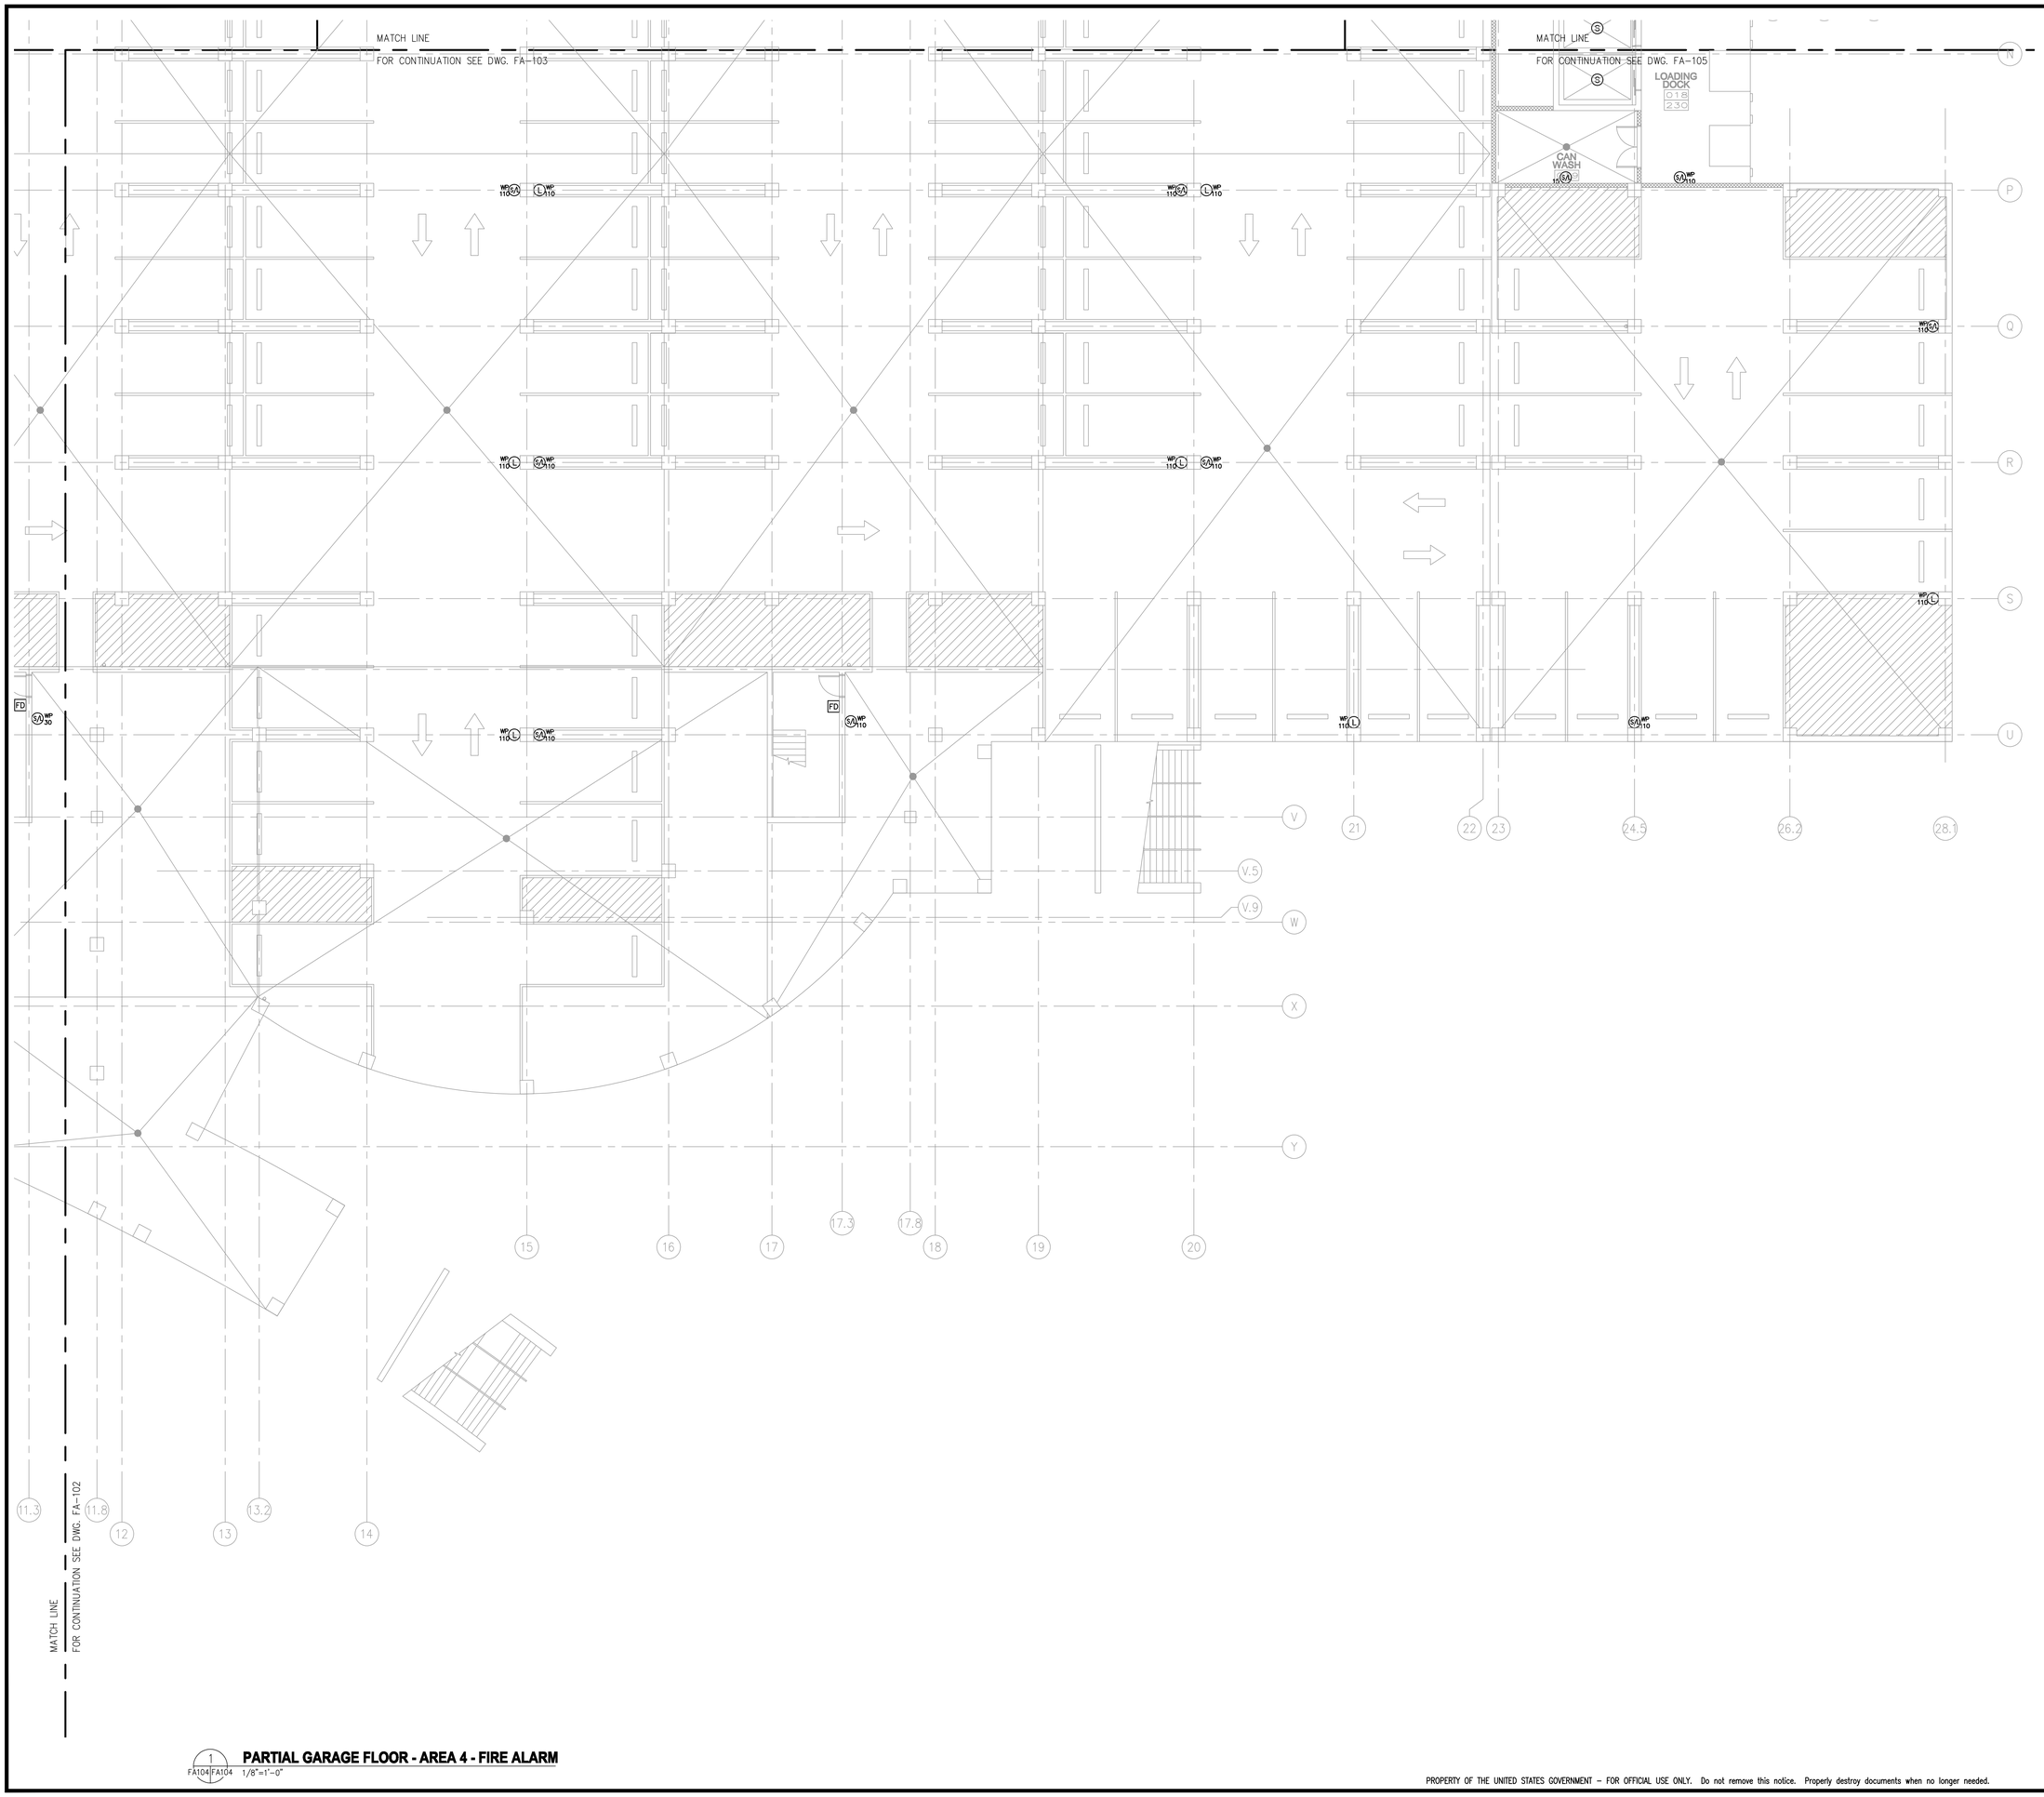

1 FA104/FA104 **PARTIAL GARAGE FLOOR - AREA 4 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

10 PROVIDE SPEAKERS IN ELEVATOR CABS FOR LIVE FIRE ALARM MESSAGES

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

KEY PLAN



AREA 4
GARAGE FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT GARAGE PLAN – AREA 4 – FIRE ALARM
FILE NAME	FA-104-N0095730.DWG
FLOOR NO.	GARAGE FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 04 DISCIPLINE SHEET TYPE SEQUENCE SHEET OF –

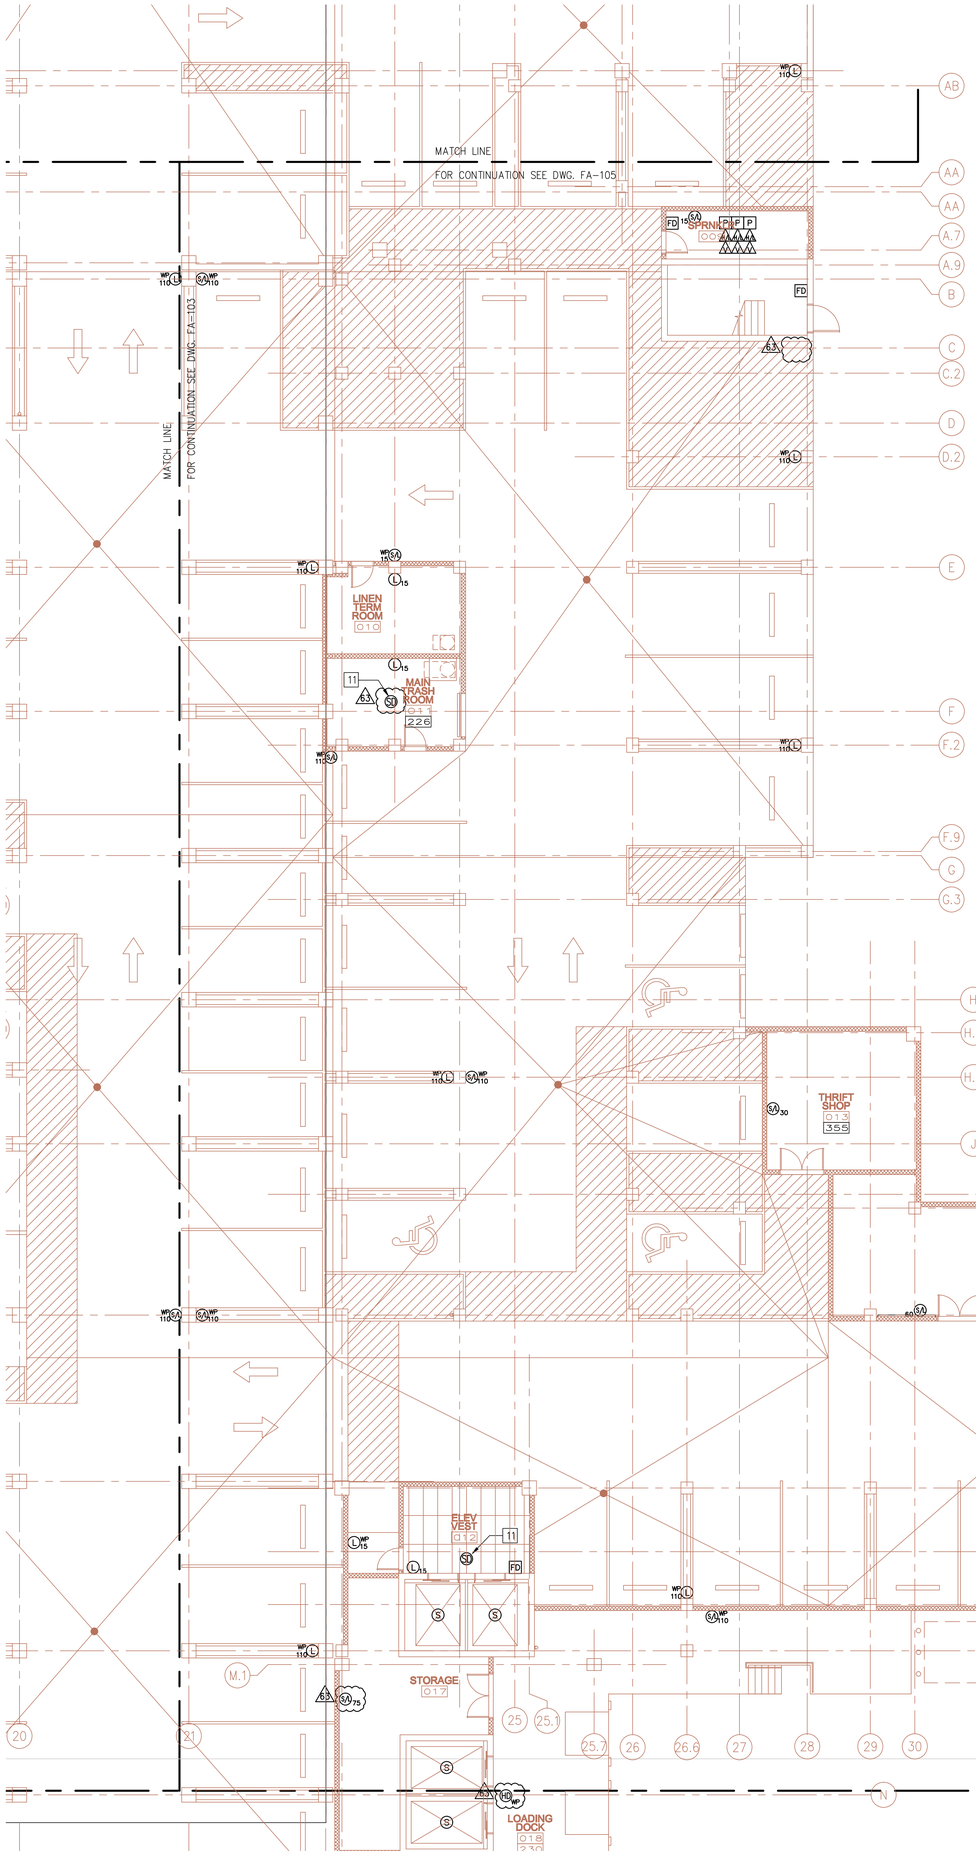

1 FA105/FA105 **PARTIAL GARAGE FLOOR - AREA 5 - FIRE ALARM**
1/8"=1'-0"

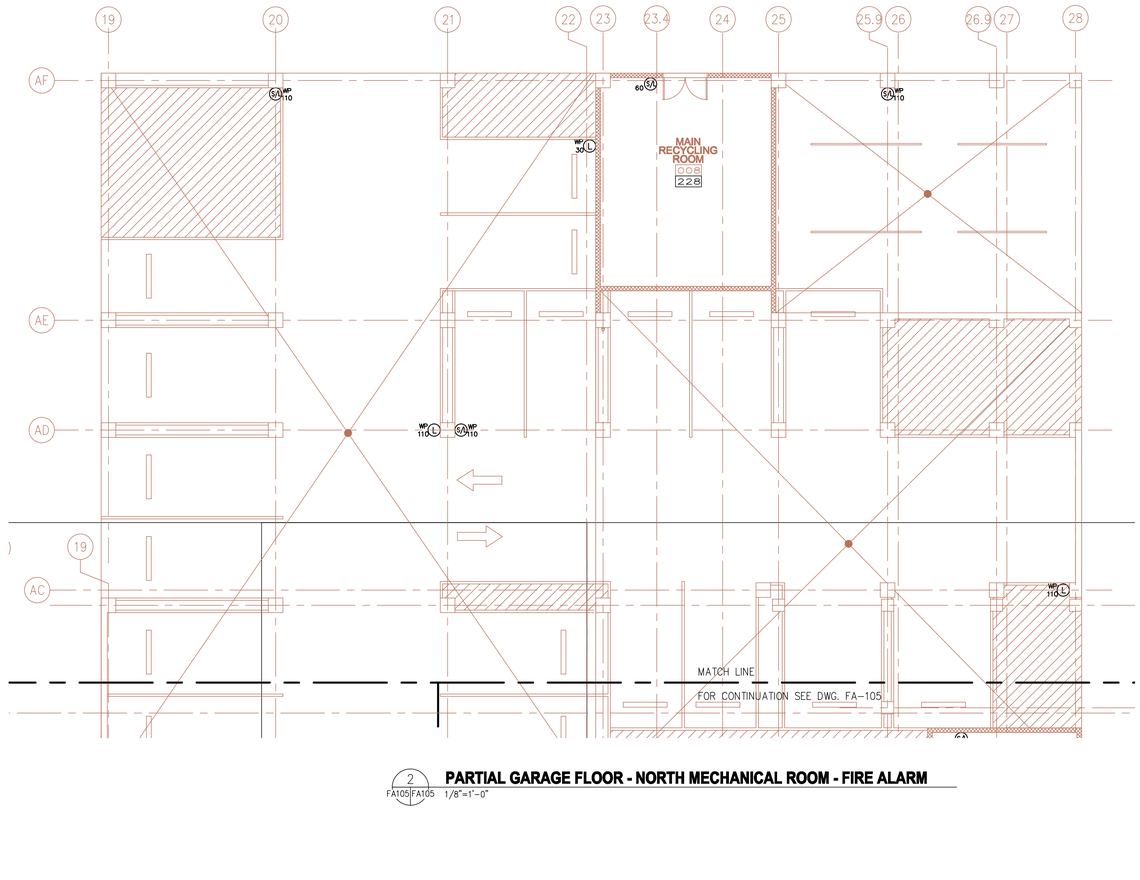

2 FA105/FA105 **PARTIAL GARAGE FLOOR - NORTH MECHANICAL ROOM - FIRE ALARM**
1/8"=1'-0"

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans
JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

10 PROVIDE SPEAKERS IN ELEVATOR CABS FOR LIVE FIRE ALARM MESSAGES

CERTIFICATIONS

DWANE HATTMAN
REGISTERED PROFESSIONAL
ENGINEER
18355
STATE OF MISSISSIPPI
2009.04.17

KEY PLAN

N

AREA 5
GARAGE FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT GARAGE PLAN - AREA 5 - FIRE ALARM
FILE NAME	FA-105-N0095730.DWG
FLOOR NO.	GARAGE FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 05
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF -

PROPERTY OF THE UNITED STATES GOVERNMENT - FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

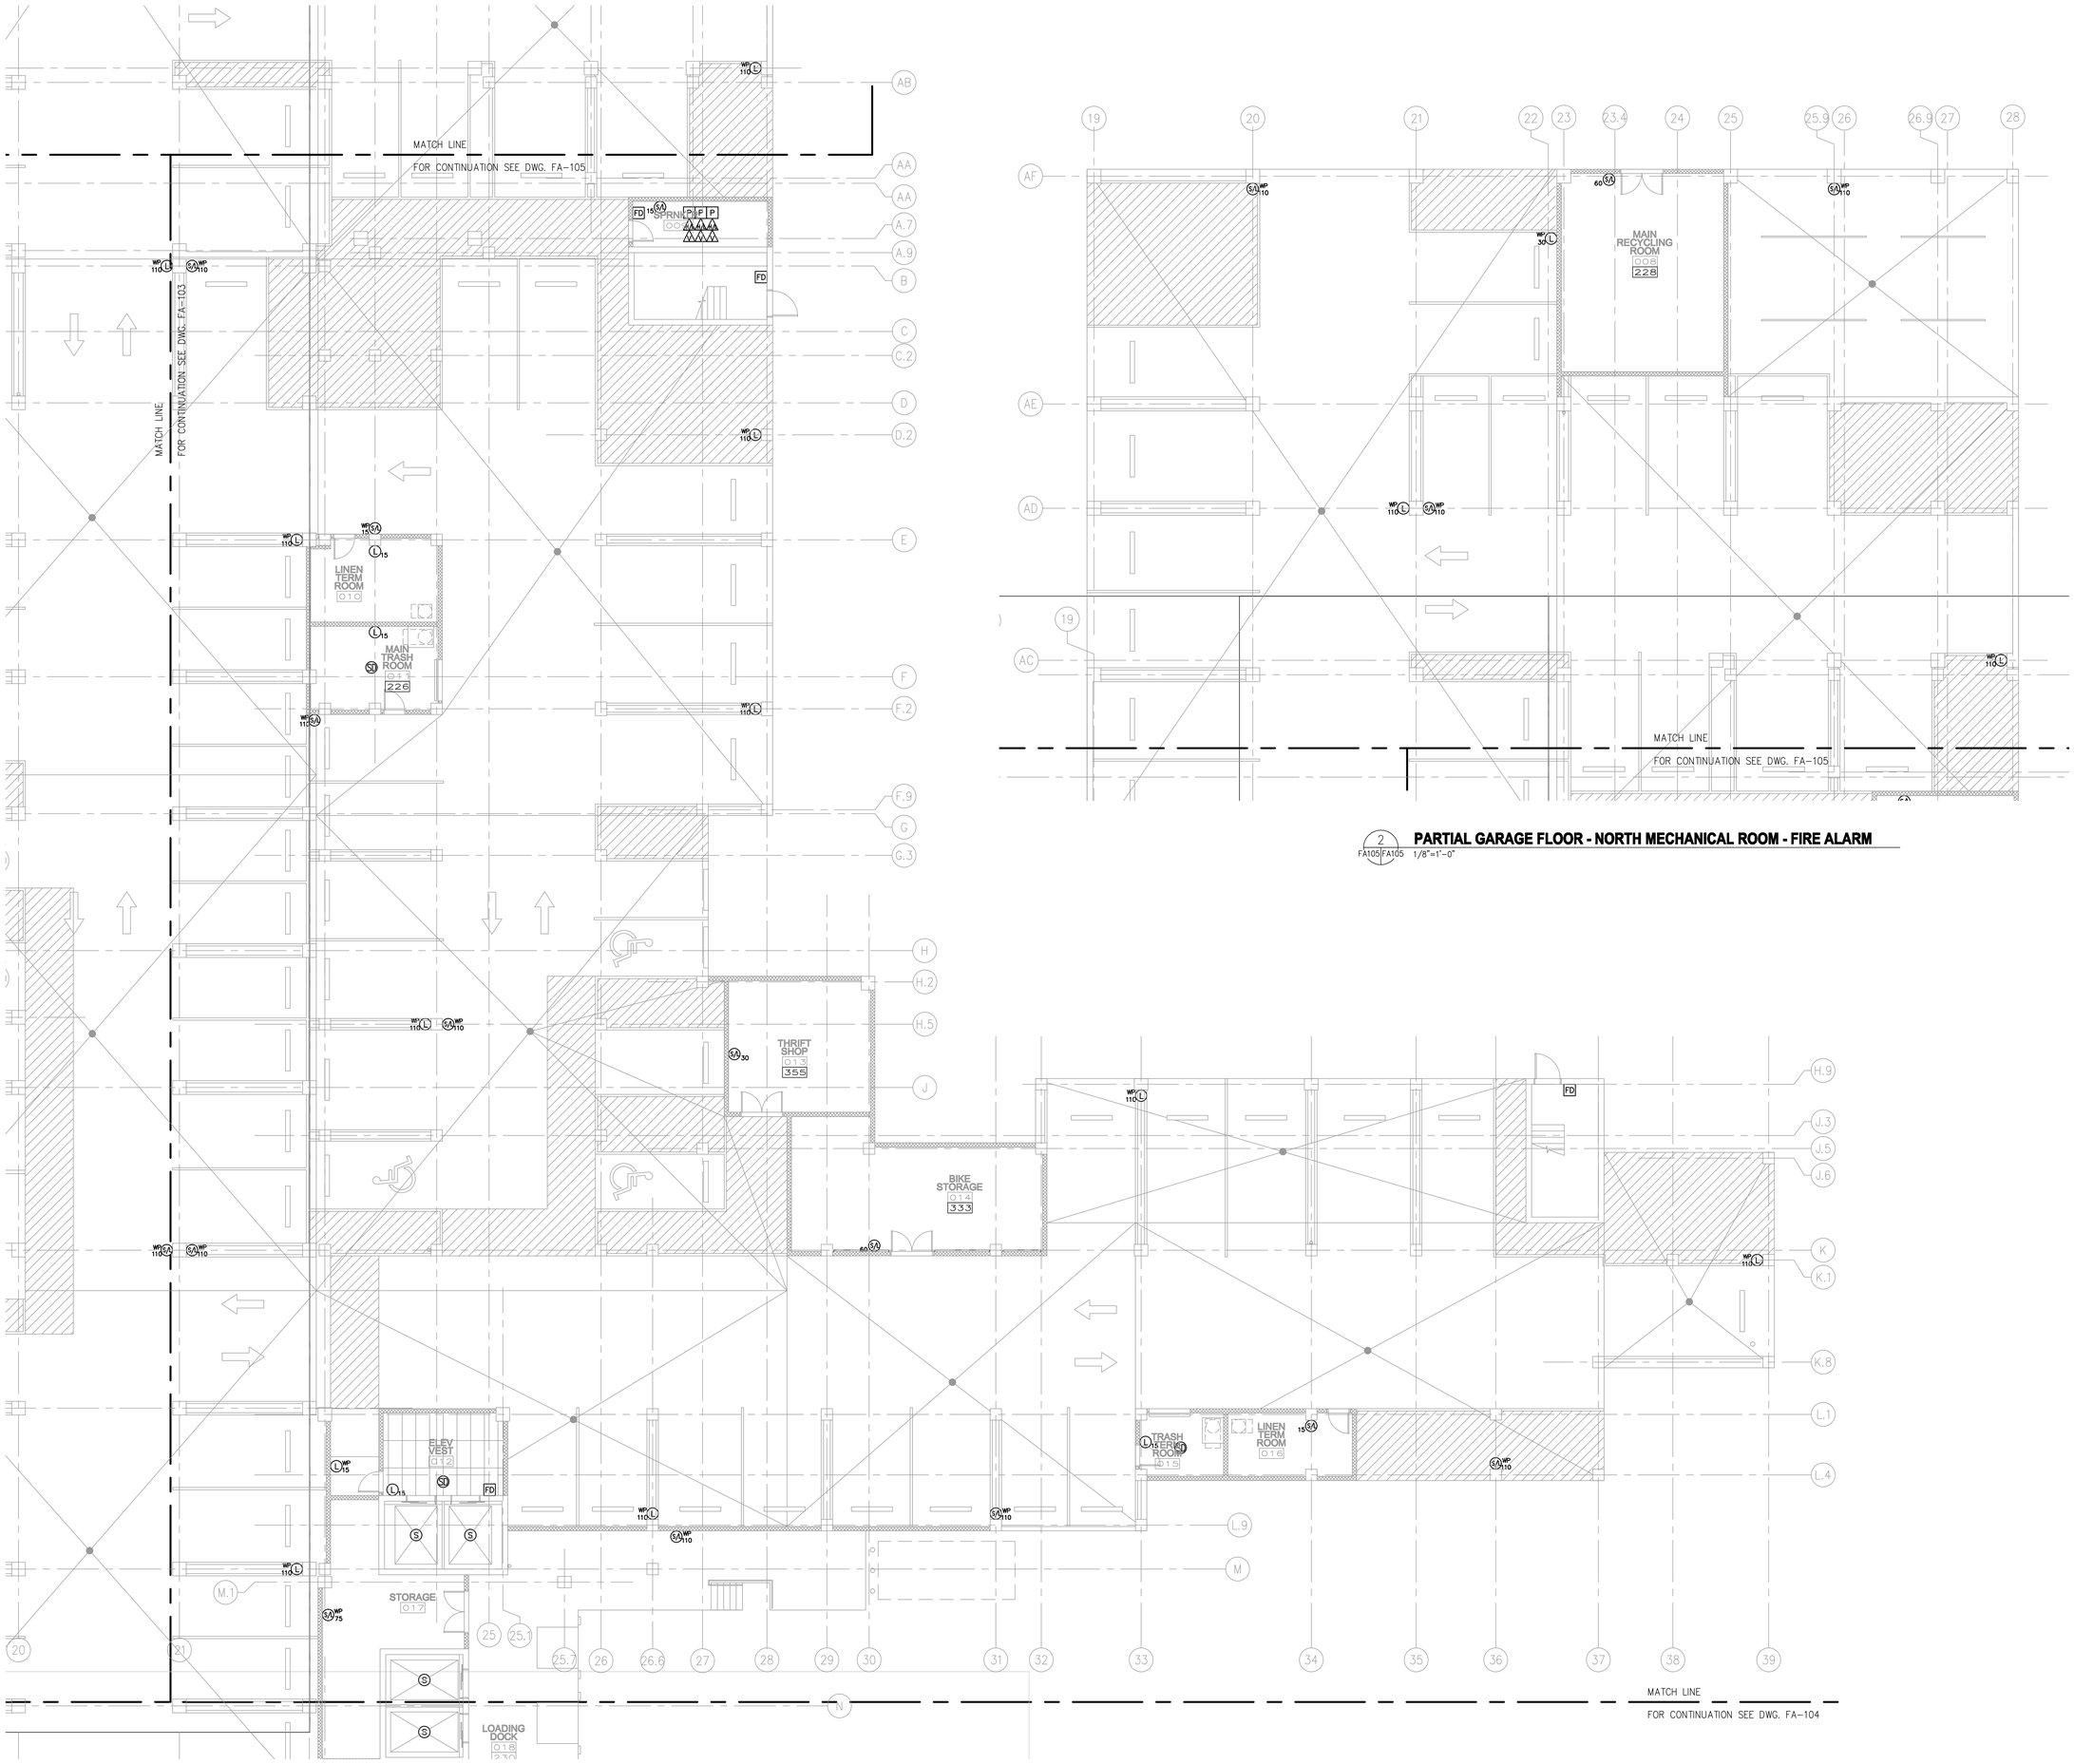

1 FA105 FA105 **PARTIAL GARAGE FLOOR - AREA 5 - FIRE ALARM**
1/8"=1'-0"

2 FA105 FA105 **PARTIAL GARAGE FLOOR - NORTH MECHANICAL ROOM - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans
JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

10 PROVIDE SPEAKERS IN ELEVATOR CABS FOR LIVE FIRE ALARM MESSAGES

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

KEY PLAN

AREA 5
GARAGE FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT GARAGE PLAN – AREA 5 – FIRE ALARM
FILE NAME	FA-105-N0095730.DWG
FLOOR NO.	GARAGE FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 05

DISCIPLINE SHEET TYPE SEQUENCE
SHEET OF –

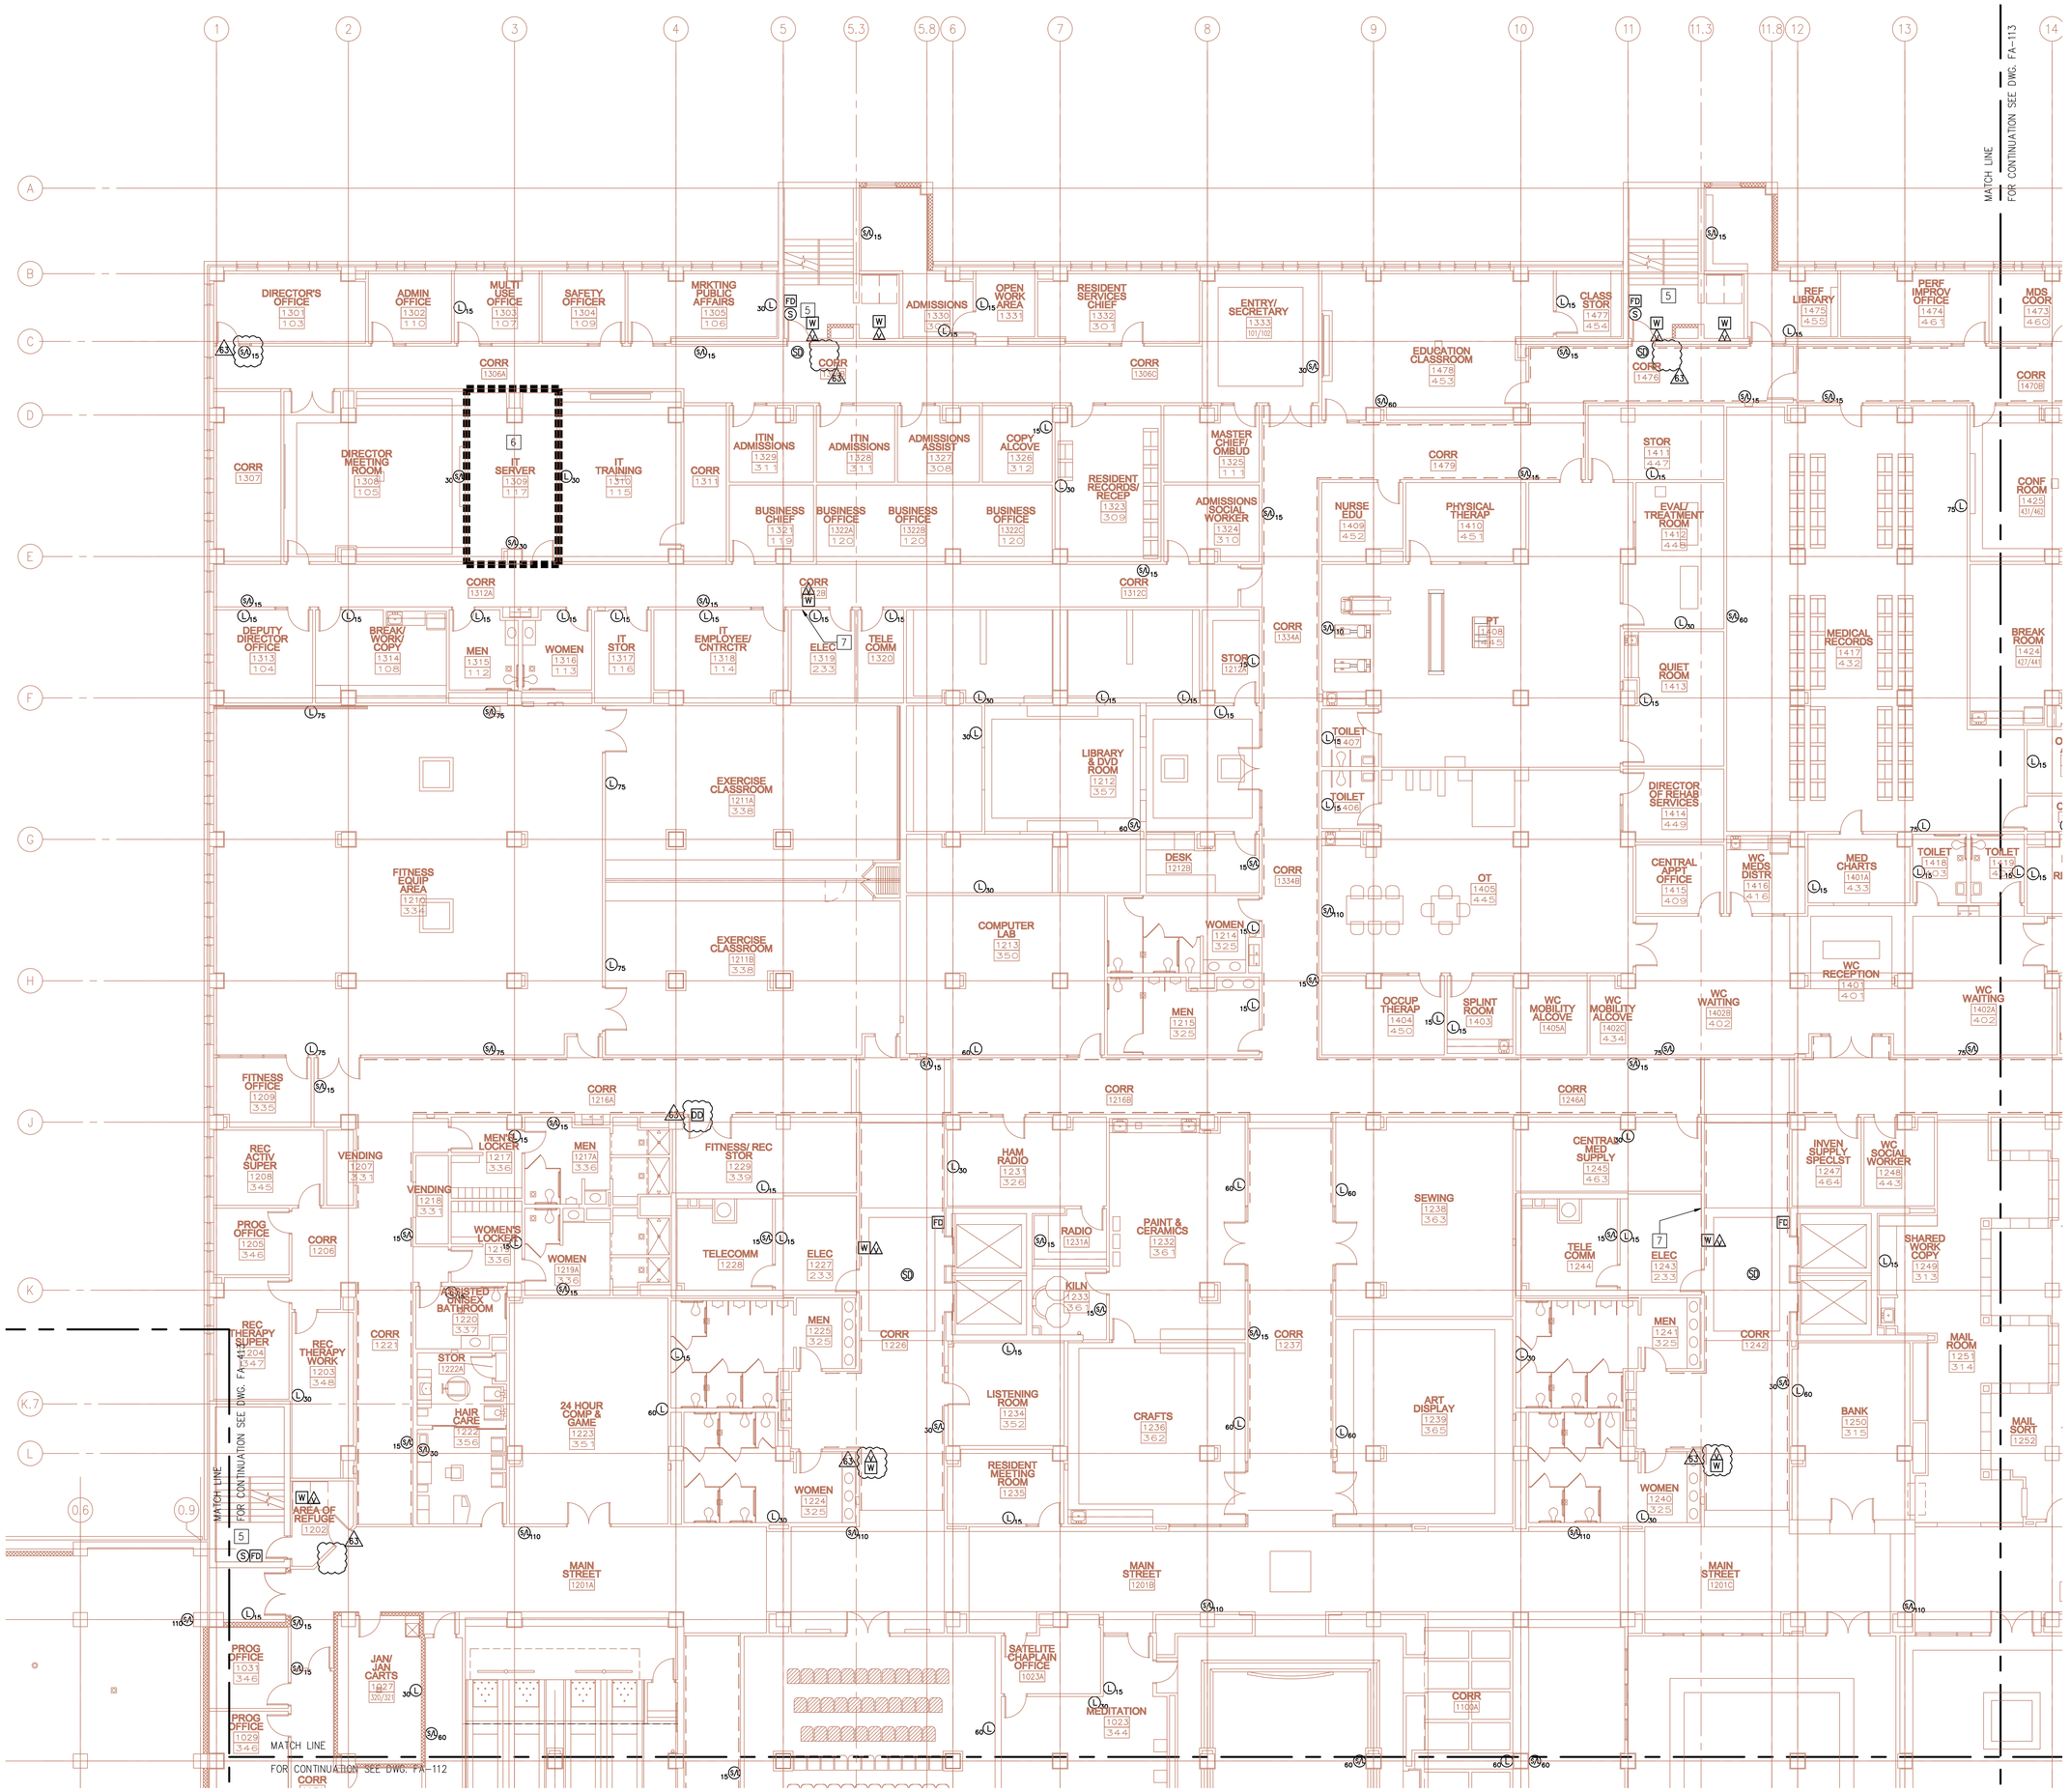

1 FA111|FA111 **PARTIAL FIRST FLOOR - AREA 1 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans
JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

6 PROVIDE AUTOMATIC FIRE DETECTION, CONTROL PANELS, ETC. FOR FM200 FIRE SUPPRESSION SYSTEM IN IT SERVER ROOM 1309.

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

CERTIFICATIONS

WAYNE HATHAWAY REGISTERED PROFESSIONAL ENGINEER STATE OF MISSISSIPPI 16355
2009.04.17

KEY PLAN



AREA 1
FIRST FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 1ST FL PL - AREA 1 - FIRE ALARM
FILE NAME	FA-111-N0095730.DWG
FLOOR NO.	FIRST FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 11
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

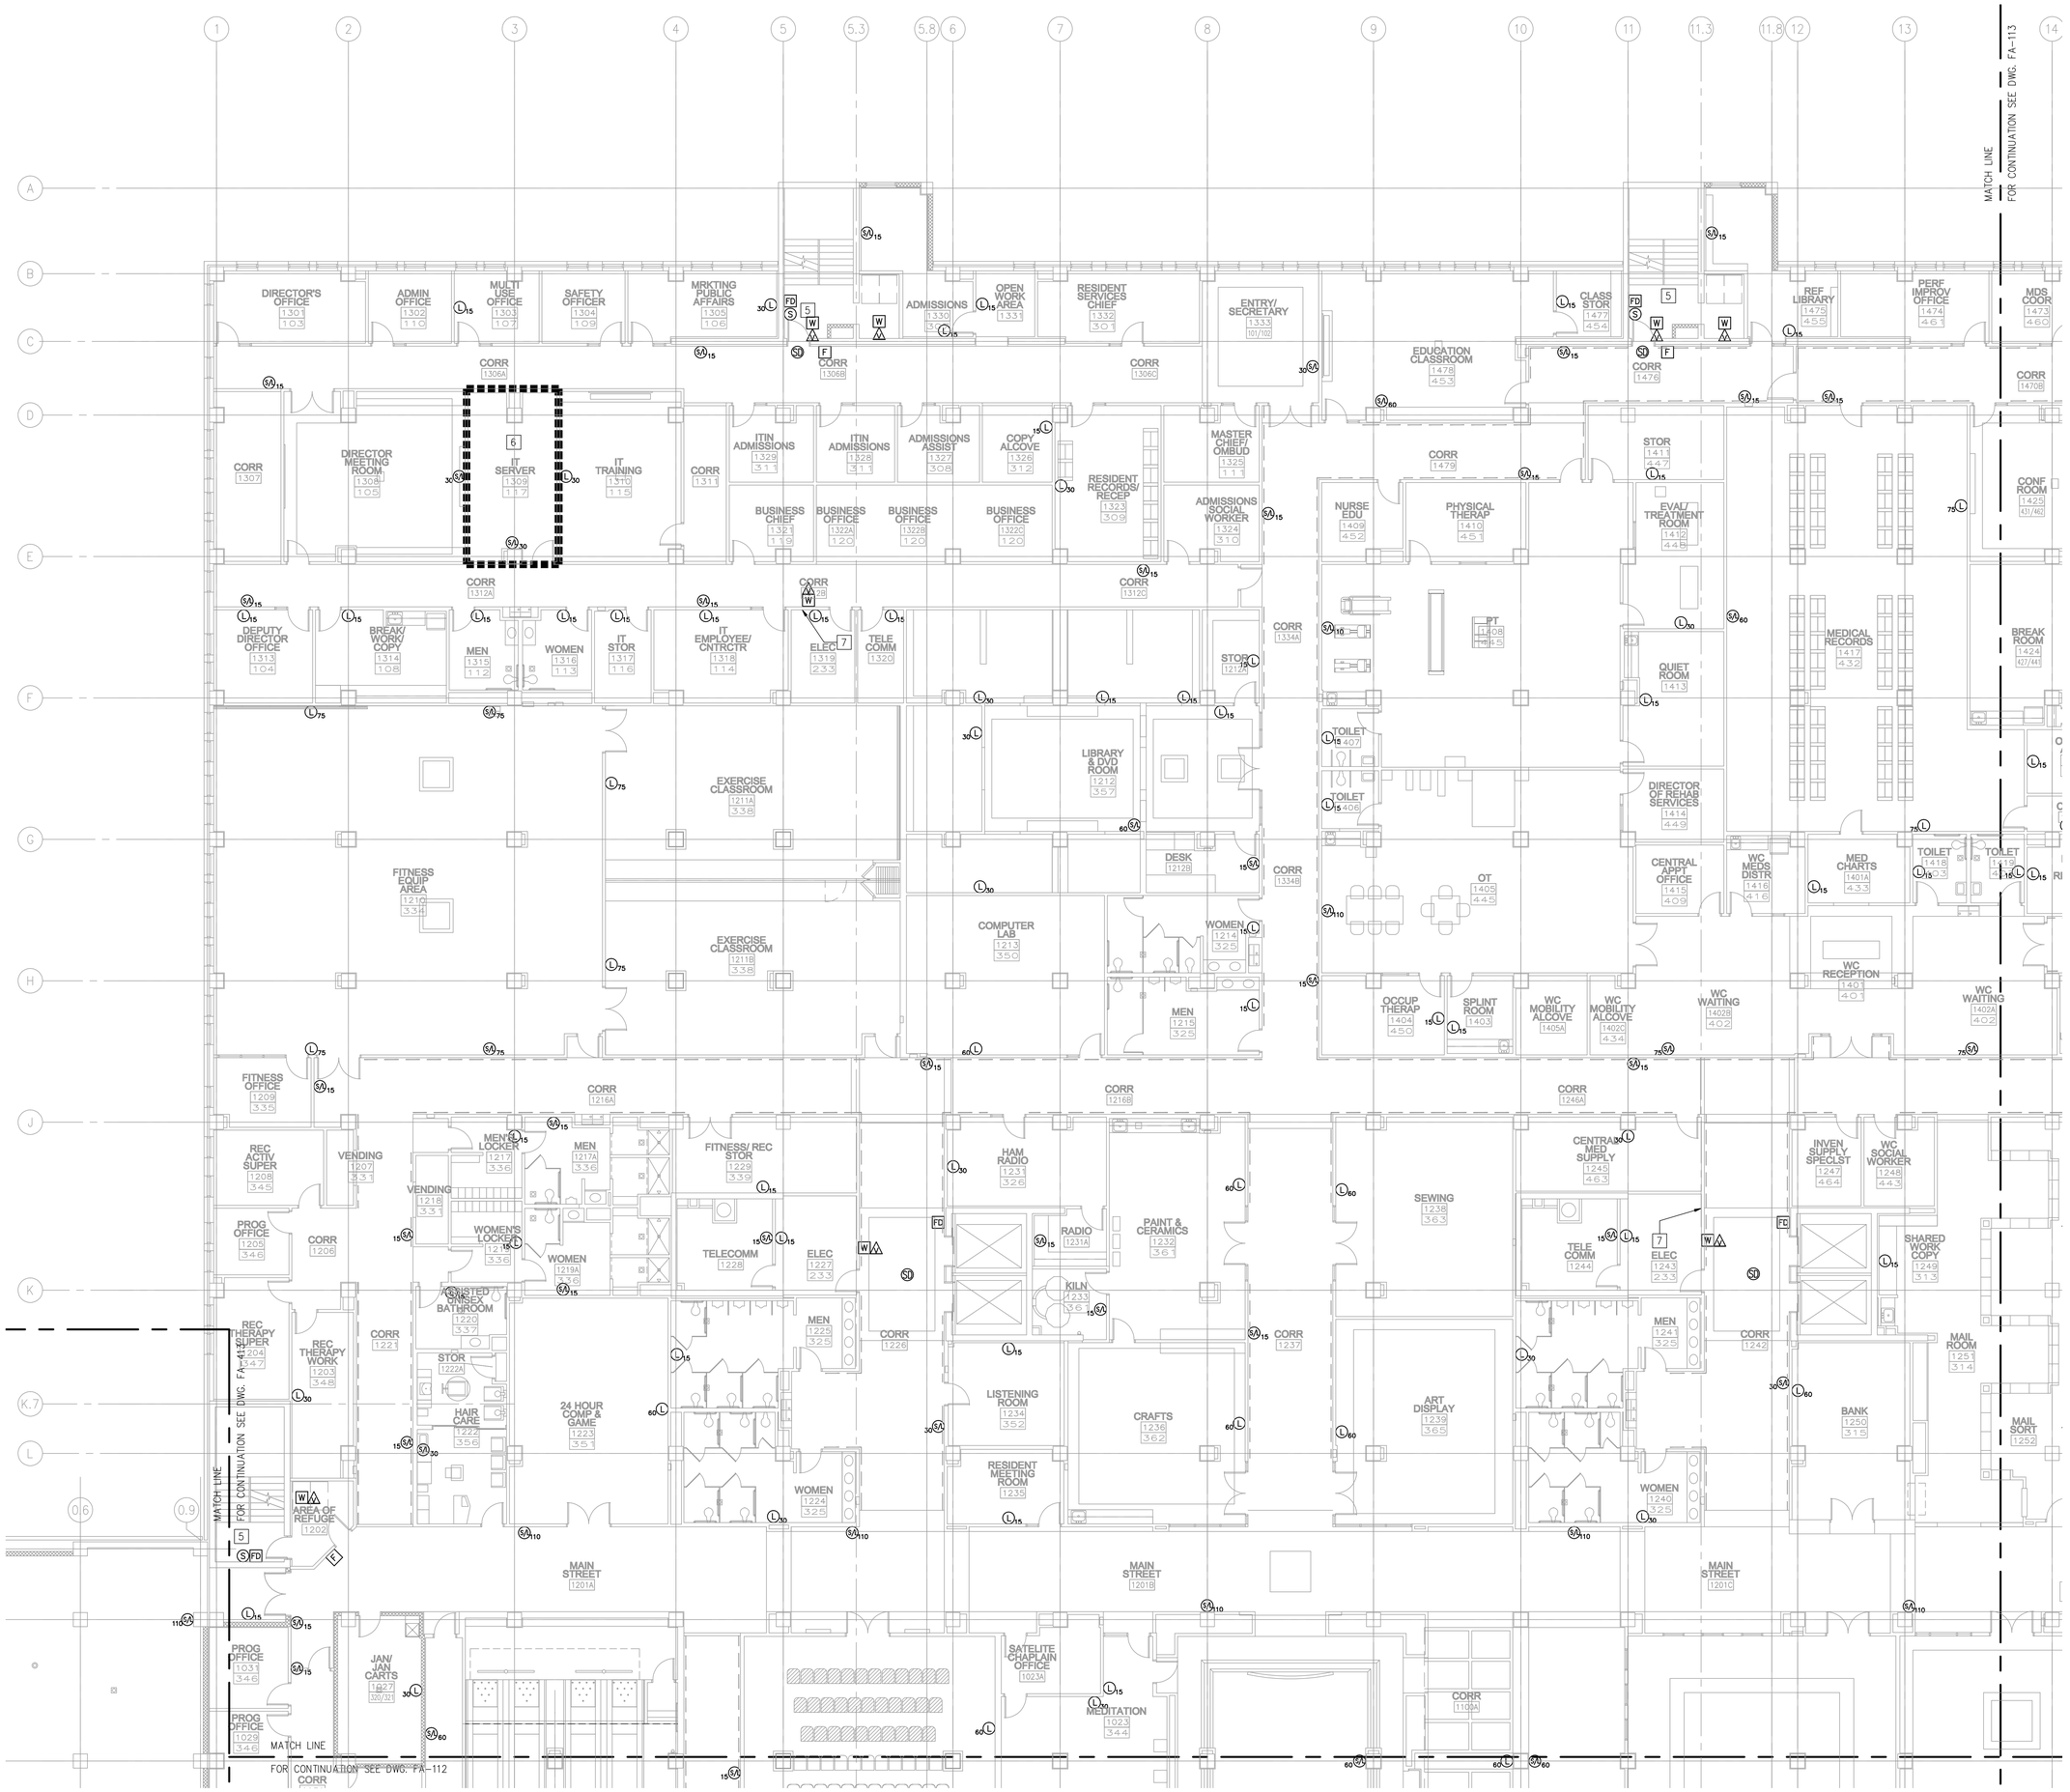

1 FA111|FA111 **PARTIAL FIRST FLOOR - AREA 1 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans
JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

6 PROVIDE AUTOMATIC FIRE DETECTION, CONTROL PANELS, ETC. FOR FM200 FIRE SUPPRESSION SYSTEM IN IT SERVER ROOM 1309.

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

KEY PLAN



REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 1ST FL PL – AREA 1 – FIRE ALARM
FILE NAME	FA-111-M0095730.DWG
FLOOR NO.	FIRST FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 11
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

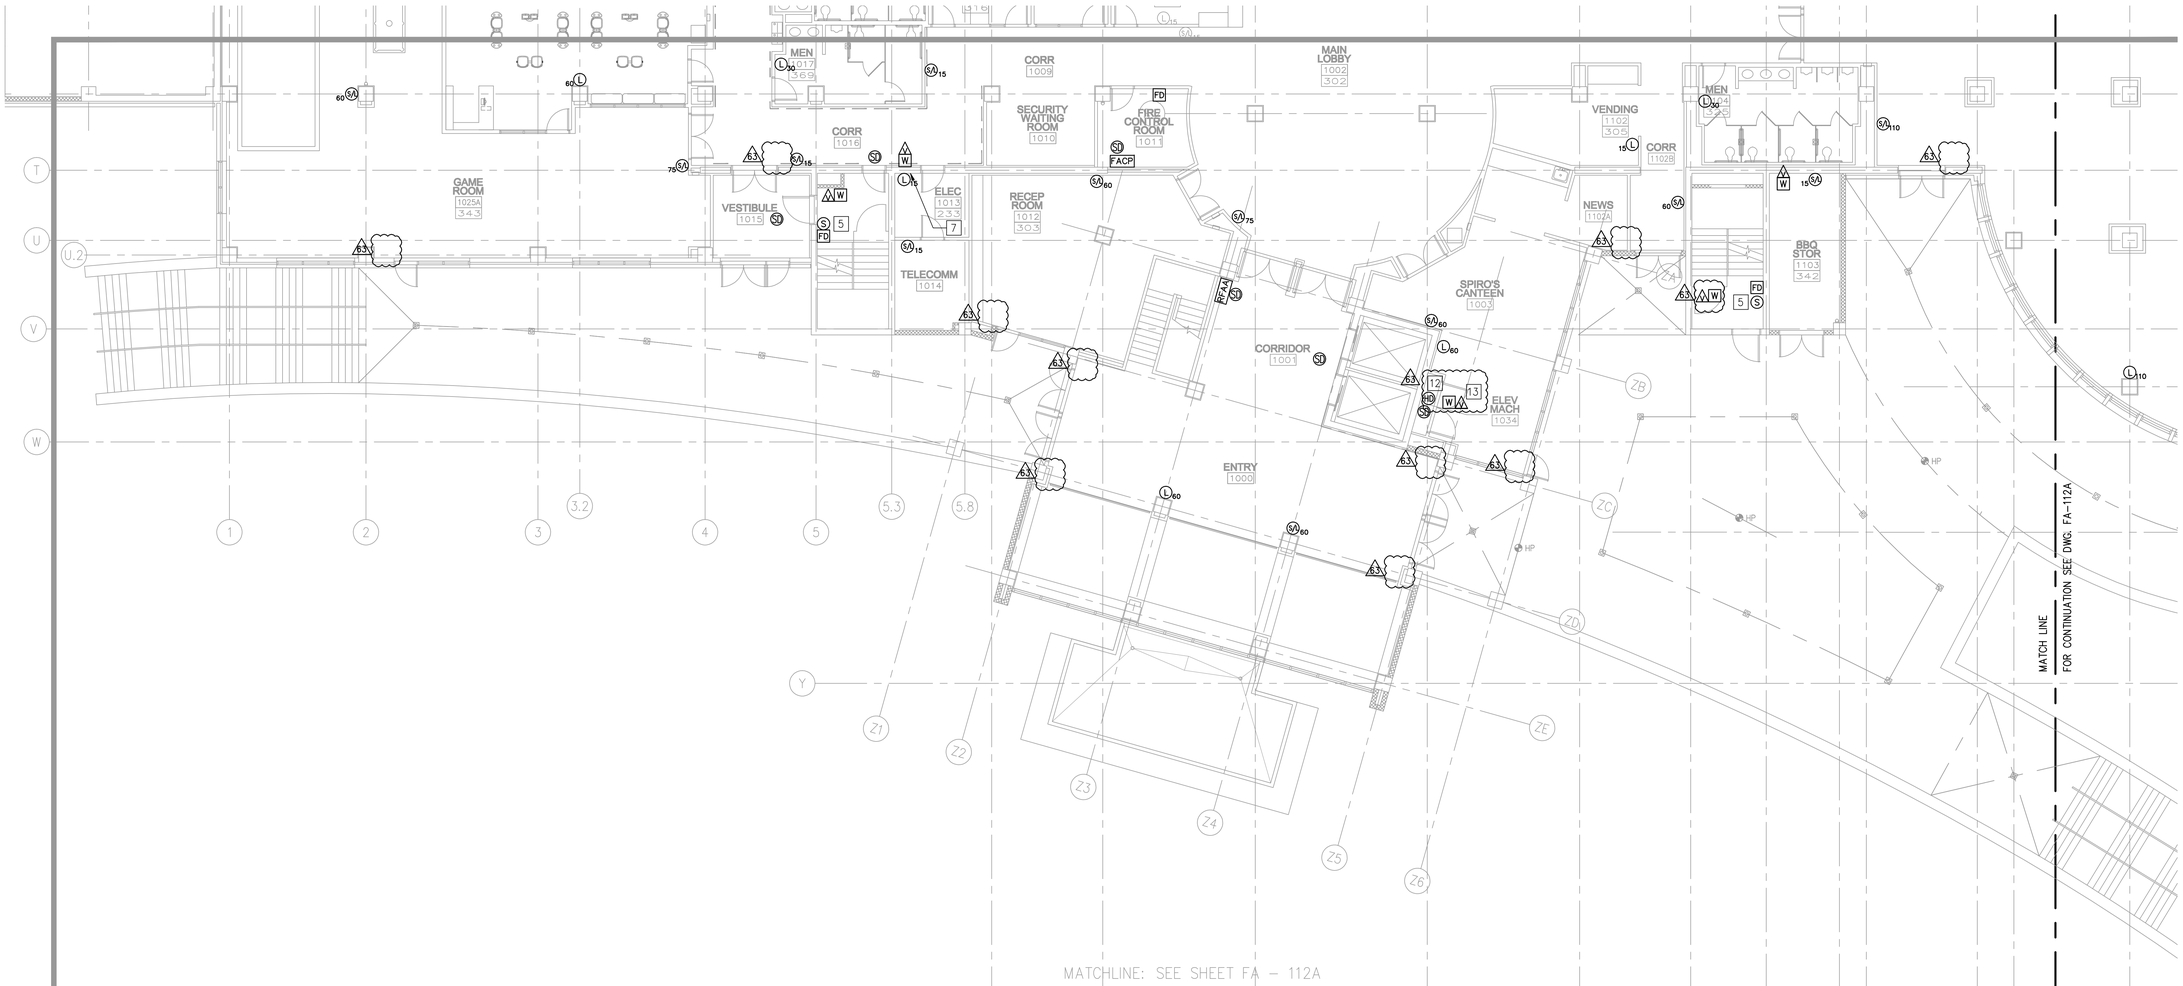

1 **PARTIAL FIRST FLOOR PLAN - AREA 2 - ENTRY**
FA102A|FA102A 1/8"=1'-0"

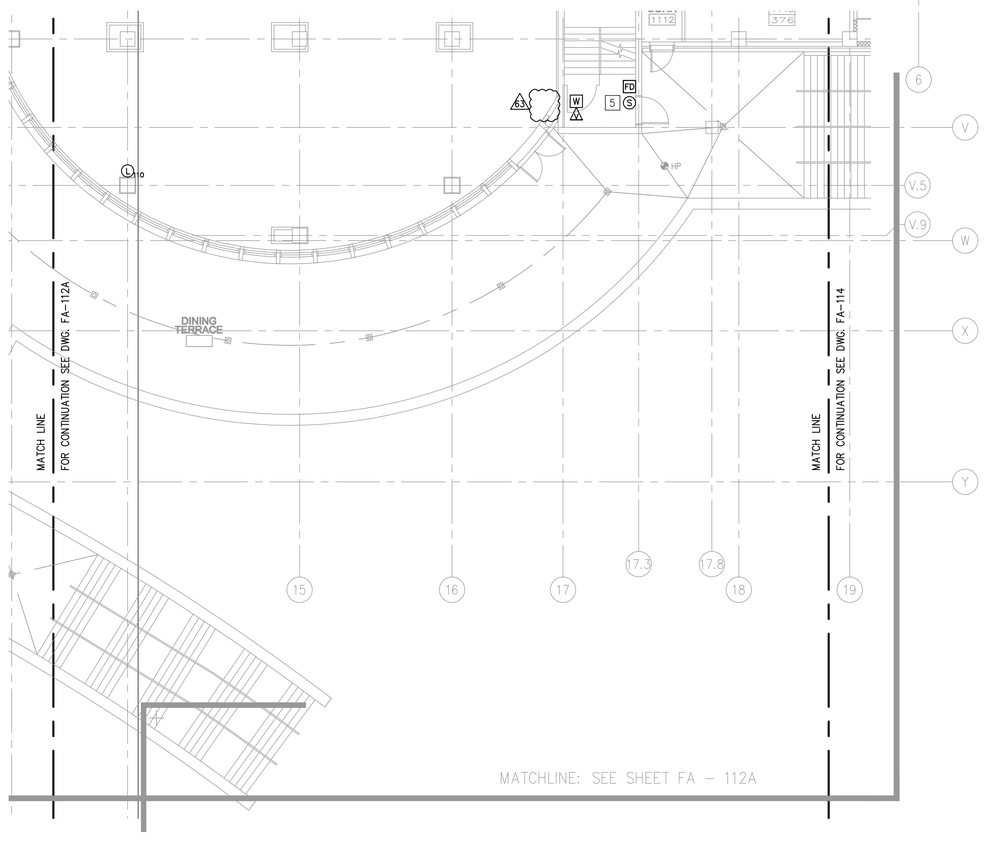

2 **PARTIAL FIRST FLOOR PLAN - AREA 2 - ENTRY**
FA102A|FA102A 1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CERTIFICATIONS

SHANE HATHMAKER
ENGINEER
18355
STATE OF MISSISSIPPI
2009.04.17

KEY PLAN



AREA 2
GARAGE FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PART. FIRST FLR PLAN –AREA 2– ENTRY
FILE NAME	FA-112A-N0095730.DWG
FLOOR NO.	FIRST FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 12A
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

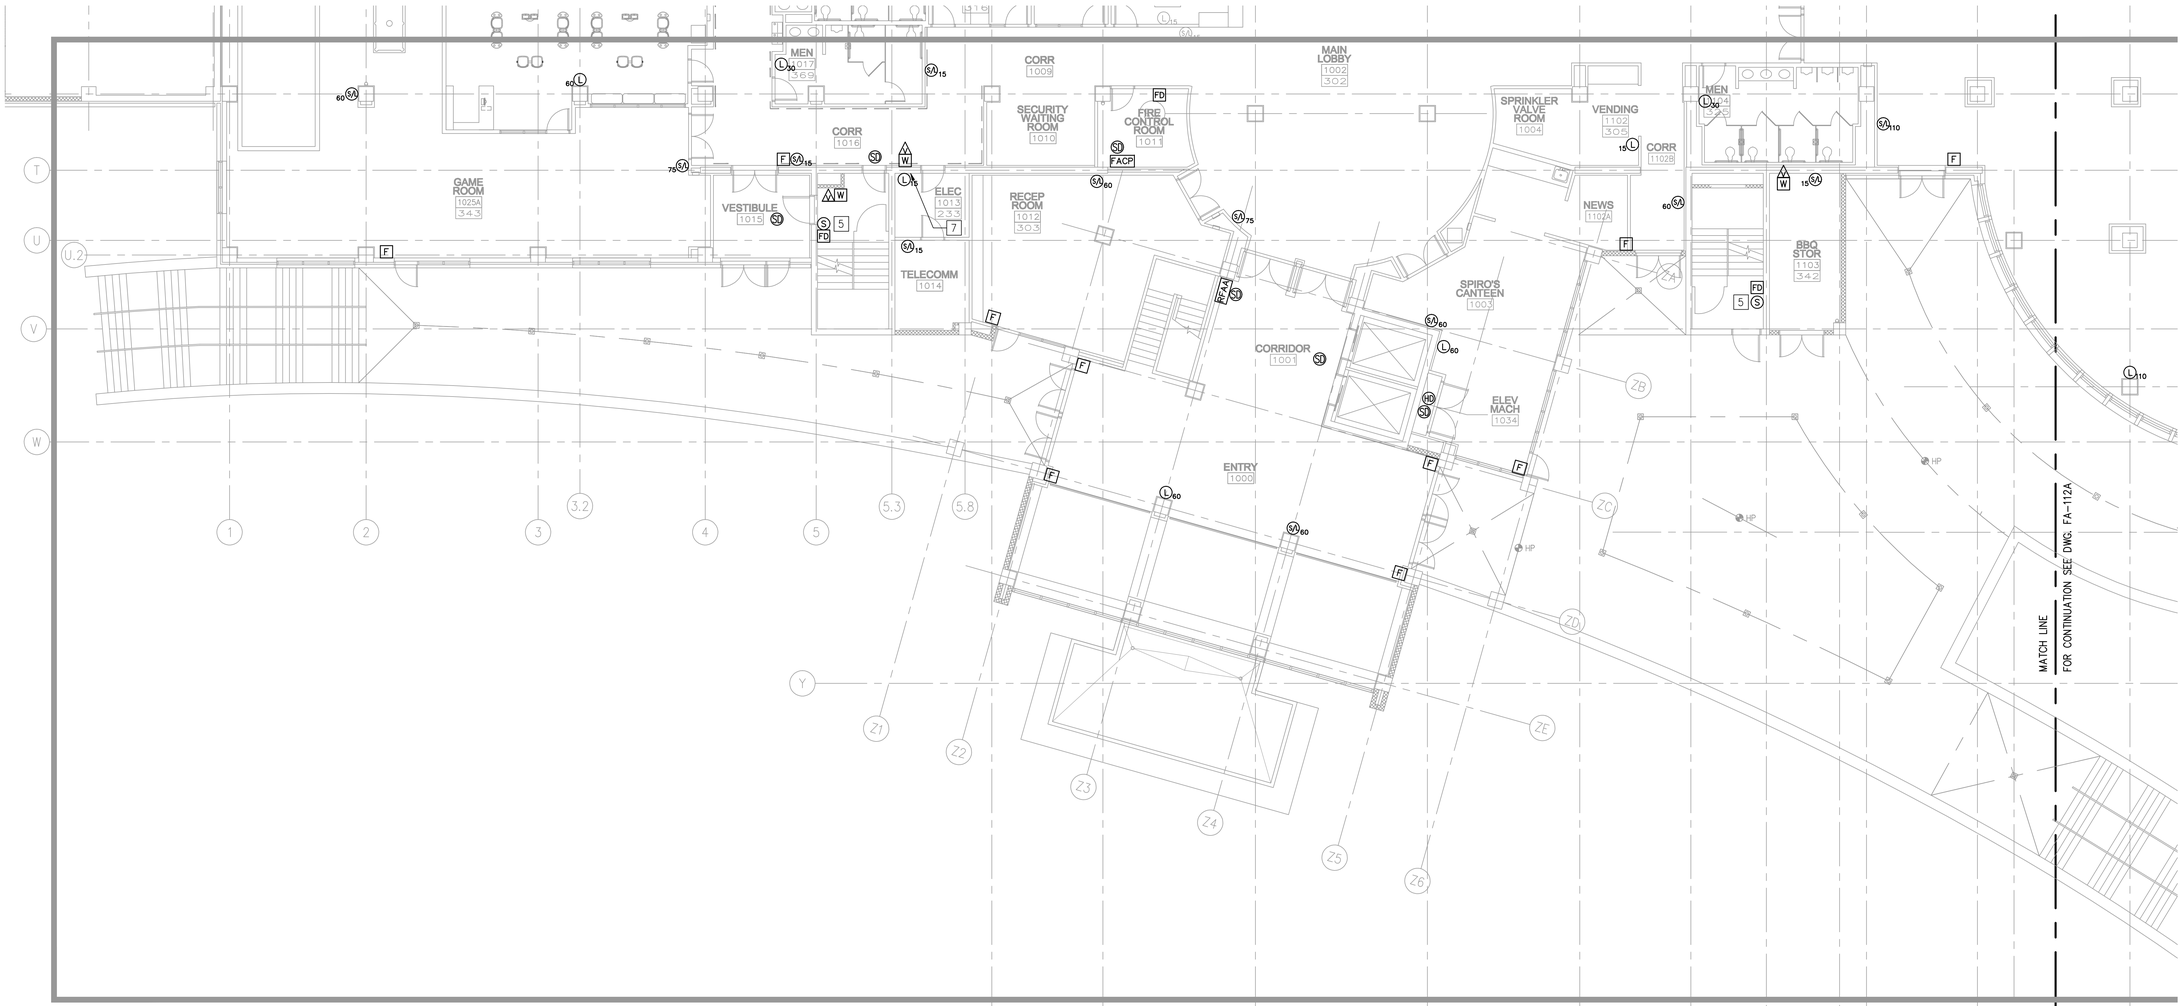

1 **PARTIAL FIRST FLOOR PLAN - AREA 2 - ENTRY**
FA102A FA102A 1/8"=1'-0"

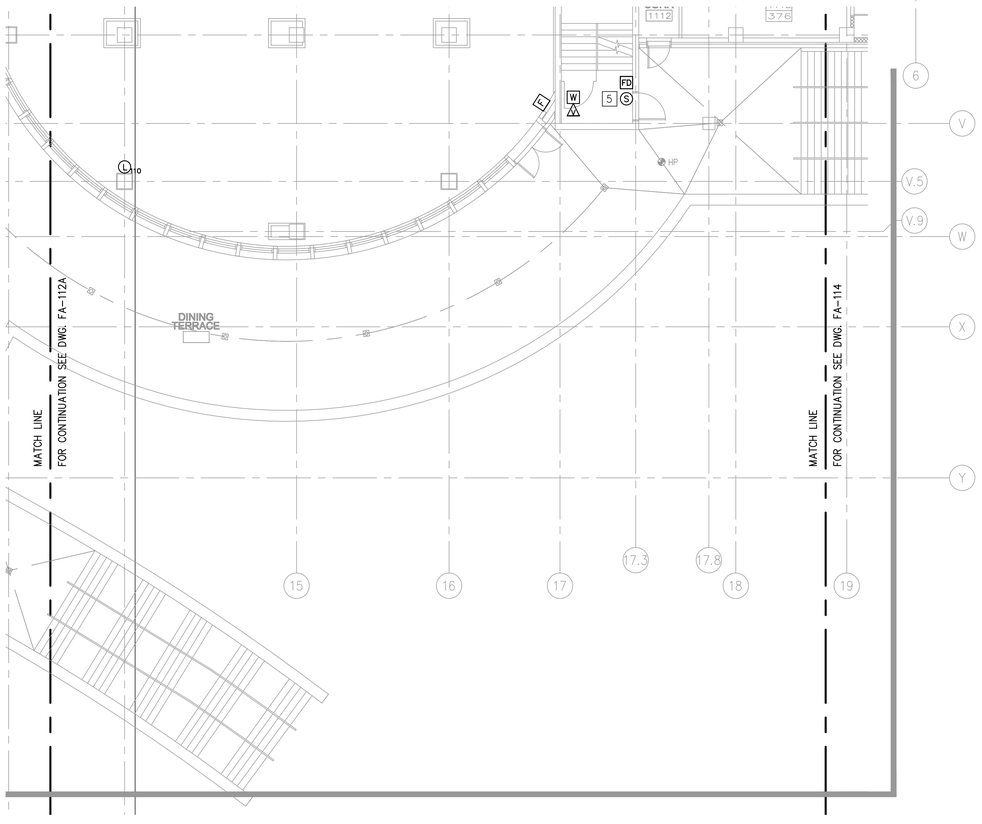

2 **PARTIAL FIRST FLOOR PLAN - AREA 2 - ENTRY**
FA102A FA102A 1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

KEY PLAN



AREA 2
GARAGE FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PART. FIRST FLR PLAN –AREA 2– ENTRY
FILE NAME	FA-112A-N0095730.DWG
FLOOR NO.	FIRST FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 12A
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

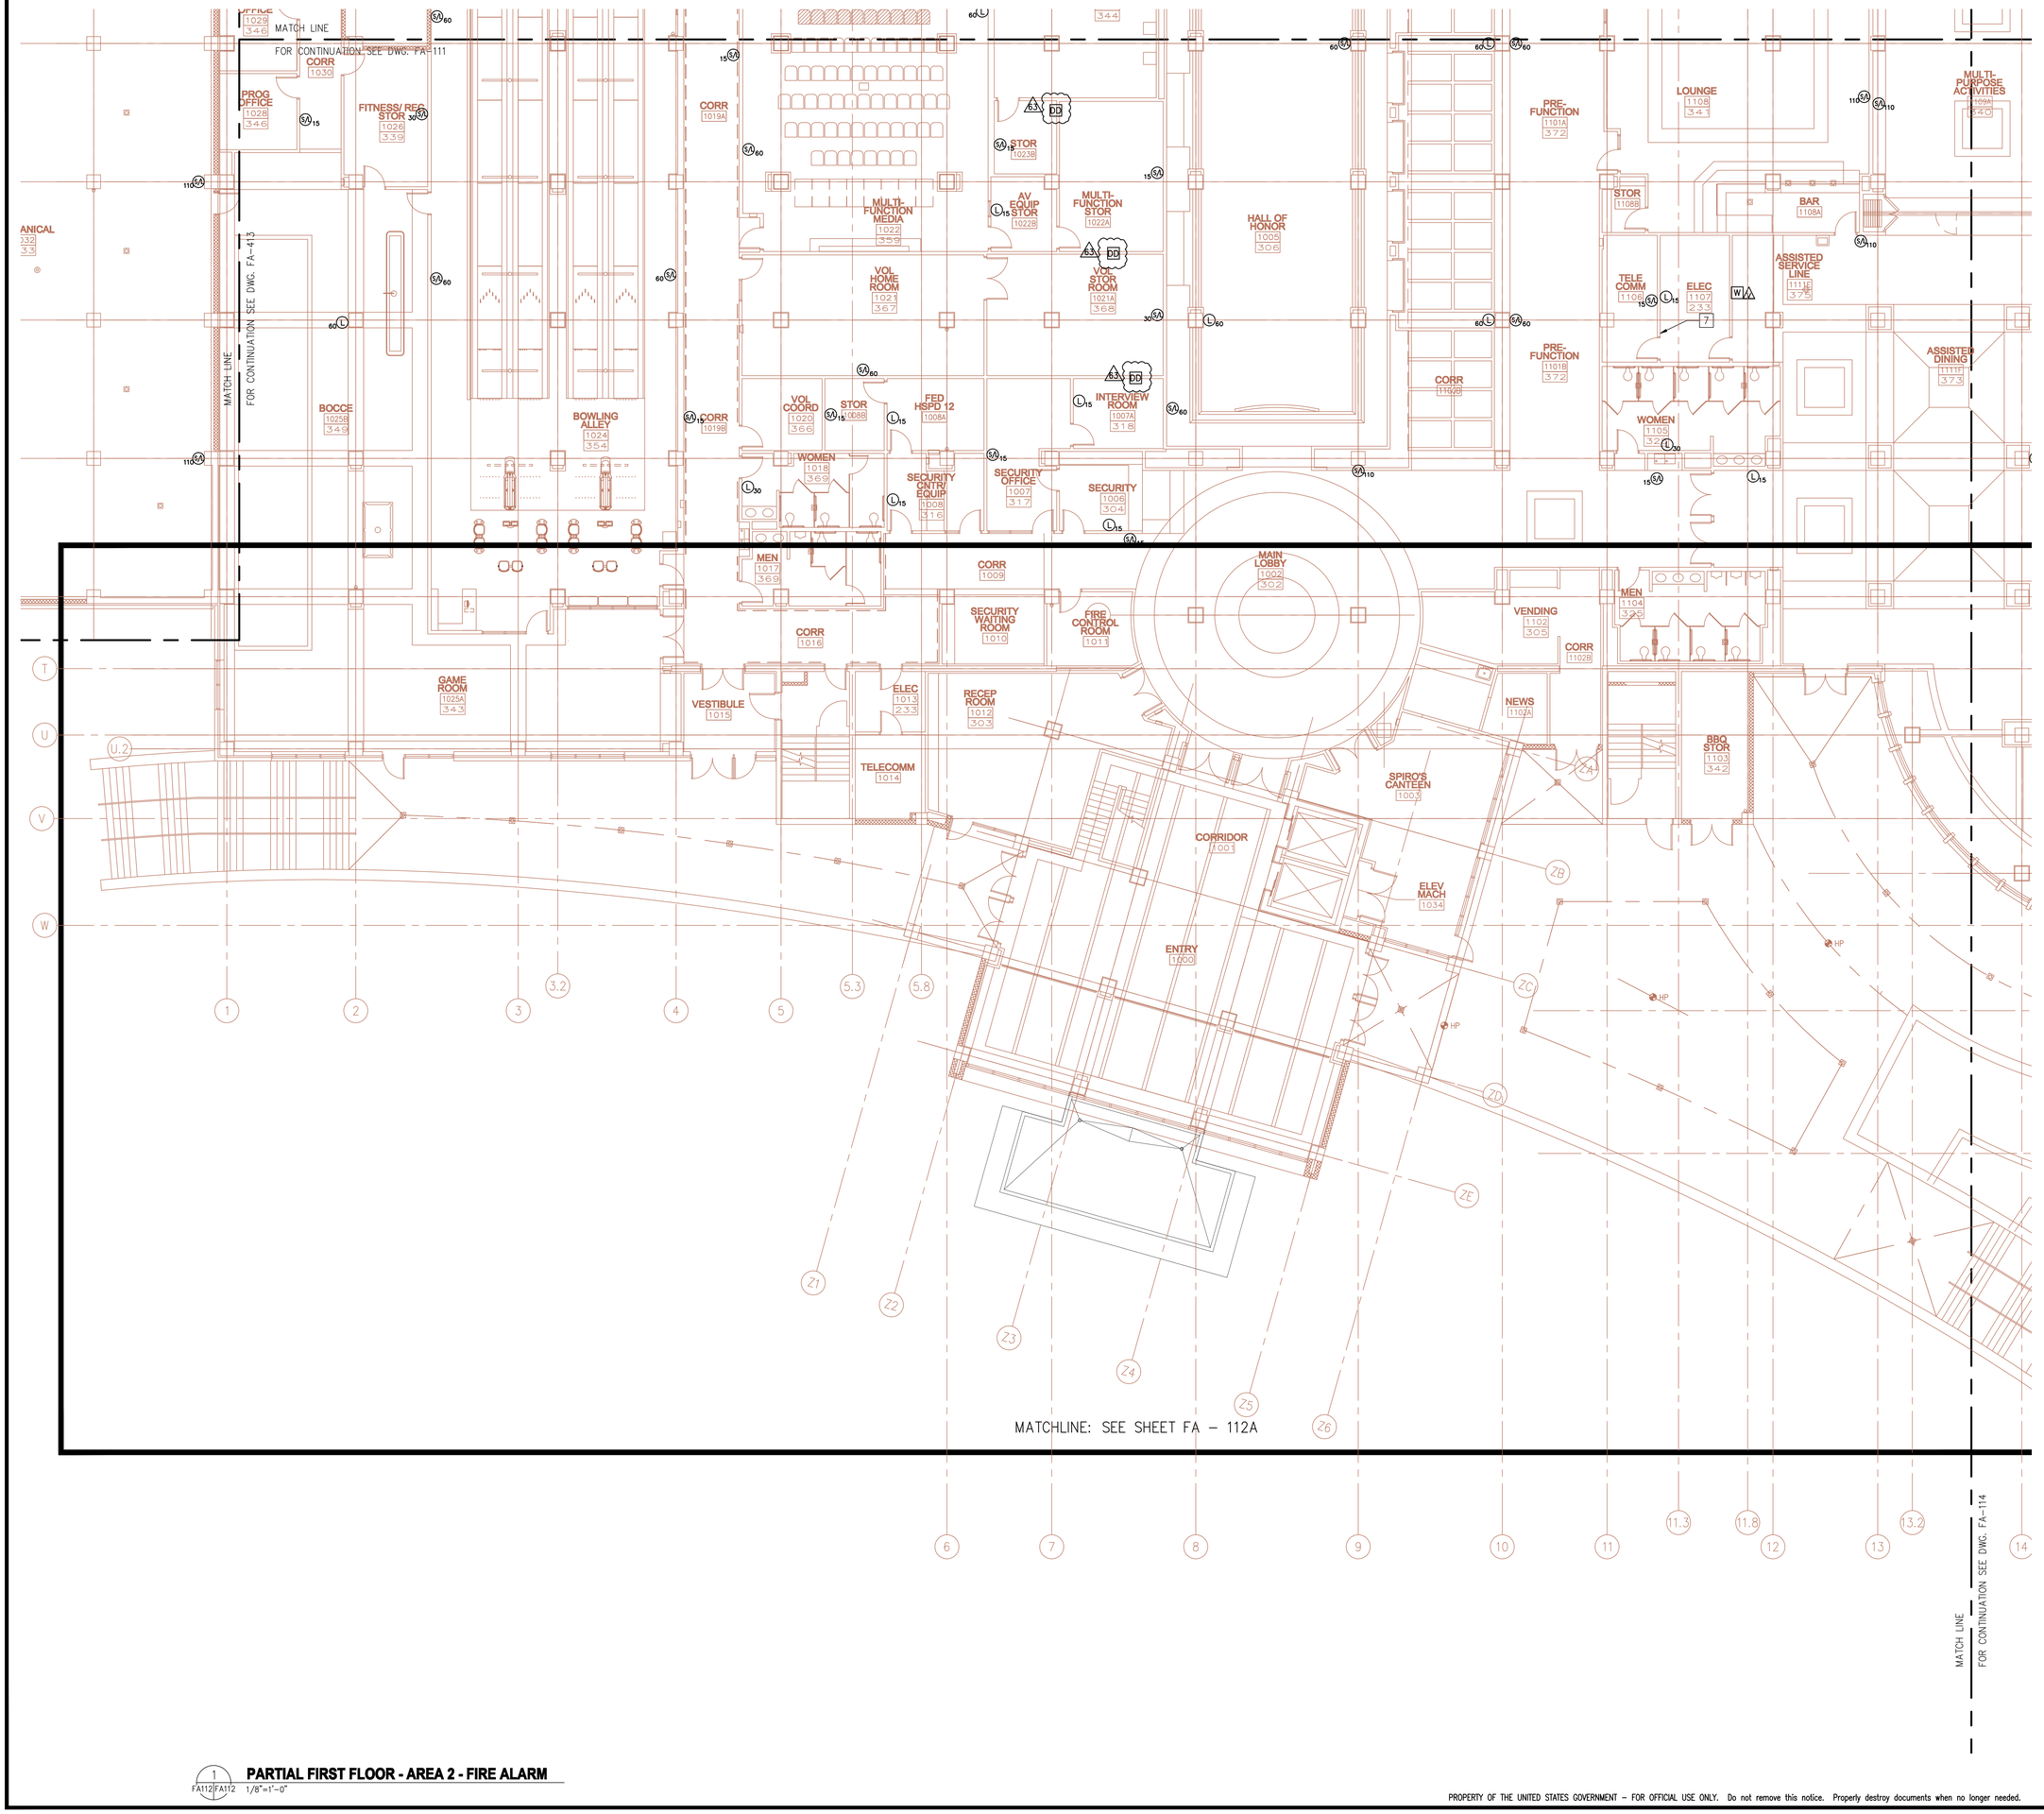

PARTIAL FIRST FLOOR - AREA 2 - FIRE ALARM

1 / FA112 | FA112 1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

6 PROVIDE AUTOMATIC FIRE DETECTION, CONTROL PANELS, ETC. FOR FM200 FIRE SUPPRESSION SYSTEM IN IT SERVER ROOM 1309.

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

CERTIFICATIONS

SHANE HATAMIYAR — REGISTERED PROFESSIONAL ENGINEER — 16355 — STATE OF MISSISSIPPI — 2009.04.17

KEY PLAN



AREA 2
FIRST FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 1ST FL PL – AREA 2 – FIRE ALARM
FILE NAME	FA-112-N0095730.DWG
FLOOR NO.	FIRST FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 12 DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

1 FA112/FA112 **PARTIAL FIRST FLOOR - AREA 2 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans
JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

6 PROVIDE AUTOMATIC FIRE DETECTION, CONTROL PANELS, ETC. FOR FM200 FIRE SUPPRESSION SYSTEM IN IT SERVER ROOM 1309.

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

KEY PLAN

AREA 2
FIRST FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 1ST FL PL – AREA 2 – FIRE ALARM
FILE NAME	FA-112-N0095730.DWG
FLOOR NO.	FIRST FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 12

DISCIPLINE SHEET TYPE SEQUENCE
SHEET OF –

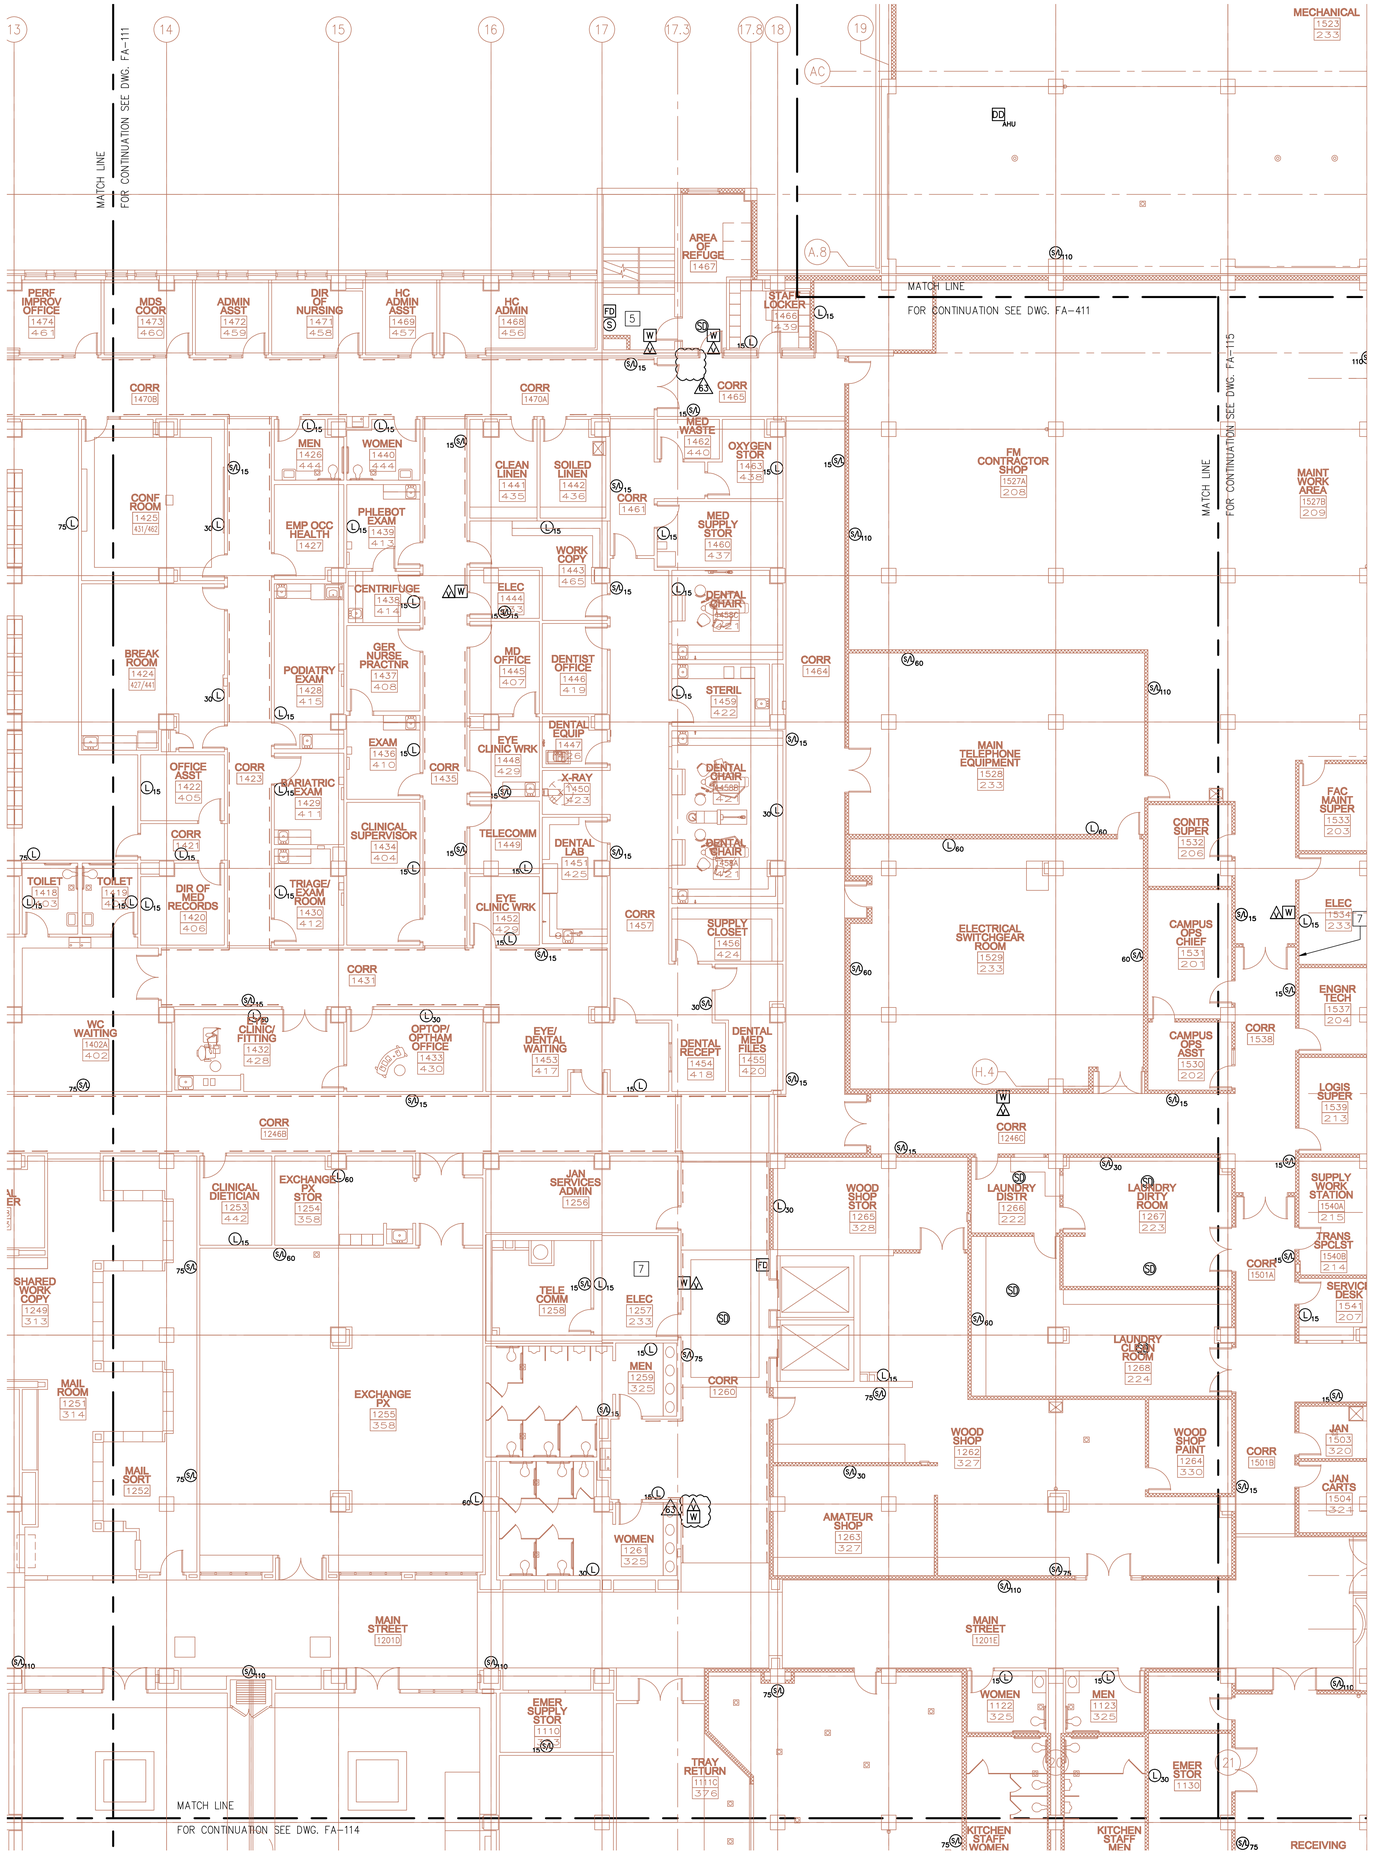

1 FA113 FA113 **PARTIAL FIRST FLOOR - AREA 3 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

6 PROVIDE AUTOMATIC FIRE DETECTION, CONTROL PANELS, ETC. FOR FM200 FIRE SUPPRESSION SYSTEM IN IT SERVER ROOM 1309.

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

CERTIFICATIONS

DWANE HATHAWAY — REGISTERED PROFESSIONAL ENGINEER — ENGINEER — 16355 — STATE OF MISSISSIPPI — 2009.04.17

KEY PLAN



AREA 3
FIRST FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 1ST FL PL – AREA 3 – FIRE ALARM
FILE NAME	FA-113-N0095730.DWG
FLOOR NO.	FIRST FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 13 (DISCIPLINE SHEET TYPE SEQUENCE)
	SHEET OF –

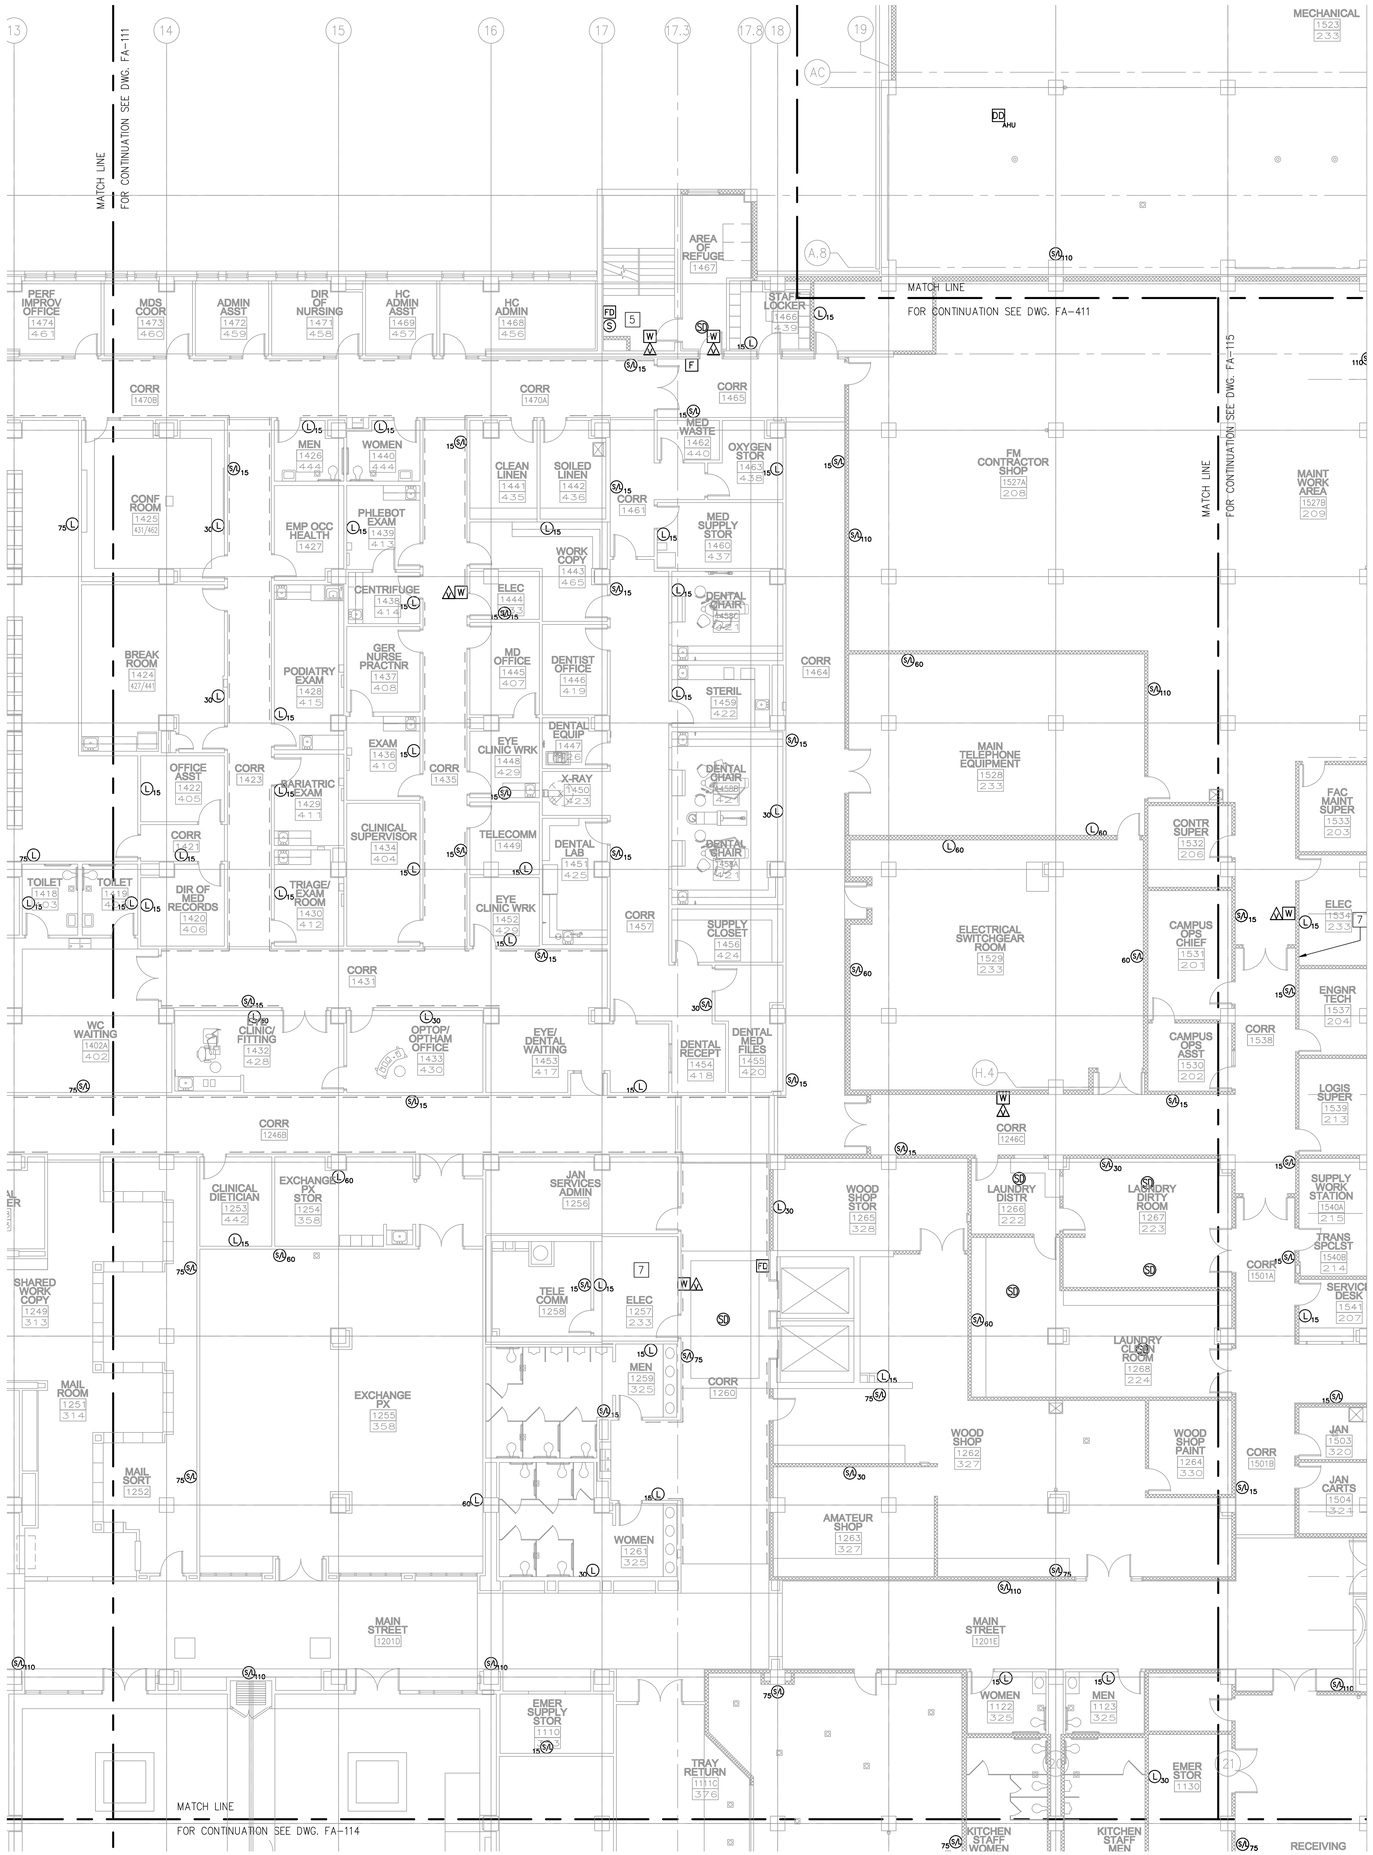

1 FA113/FA113 **PARTIAL FIRST FLOOR - AREA 3 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans
JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

6 PROVIDE AUTOMATIC FIRE DETECTION, CONTROL PANELS, ETC. FOR FM200 FIRE SUPPRESSION SYSTEM IN IT SERVER ROOM 1309.

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

Registered Professional Engineer — Date 12/08/08 — ENGINEER — 18355 — STATE OF MISSISSIPPI

KEY PLAN



AREA 3
FIRST FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 1ST FL PL – AREA 3 – FIRE ALARM
FILE NAME	FA-113-N0095730.DWG
FLOOR NO.	FIRST FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 13 DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

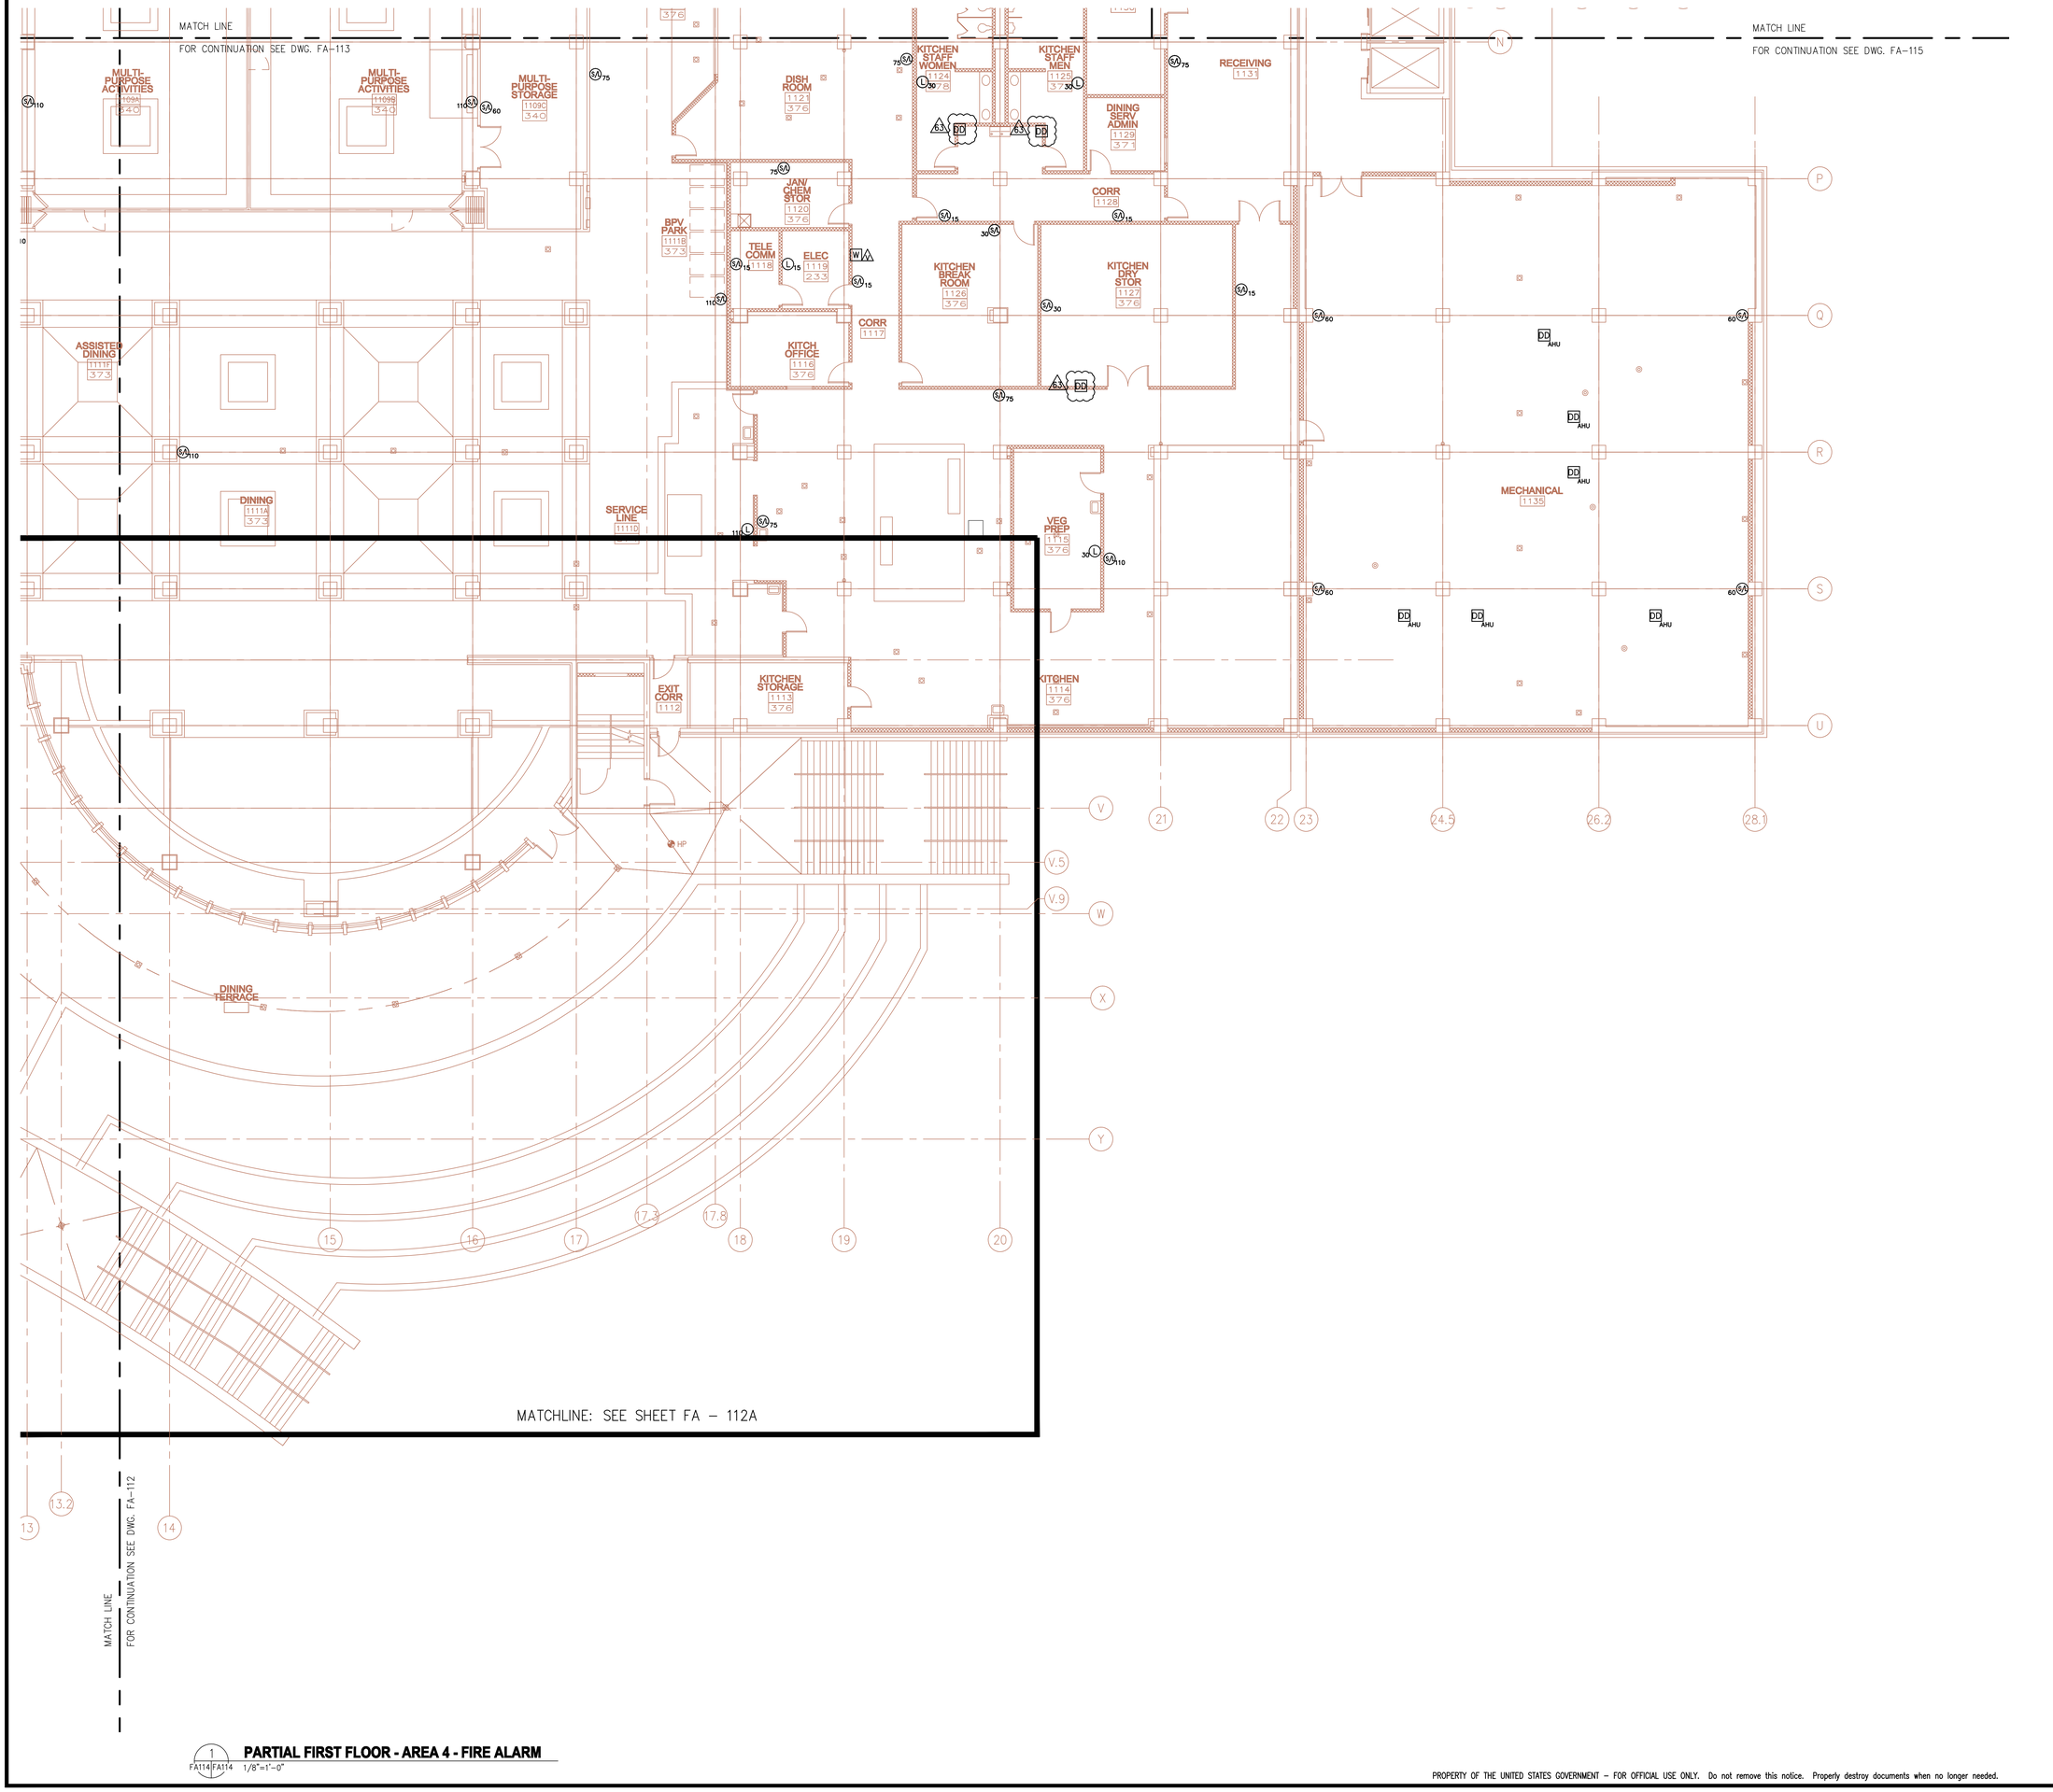

1 FA114 FA114 **PARTIAL FIRST FLOOR - AREA 4 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

CERTIFICATIONS

SHANE HATAWAY — REGISTERED PROFESSIONAL — ENGINEER — 16355 — STATE OF MISSISSIPPI — 2009.09.17

KEY PLAN

AREA 1
FIRST FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
2	09/08/08	ISSUED FOR CONSTRUCTION
3	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 1ST FL PL – AREA 4 – FIRE ALARM
FILE NAME	FA-114-N0095730.DWG
FLOOR NO.	FIRST FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 14
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

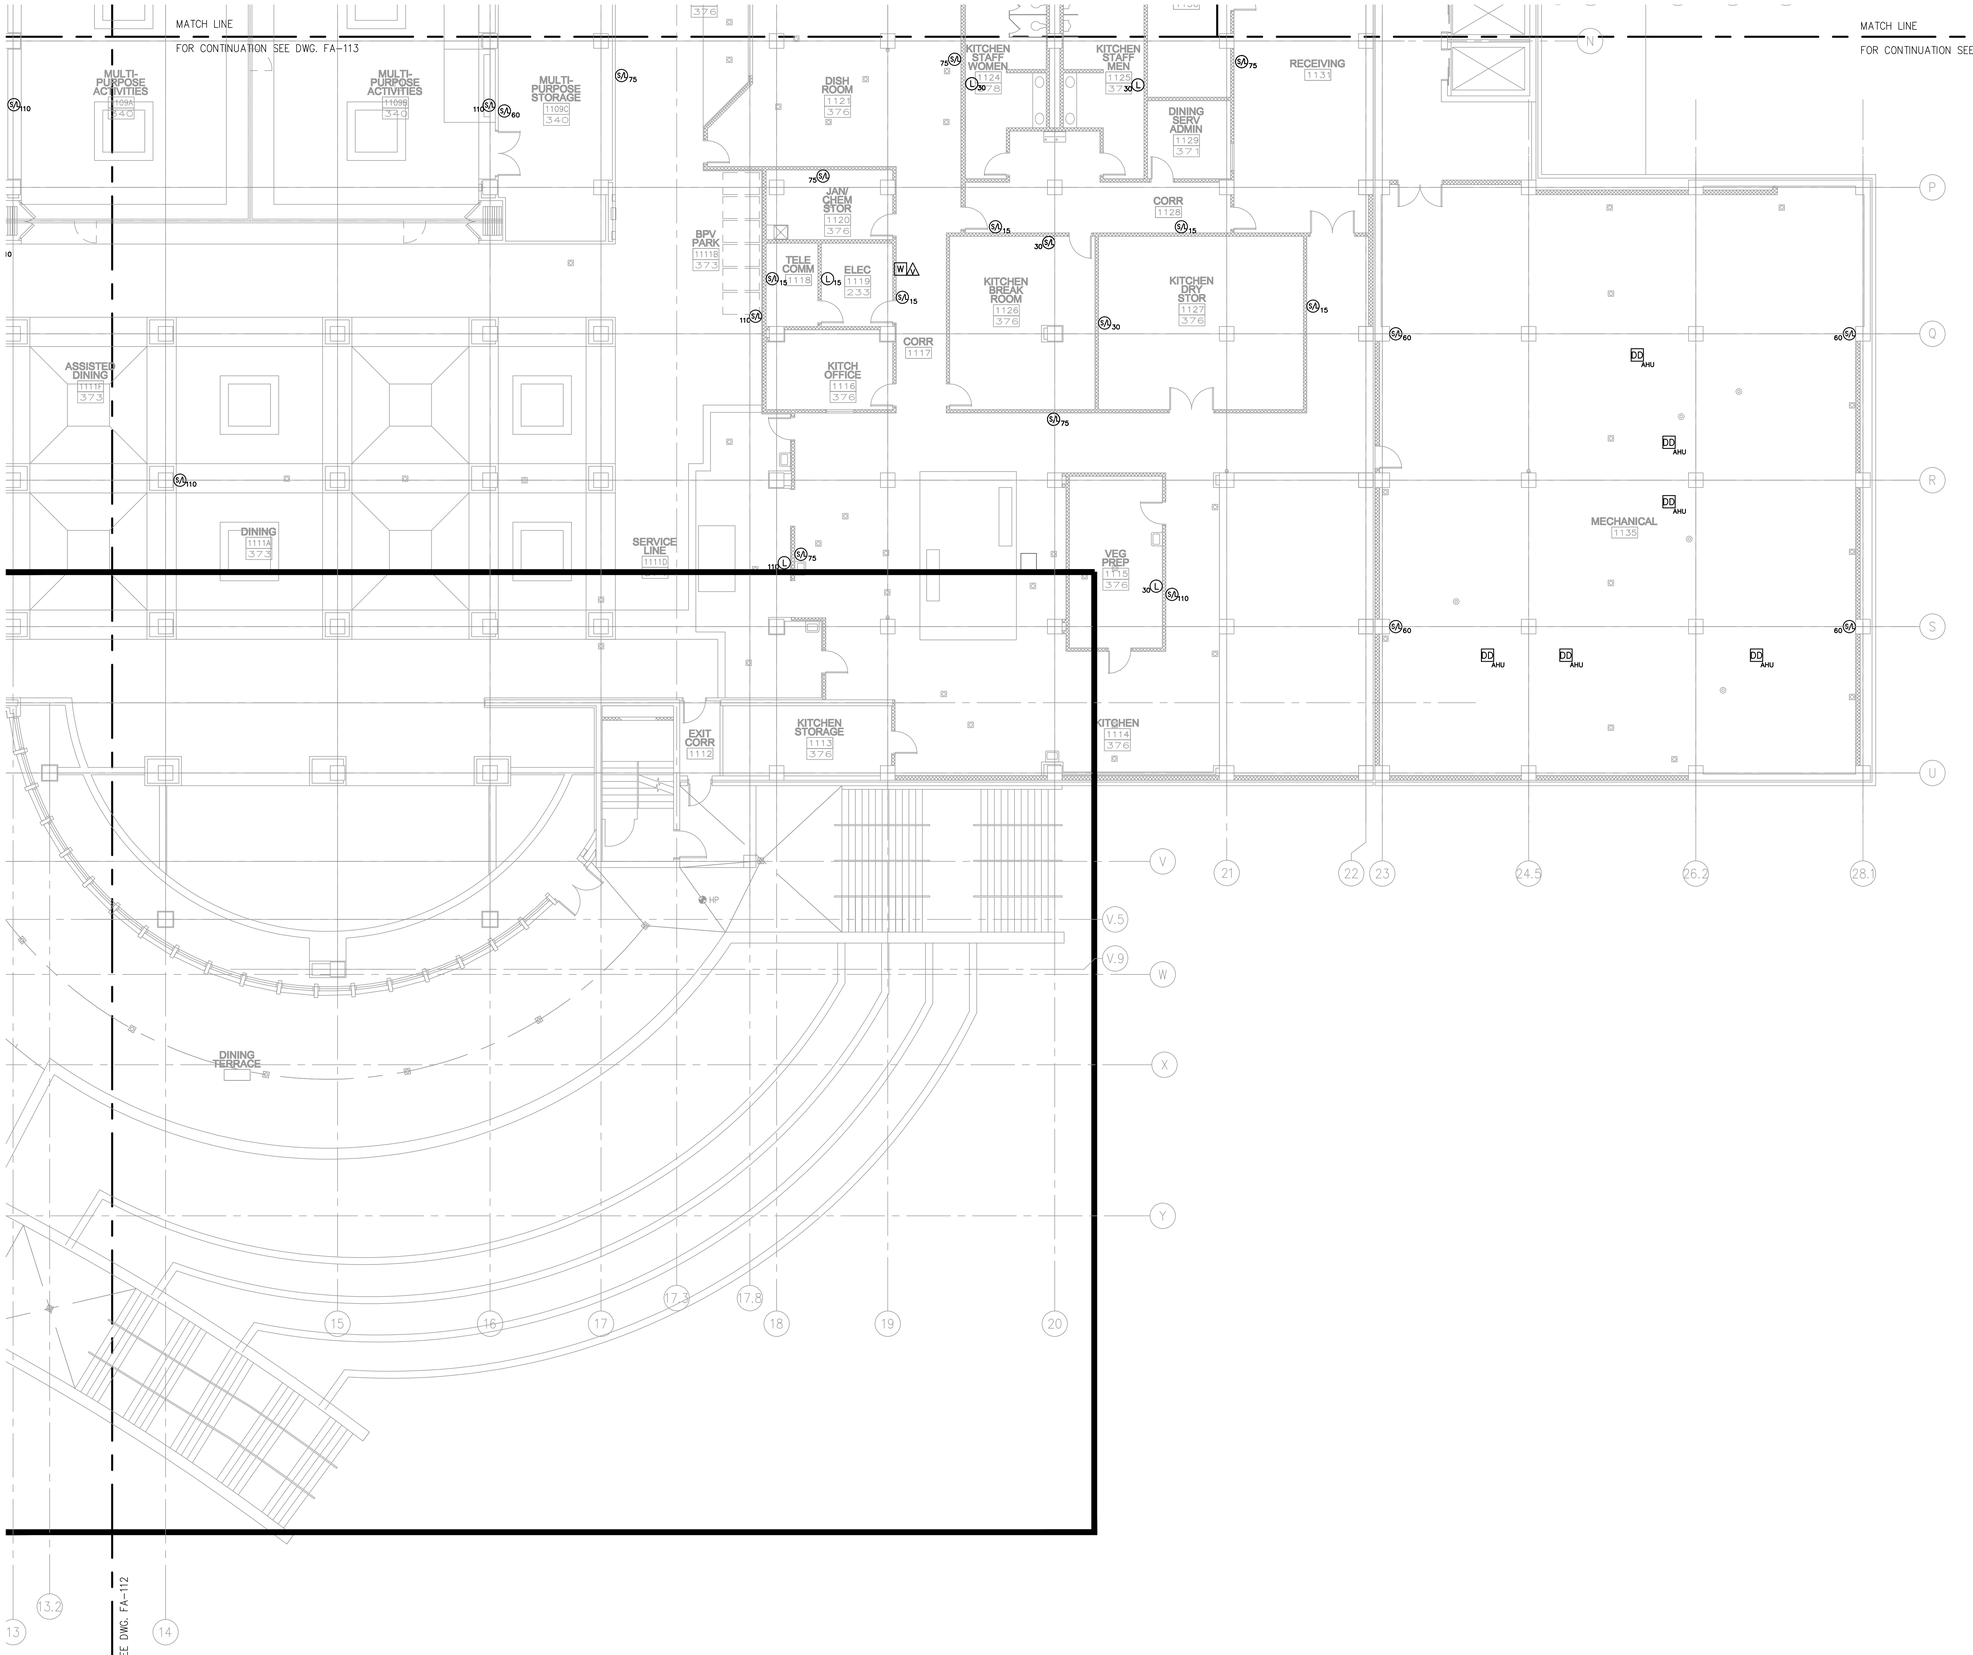

1 FA114 FA114 **PARTIAL FIRST FLOOR - AREA 4 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

KEY PLAN

AREA 1
FIRST FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 1ST FL PL – AREA 4 – FIRE ALARM
FILE NAME	FA-114-N0095730.DWG
FLOOR NO.	FIRST FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 14 (DISCIPLINE SHEET TYPE SEQUENCE)
	SHEET OF –

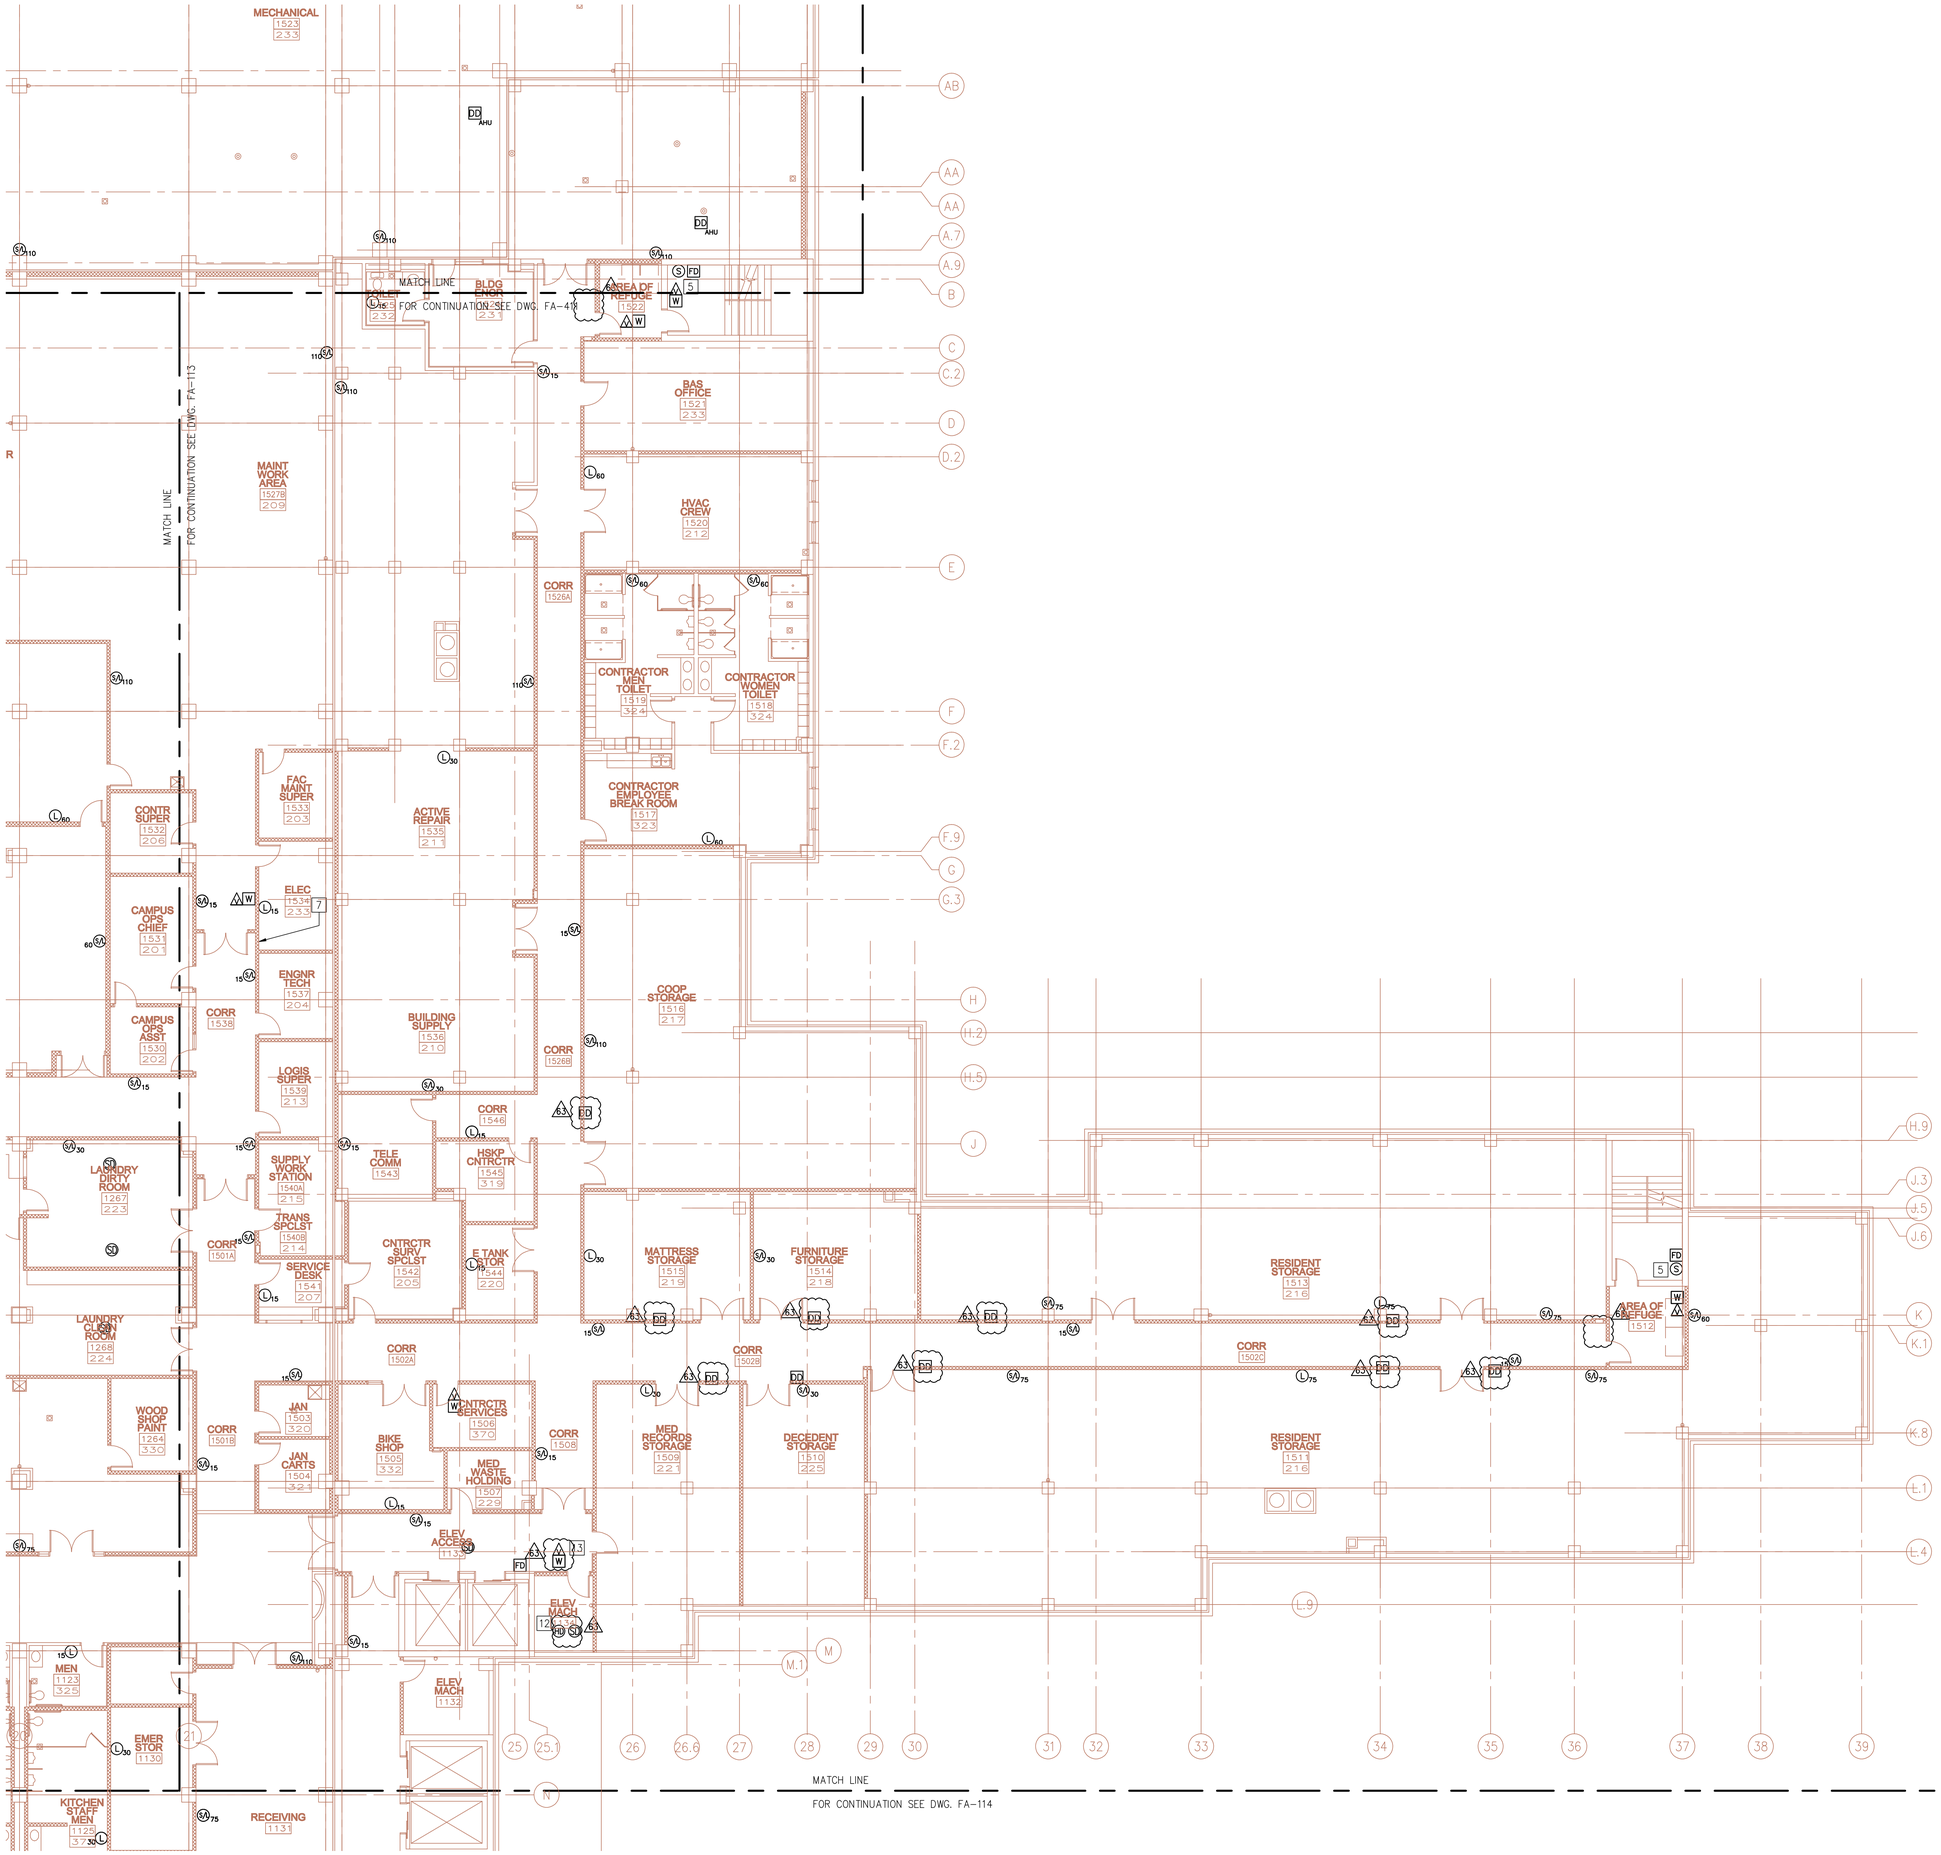

1 FA115|FA115 **PARTIAL FIRST FLOOR - AREA 5 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans
JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

12 HEAT DETECTOR SHOULD BE WITHIN 18" OF FIRE SPRINKLERS.

13 THE WATER FLOW ALARAM AND HEAT DETECTOR SHALL AUTOMATICALLY DISCONNECT THE MAINELINE POWER TO THE ASSOCIATED ELEVATORS.

CERTIFICATIONS

KEY PLAN

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 1ST FL PL - AREA 5 - FIRE ALARM
FILE NAME	FA-115-N0095730.DWG
FLOOR NO.	FIRST FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 15 DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

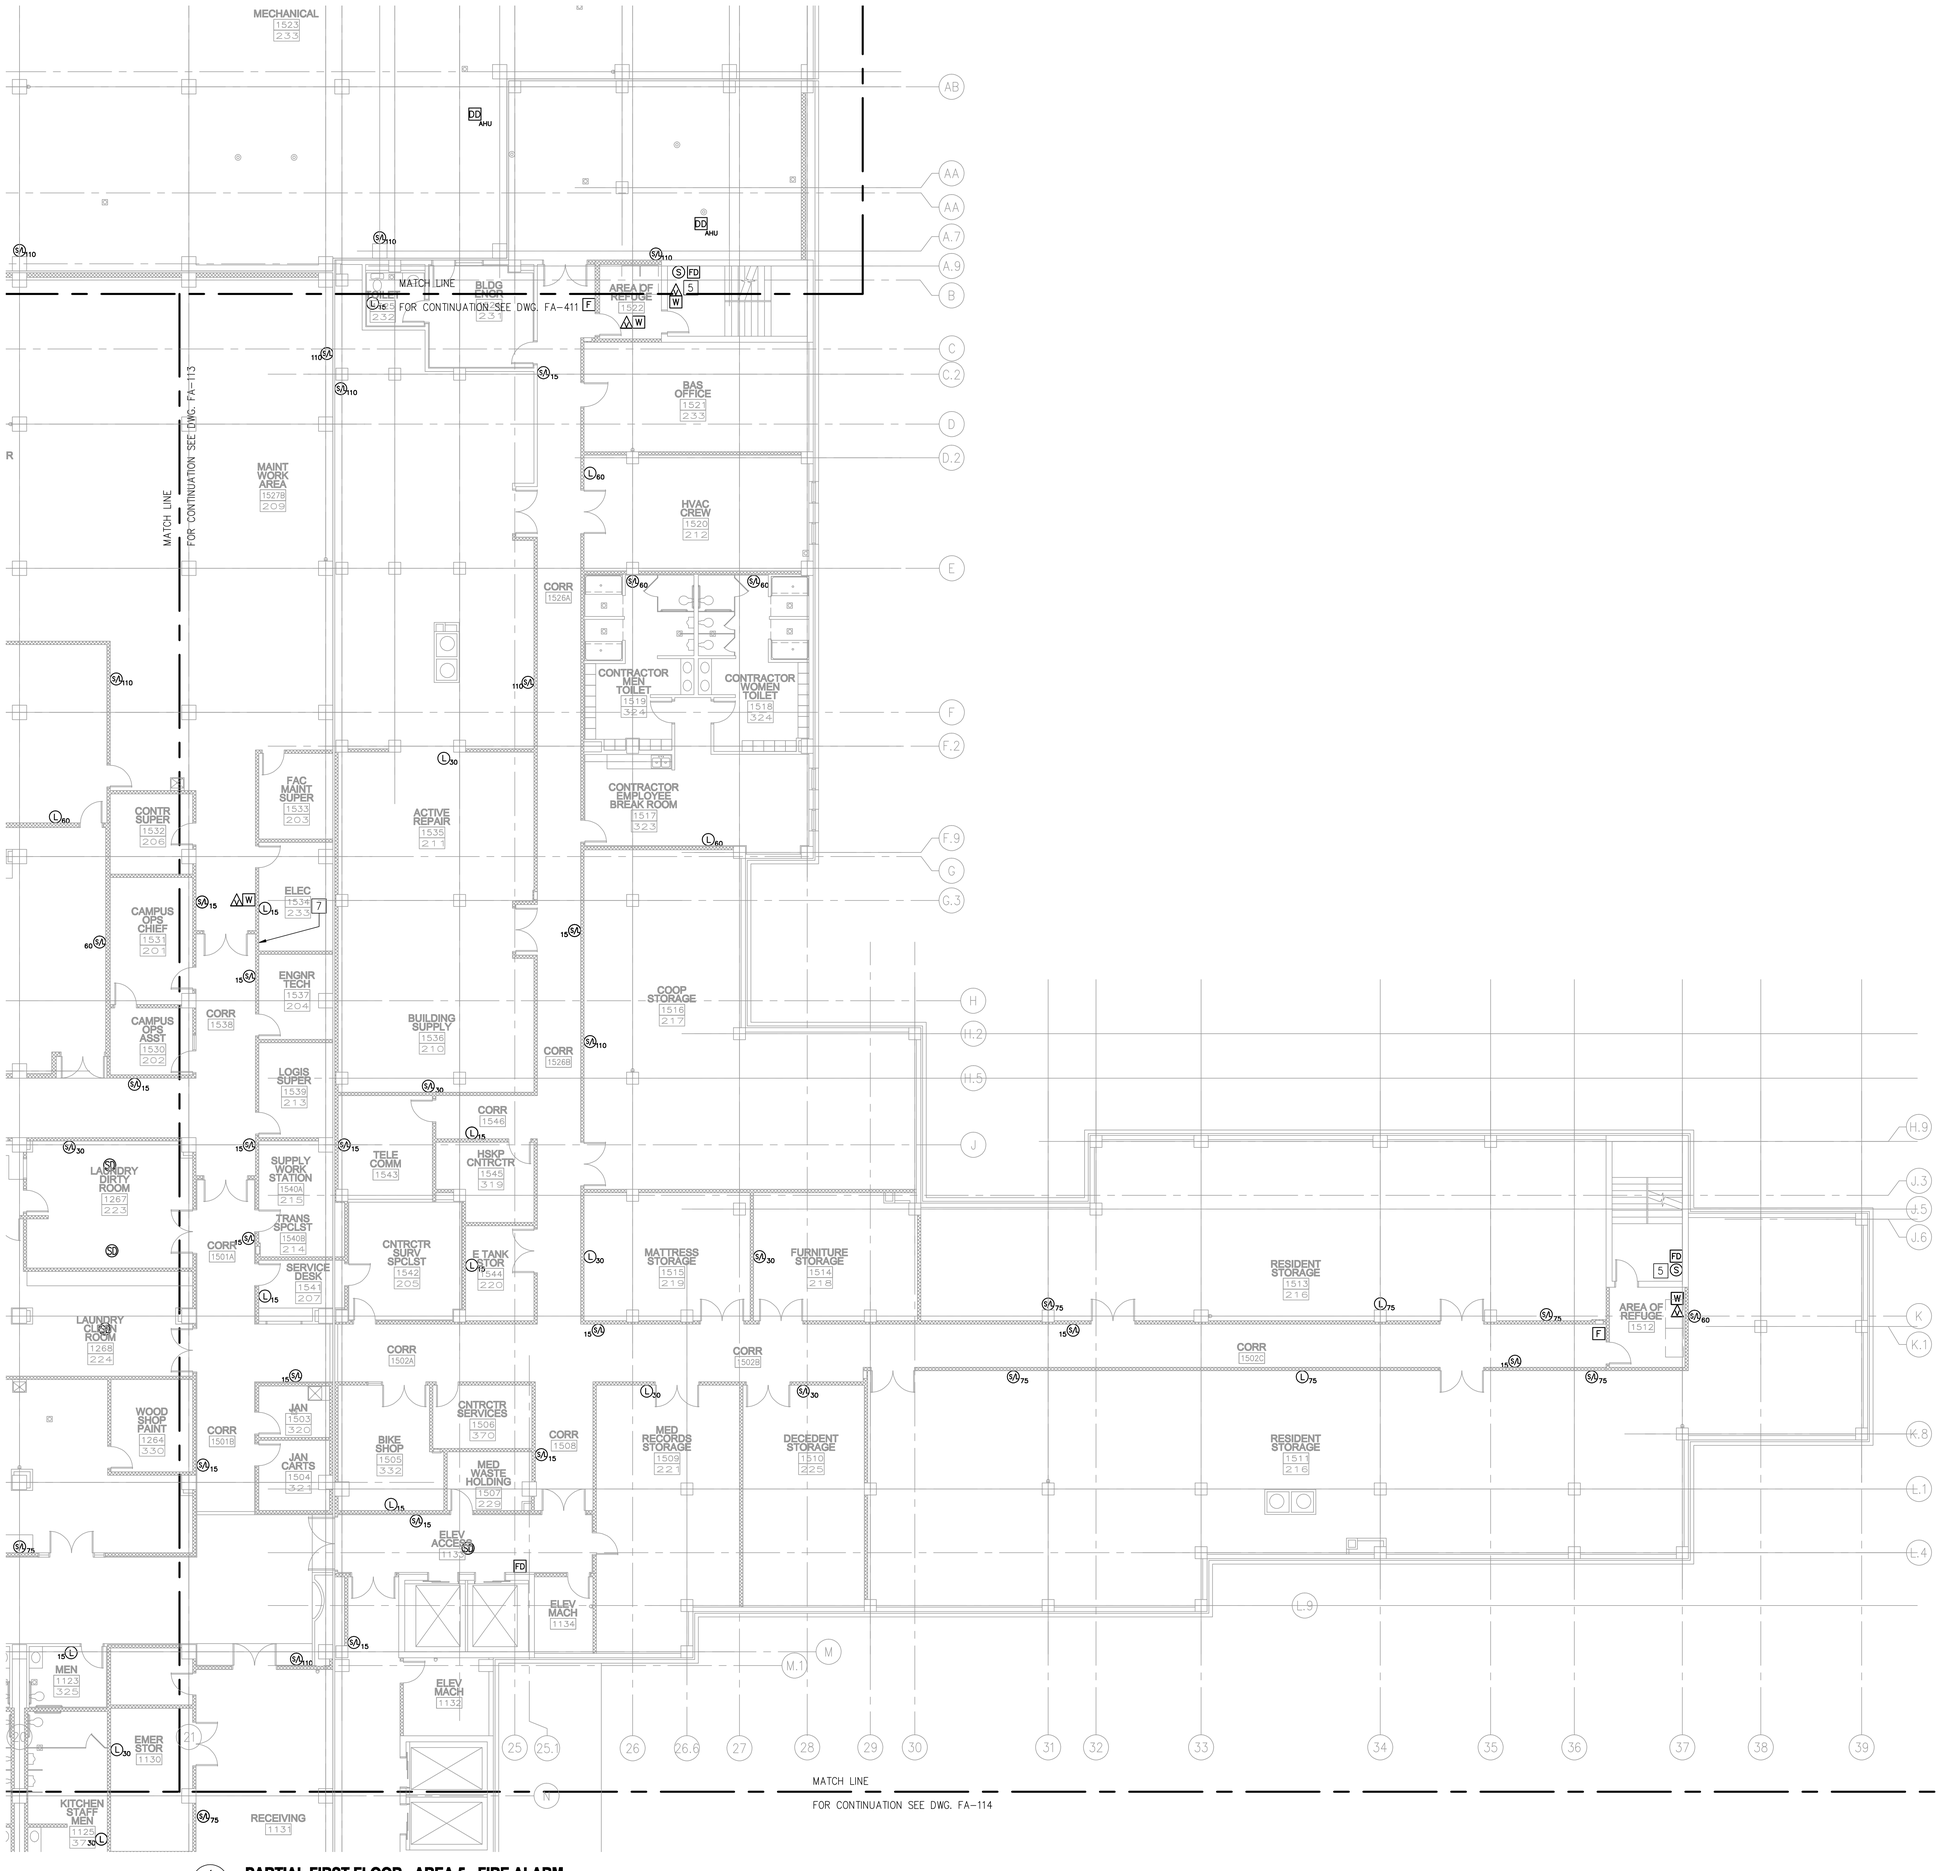

1 PARTIAL FIRST FLOOR - AREA 5 - FIRE ALARM

FA115 | FA115 1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans
JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

KEY PLAN

AREA 5
FIRST FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

DRAWING SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 1ST FL PL - AREA 5 - FIRE ALARM
FILE NAME	FA-115-N0095730.DWG
FLOOR NO.	FIRST FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 15 DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

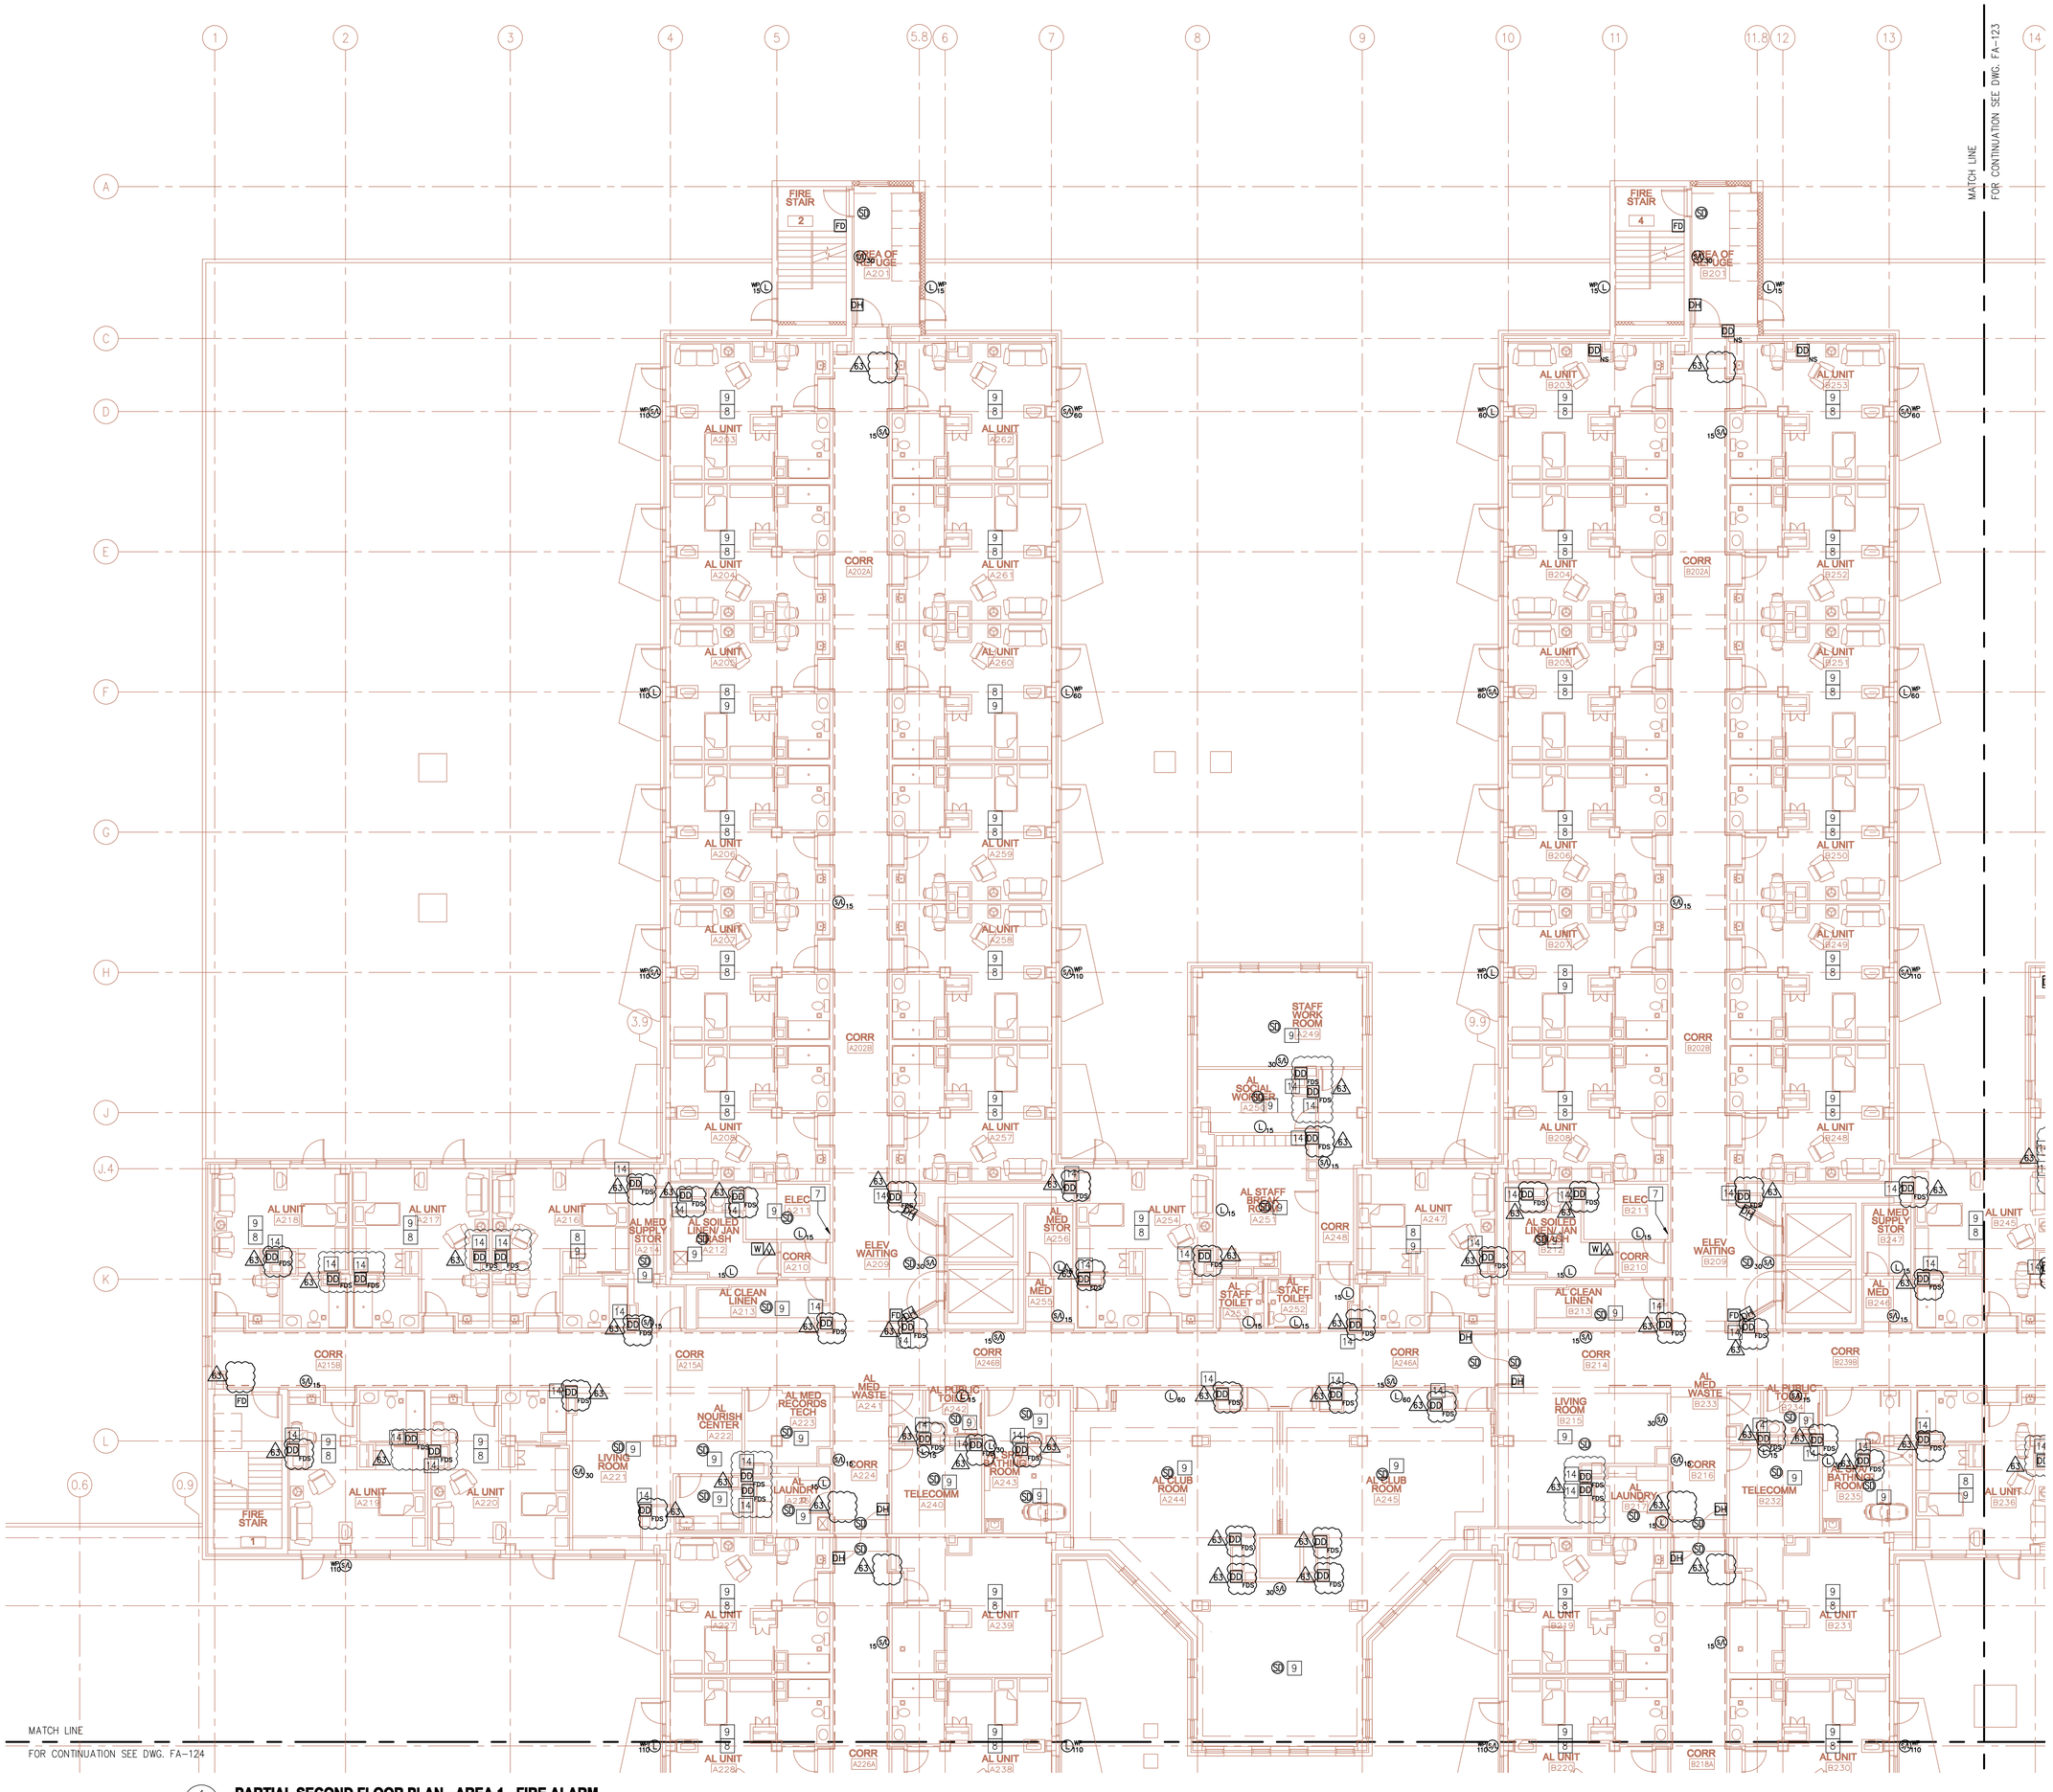

1 FA121|FA121 **PARTIAL SECOND FLOOR PLAN - AREA 1 - FIRE ALARM**
1/8"=1'-0"

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 / 6.3 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

14 ACTIVATION OF SMOKE DUCT DETECTOR SHALL CLOSE FIRE/SMOKE DAMPER SERVING THE FLOOR/CEILING ASSY DUCT PENETRATION (PER SECTION 716.3.2.1(1) OF THE 2006 IBC).

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CERTIFICATIONS

DWAYNE HATHORN
CERTIFICATE NO.
ENGINEER
16355
STATE OF MISSISSIPPI
2009.04.17

KEY PLAN

AREA 1
SECOND FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

BUILDING CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 2ND FL PL - AREA 1 - FIRE ALARM
FILE NAME	FA-121-N0095730.DWG
FLOOR NO.	SECOND FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 21 DISCIPLINE SHEET TYPE SEQUENCE SHEET OF -

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

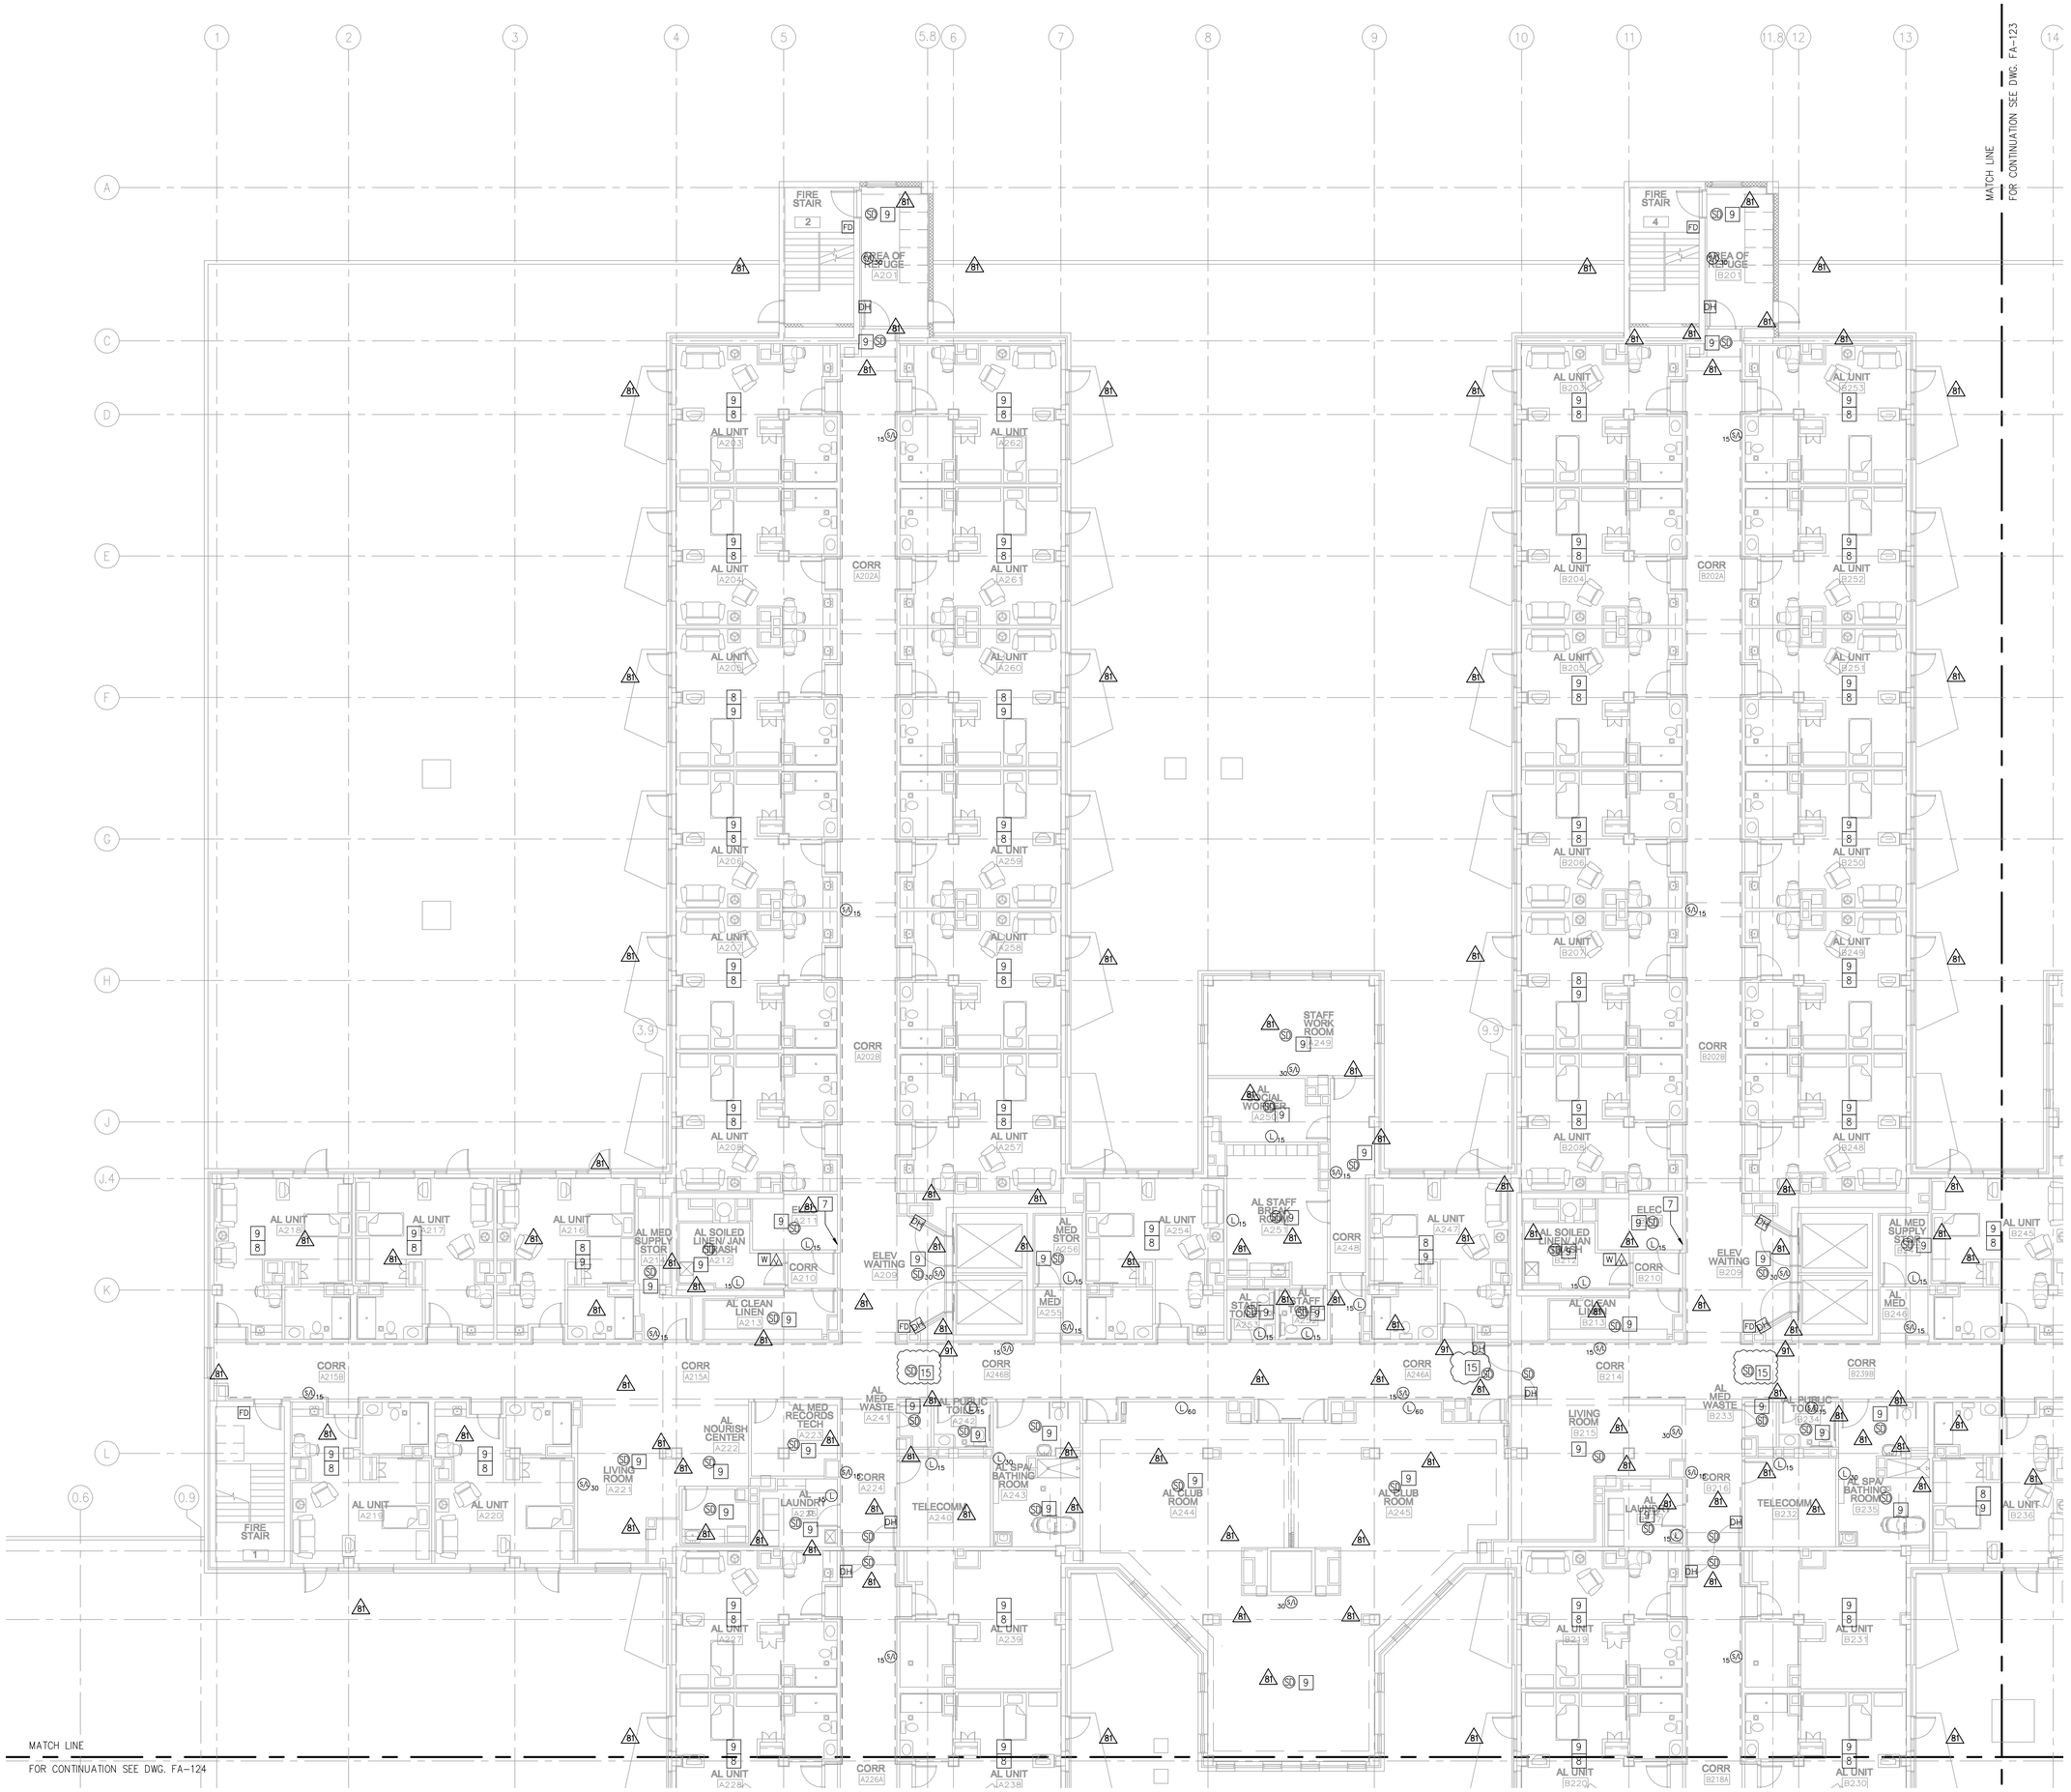

1 FA121|FA121 **PARTIAL SECOND FLOOR PLAN - AREA 1 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

14 ACTIVATION OF SMOKE DUCT DETECTOR SHALL CLOSE FIRE/SMOKE DAMPER SERVING THE FLOOR/CEILING ASSY DUCT PENETRATION (PER SECTION 716.3.2.1(1) OF THE 2006 IBC).

15 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ADJACENT FIRE/SMOKE DAMPER (PER SECTION 716.3.2.1(4) OF THE 2006 IBC).

CERTIFICATIONS

STEPHEN HATHAWAY — 11/4/09
REGISTERED PROFESSIONAL ENGINEER — ENGINEER — 18355 — STATE OF MISSISSIPPI

KEY PLAN

AREA 1
SECOND FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
2	09/08/08	ISSUED FOR CONSTRUCTION
3	04/17/09	ARCHITECTURAL & MEP REVISIONS
4	07/10/09	FIRE PROTECTION & SPEC REV
5	11/04/09	FIRE ALARM CHANGES

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 2ND FL PL – AREA 1 – FIRE ALARM
FILE NAME	FA-121-N0095730.DWG
FLOOR NO.	SECOND FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 21 DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

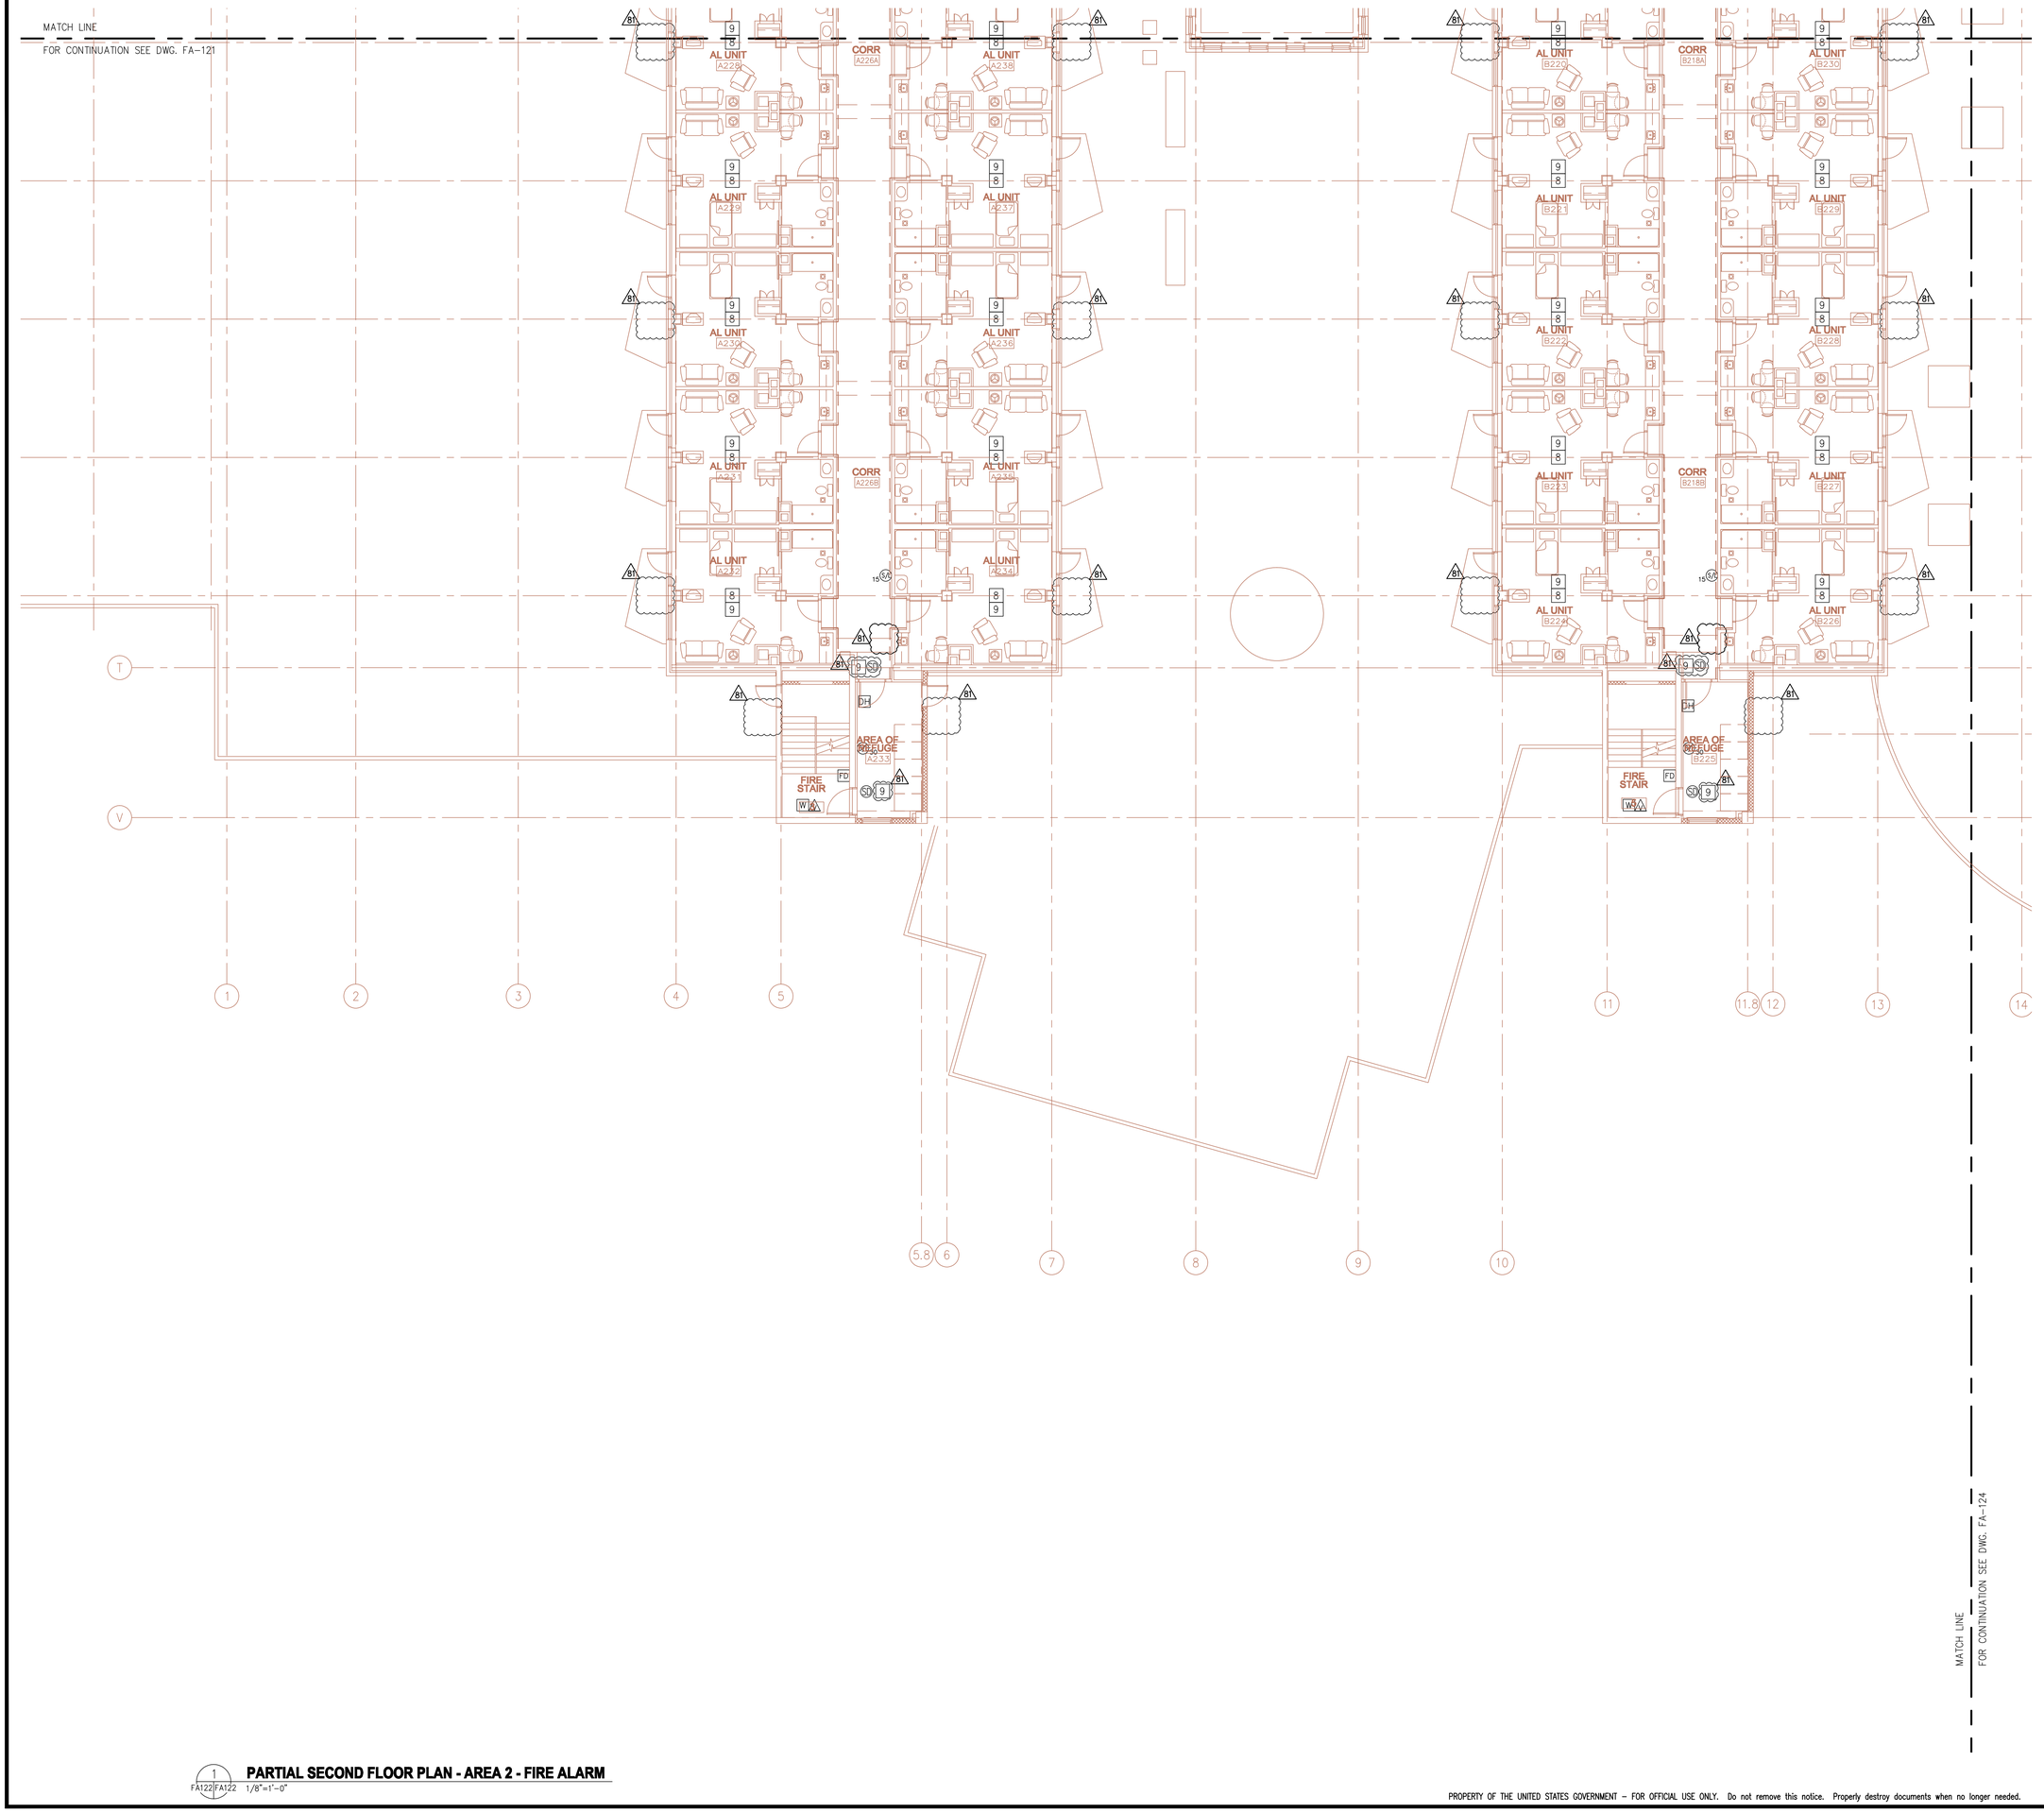

1 FA122/FA122 **PARTIAL SECOND FLOOR PLAN - AREA 2 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

CERTIFICATIONS

SHANE HATTAWAY 7/10/09 REGISTERED PROFESSIONAL ENGINEER 16355 STATE OF MISSISSIPPI

KEY PLAN

N

AREA 2
SECOND FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS
3	07/10/09	FIRE PROTECTION & SPEC REV

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 2ND FL PL – AREA 2 – FIRE ALARM
FILE NAME	FA-122-N0095730.DWG
FLOOR NO.	SECOND FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 22 DISCIPLINE SHEET TYPE SEQUENCE SHEET OF –

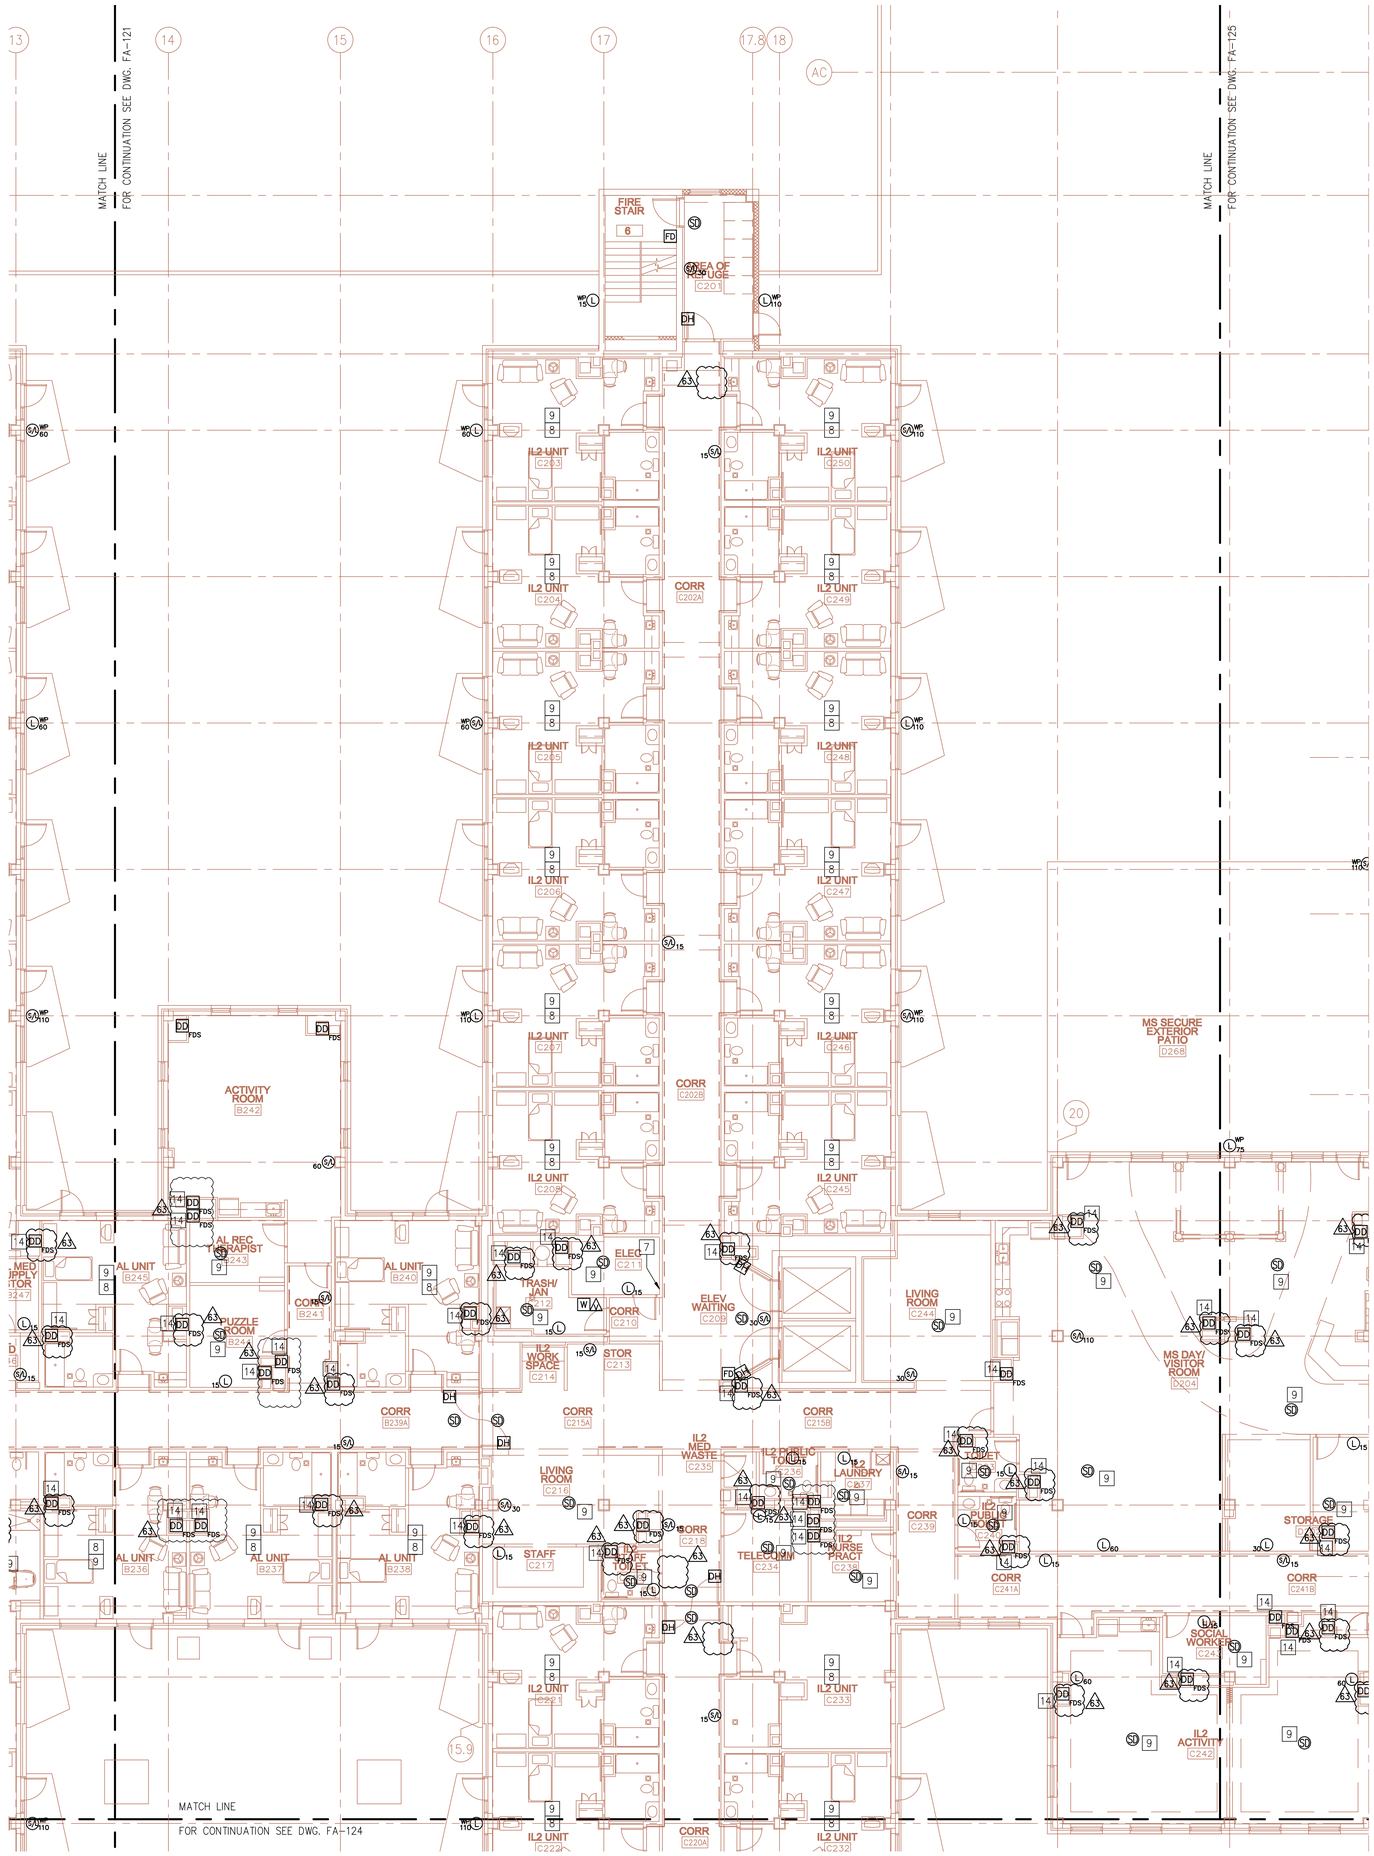

1 FA123 FA123 **PARTIAL SECOND FLOOR - AREA 3 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans
JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

63

14 ACTIVATION OF SMOKE DUCT DETECTOR SHALL CLOSE FIRE/SMOKE DAMPER SERVING THE FLOOR/CEILING ASSY DUCT PENETRATION (PER SECTION 716.3.2.1(1) OF THE 2006 IBC).

CERTIFICATIONS

NAME HATHAWAY REGISTERED PROFESSIONAL ENGINEER 16355 STATE OF MISSISSIPPI
Final 2009.04.17

KEY PLAN

N

AREA 3
SECOND FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 2ND FL PL – AREA 3 – FIRE ALARM
FILE NAME	FA-123-N0095730.DWG
FLOOR NO.	SECOND FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 23 DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

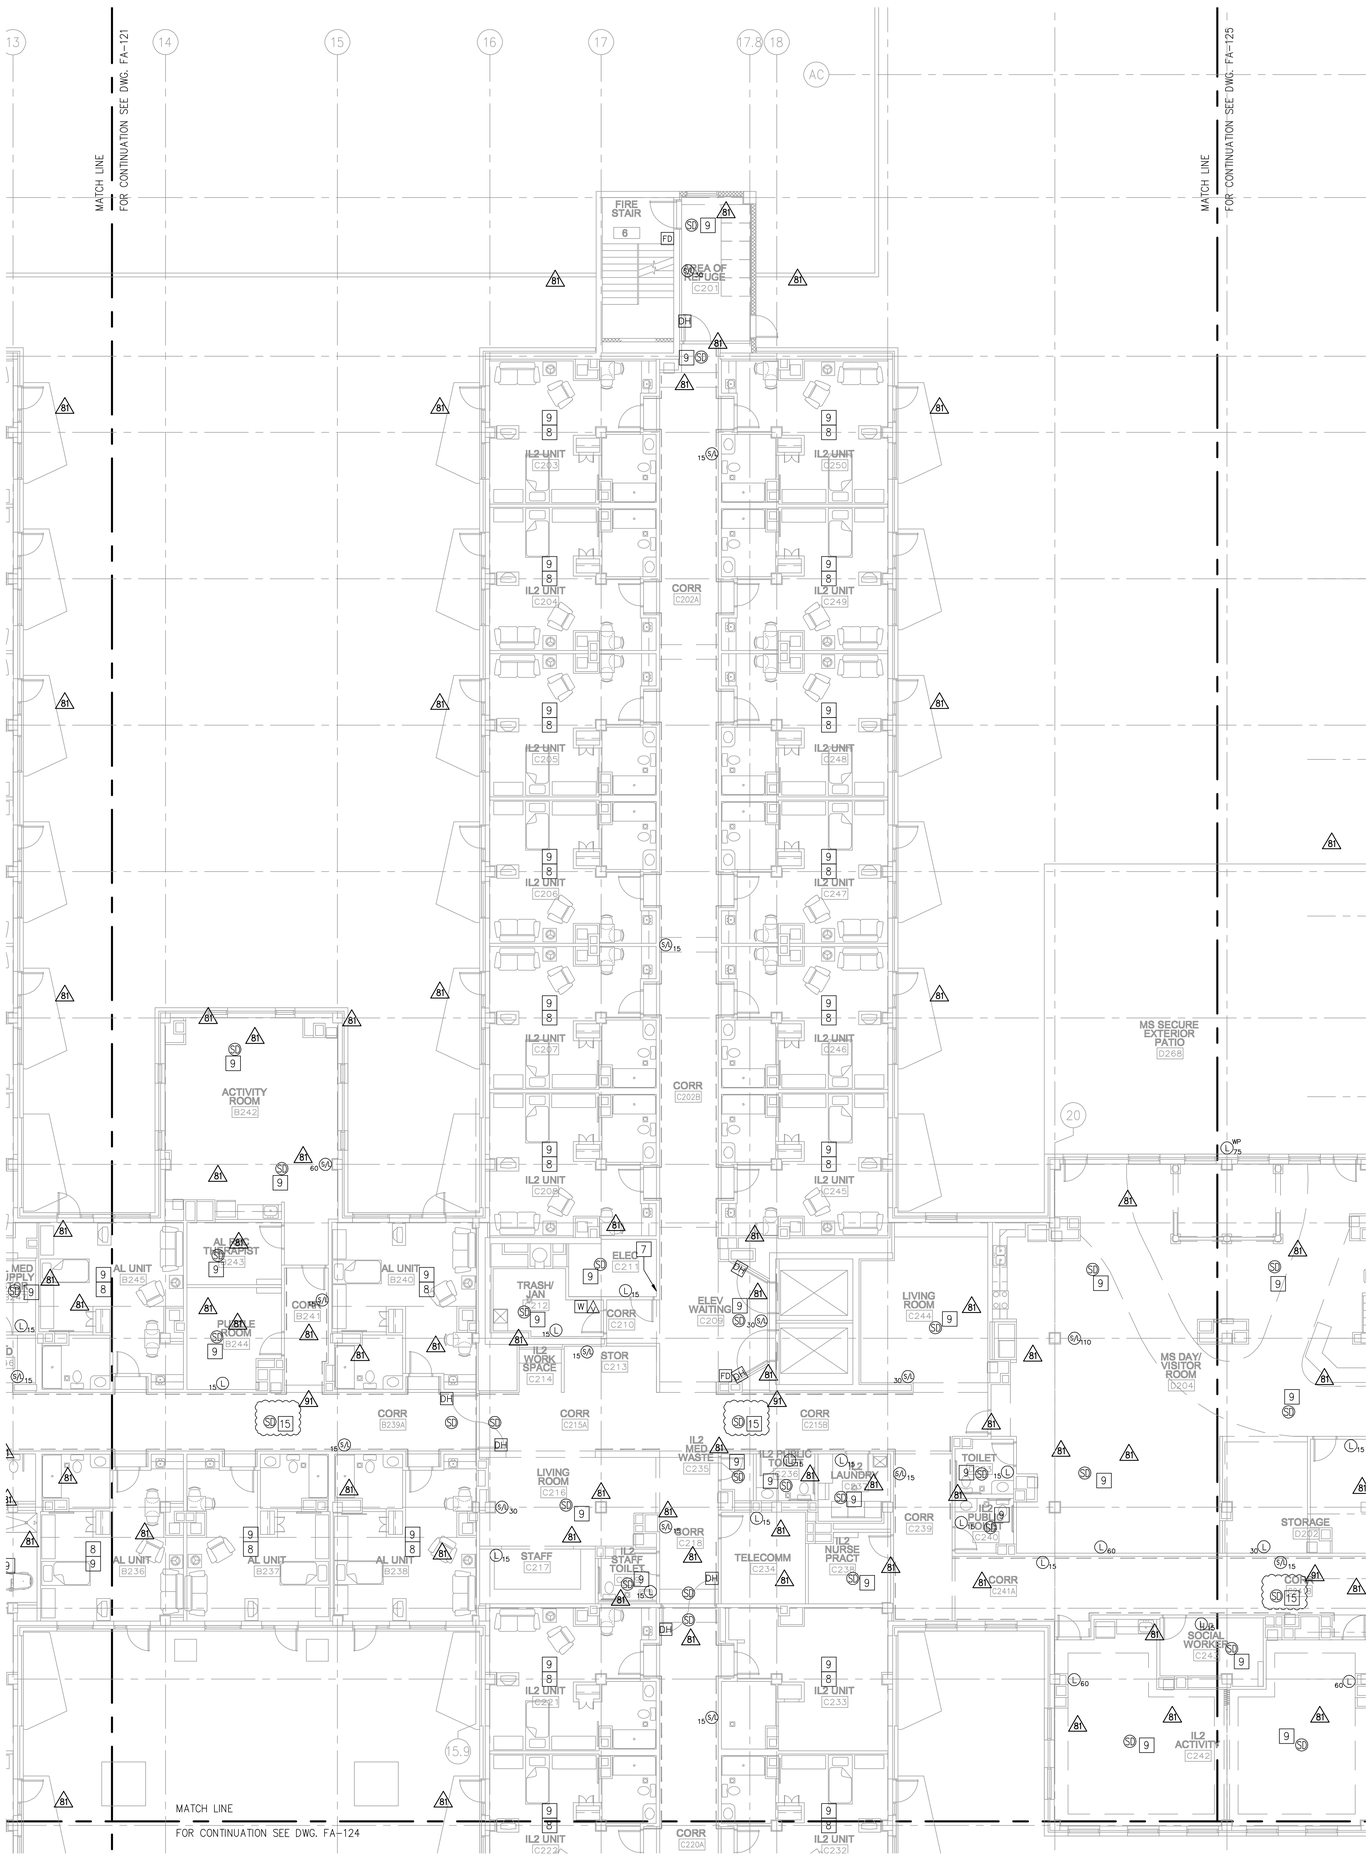

1 FA123/FA123 1/8"=1'-0"

PARTIAL SECOND FLOOR - AREA 3 - FIRE ALARM

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

14 ACTIVATION OF SMOKE DUCT DETECTOR SHALL CLOSE FIRE/SMOKE DAMPER SERVING THE FLOOR/CEILING ASSY DUCT PENETRATION (PER SECTION 716.3.2.1(1) OF THE 2006 IBC).

15 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ADJACENT FIRE/SMOKE DAMPER (PER SECTION 716.3.2.1(4) OF THE 2006 IBC).

CERTIFICATIONS

KEY PLAN

AREA 3
SECOND FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS
3	07/10/09	FIRE PROTECTION & SPEC REV
4	11/04/09	FIRE ALARM CHANGES

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 2ND FL PL – AREA 3 – FIRE ALARM
FILE NAME	FA-123-N0095730.DWG
FLOOR NO.	SECOND FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 23 DISCIPLINE SHEET TYPE SEQUENCE SHEET OF –

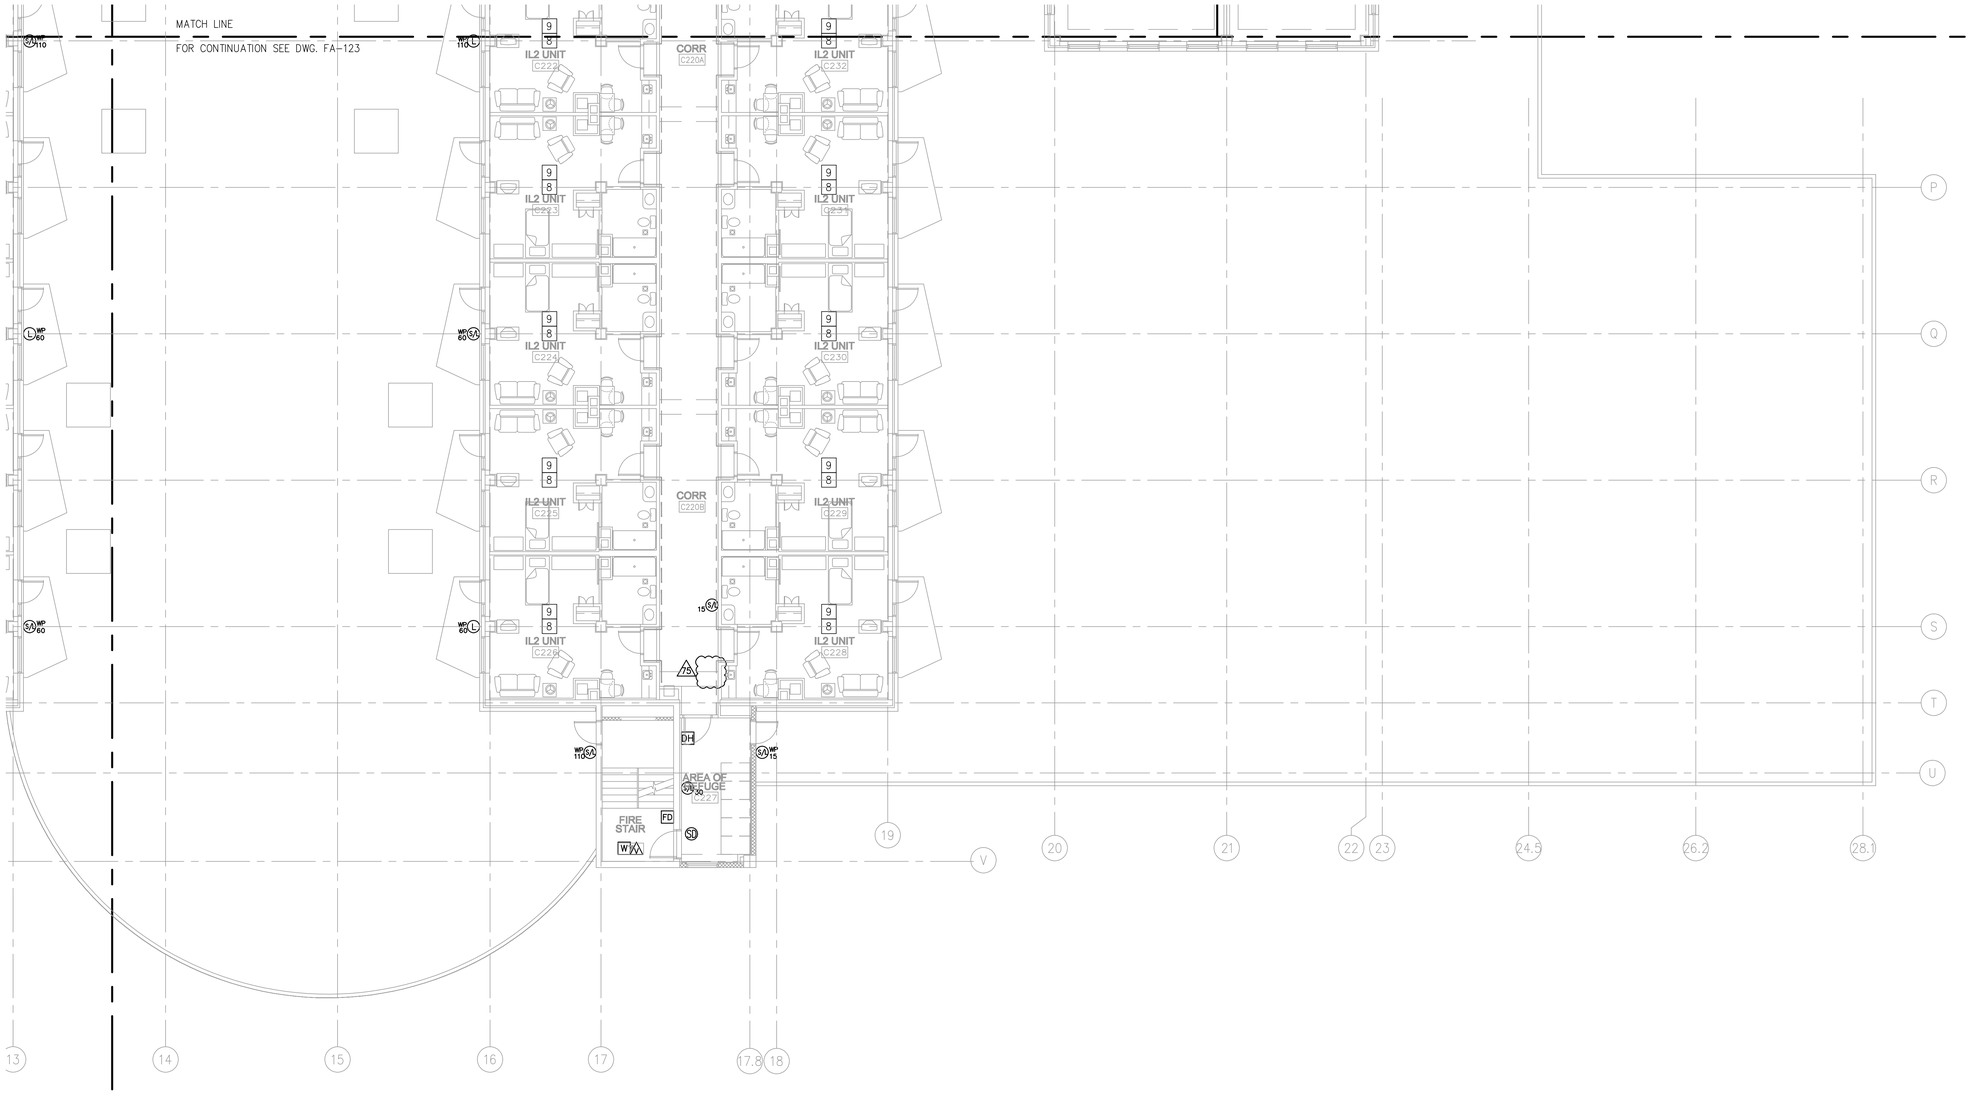

1 FA124/FA124 **PARTIAL SECOND FLOOR - AREA 4 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

CERTIFICATIONS

SHANE HATAMACH — LICENSED PROFESSIONAL ENGINEER — ENGINEER — 16355 — STATE OF MISSISSIPPI — 2009.04.17

KEY PLAN

AREA 4
SECOND FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 2ND FLR PL – AREA 4 – FIRE ALARM
FILE NAME	FA-124-N0095730.DWG
FLOOR NO.	SECOND FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 24 DISCIPLINE SHEET TYPE SEQUENCE SHEET OF –

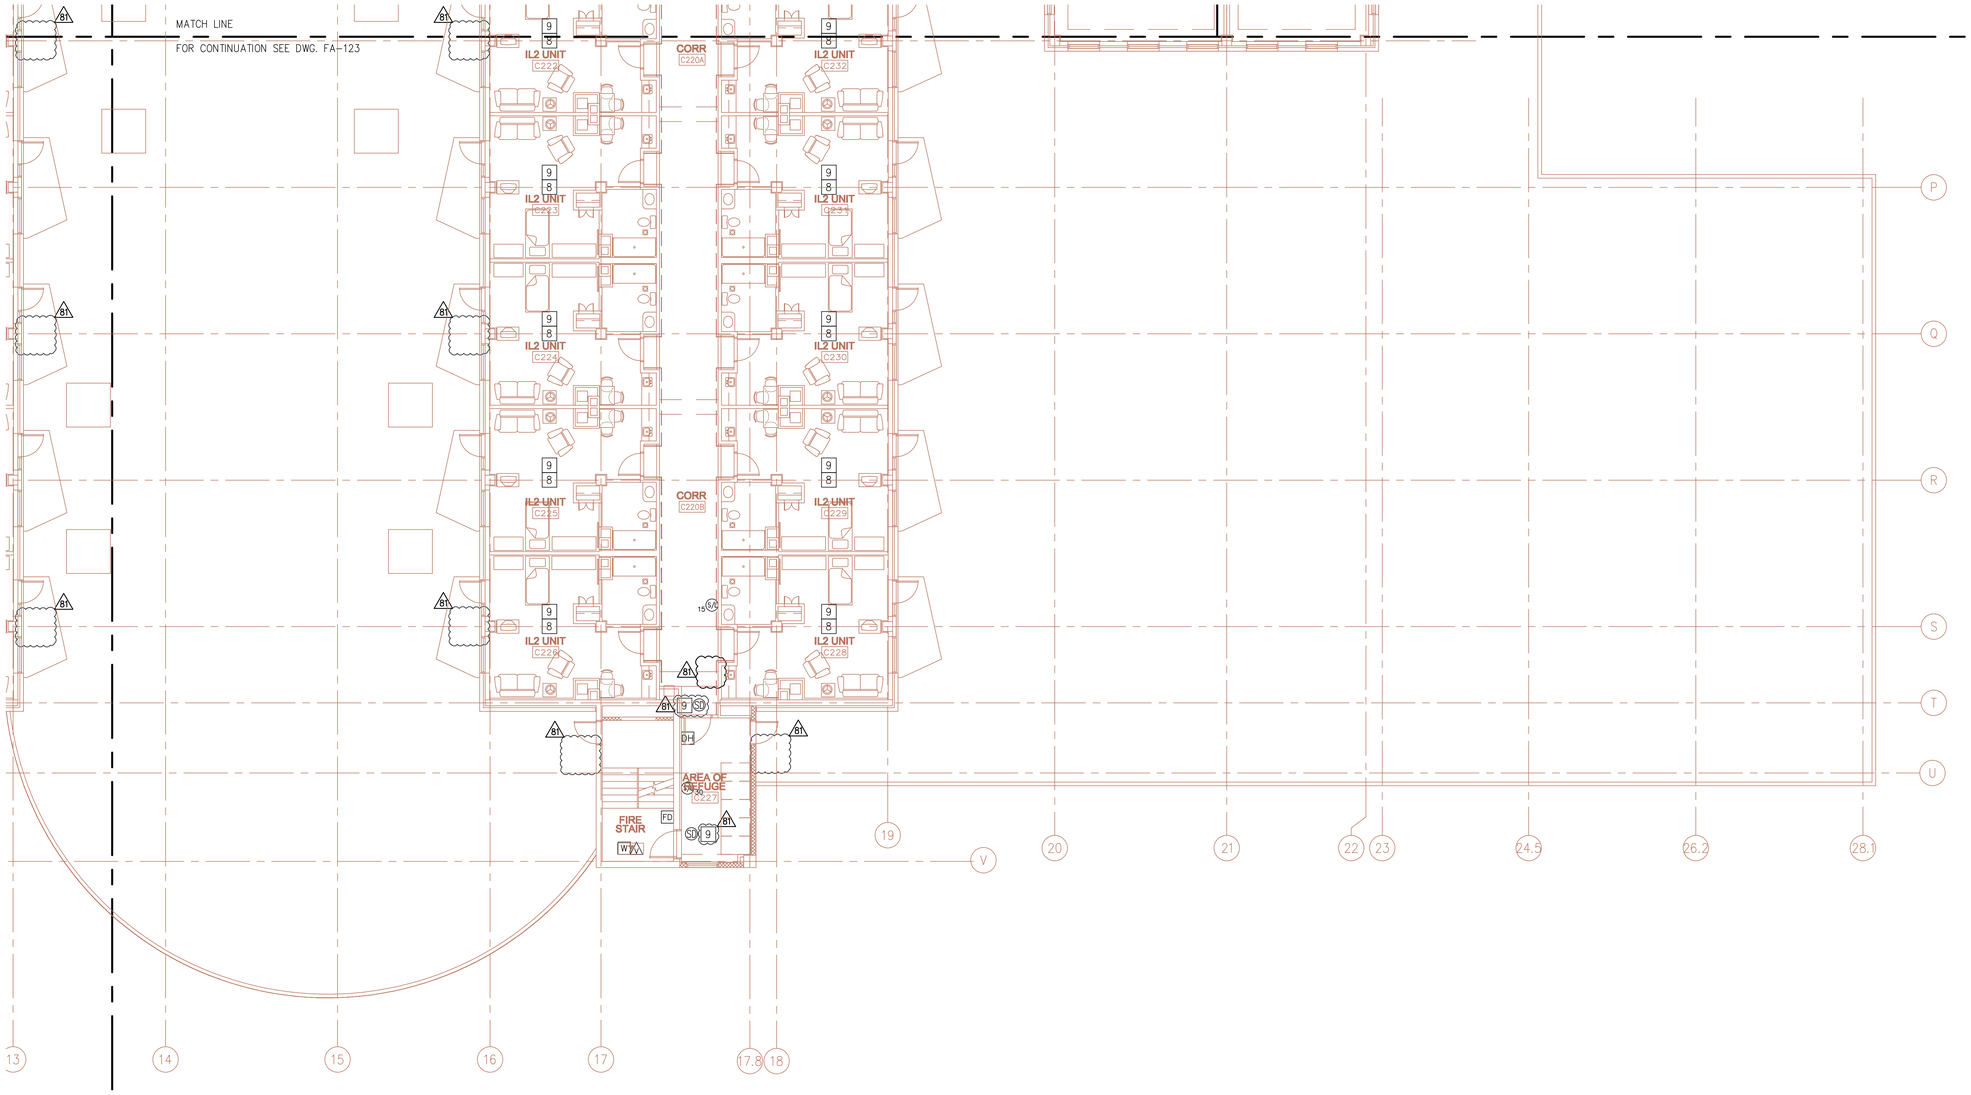

1 FA124/FA124 **PARTIAL SECOND FLOOR - AREA 4 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

CERTIFICATIONS

SHANE HATHORN 7/10/09 ENGINEER 16355 STATE OF MISSISSIPPI

KEY PLAN



AREA 4
SECOND FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS
3	07/10/09	FIRE PROTECTION & SPEC REV

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 2ND FLR PL – AREA 4 – FIRE ALARM
FILE NAME	FA-124-N0095730.DWG
FLOOR NO.	SECOND FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 24 DISCIPLINE SHEET TYPE SEQUENCE SHEET OF –

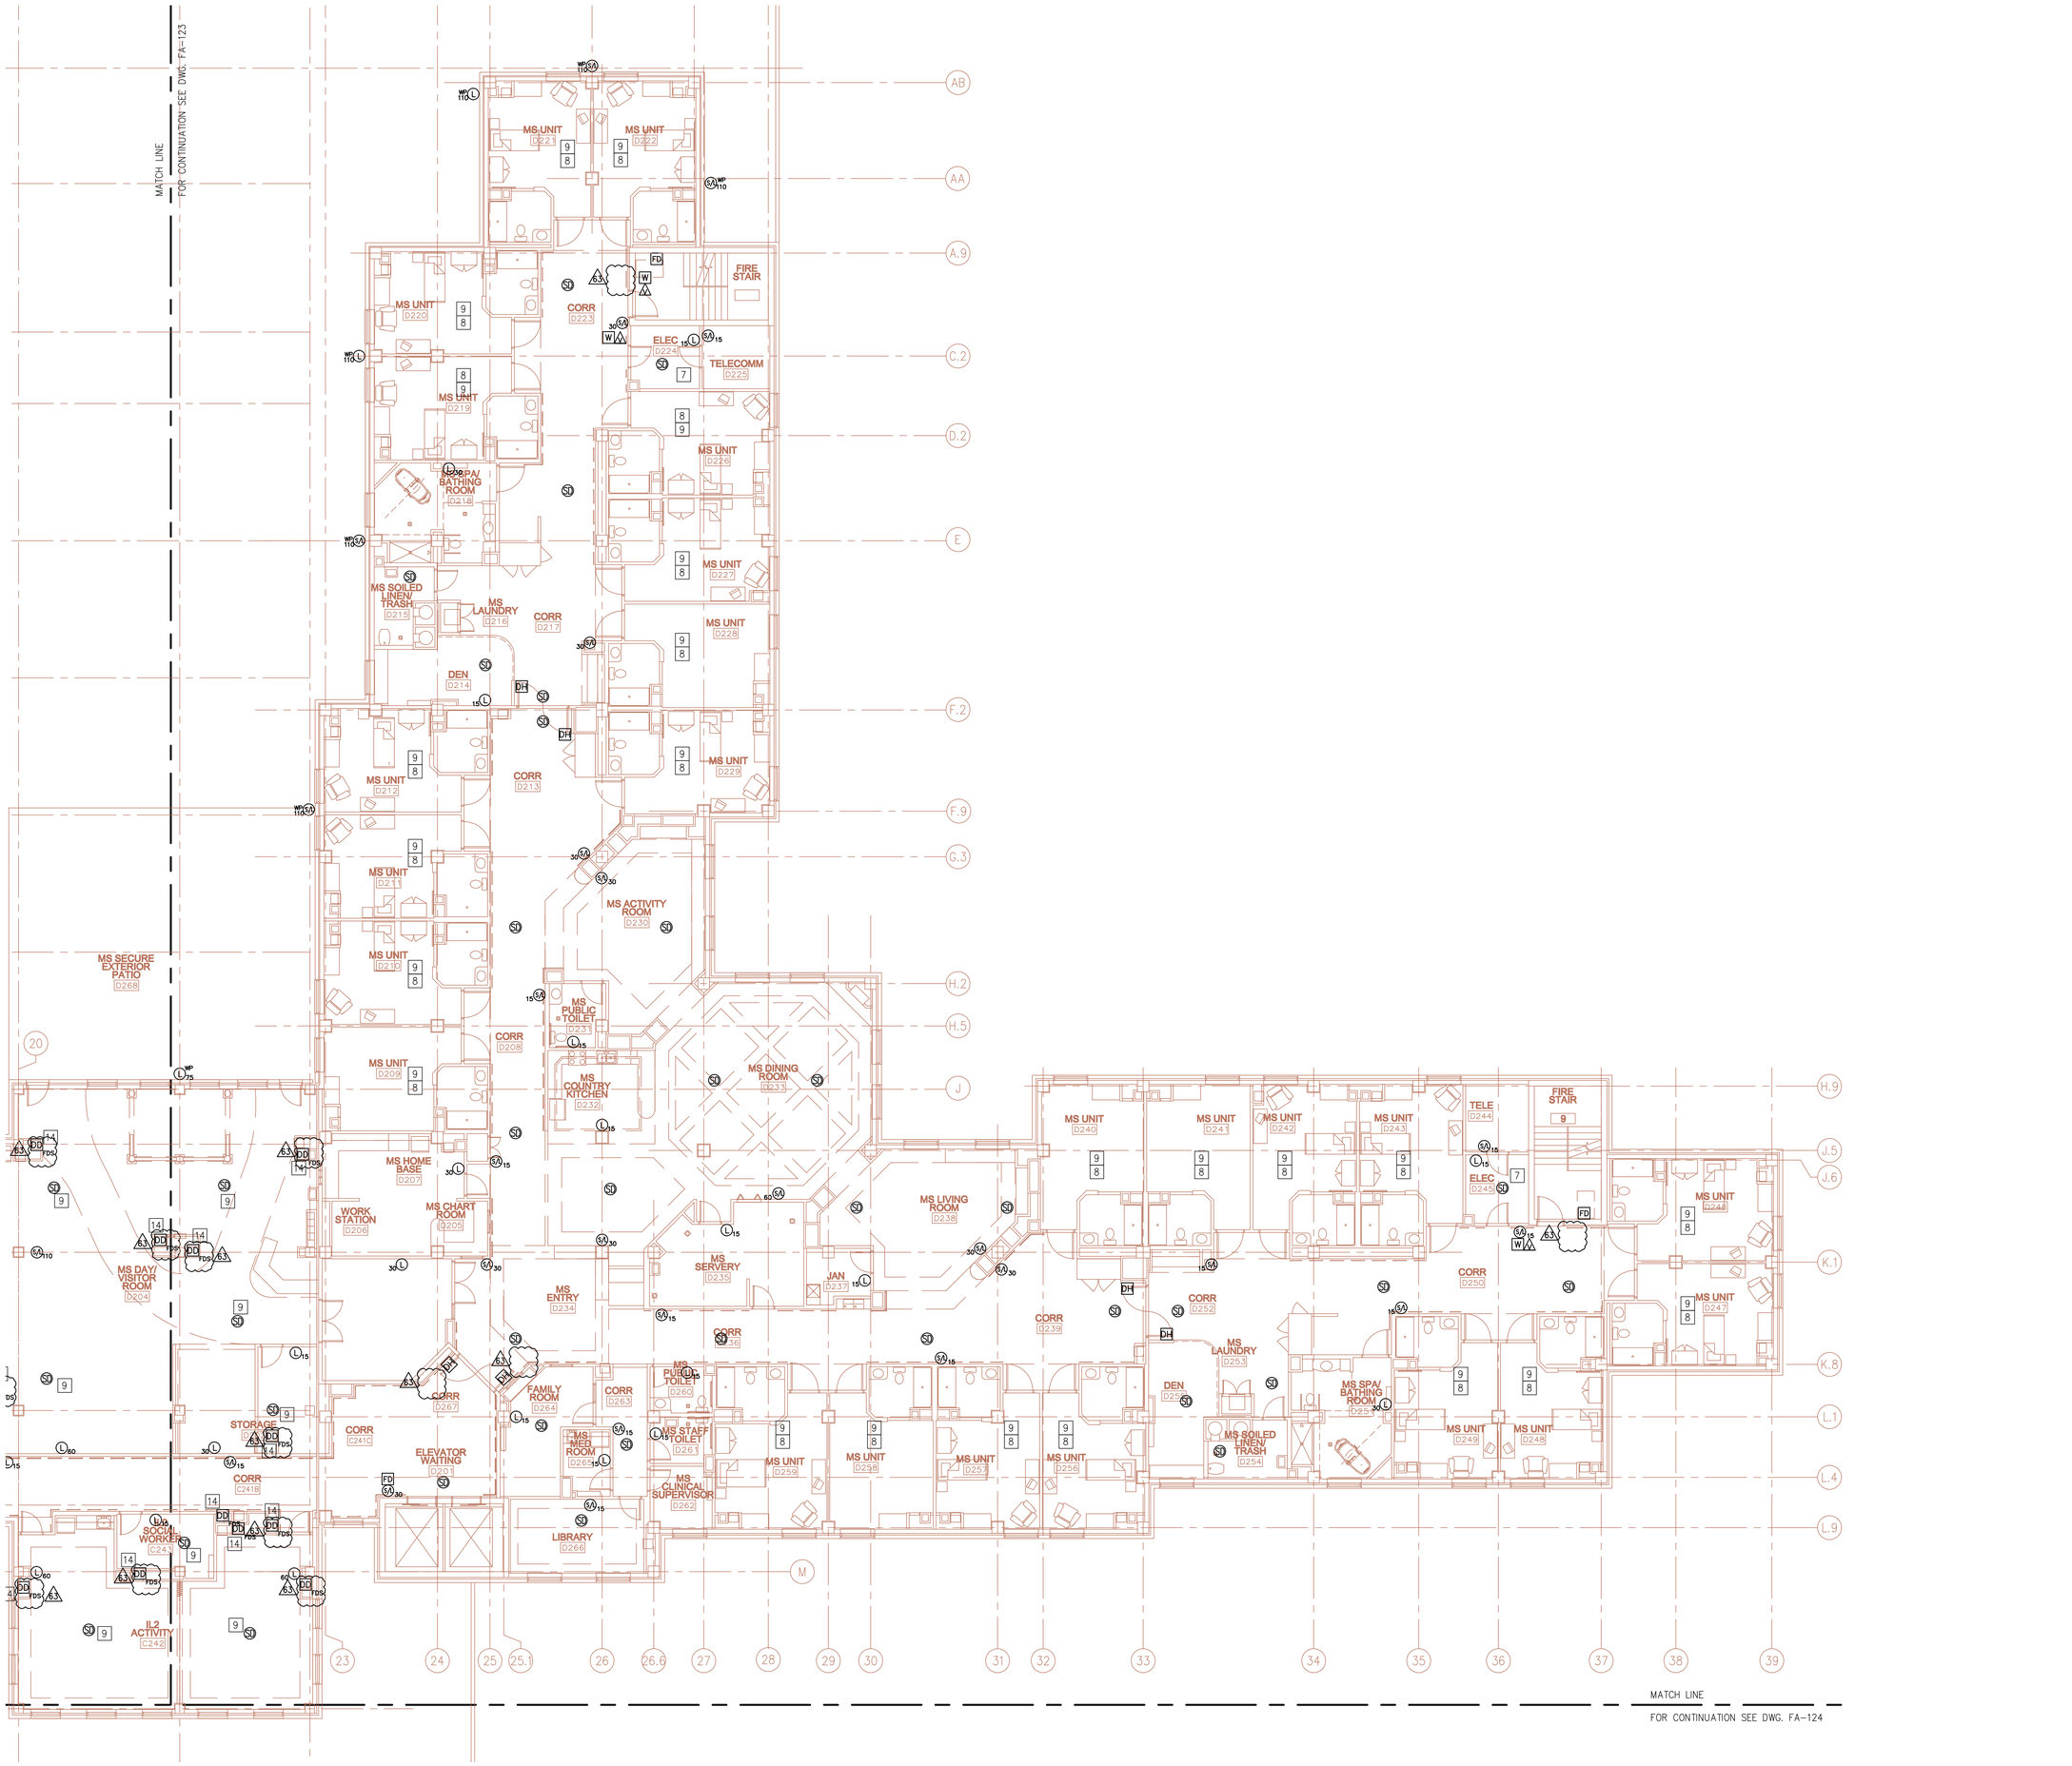

1 FA125/FA125 **PARTIAL SECOND FLOOR - AREA 5 - FIRE ALARM** 1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

63 ACTIVATION OF SMOKE DUCT DETECTOR SHALL CLOSE FIRE/SMOKE DAMPER SERVING THE FLOOR/CEILING ASSY DUCT PENETRATION (PER SECTION 716.3.2.1(1) OF THE 2006 IBC).

CERTIFICATIONS

DUANE HATTAWAY — ENGINEER — 16355 — STATE OF MISSISSIPPI — 2009.04.17

KEY PLAN

AREA 5
SECOND FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 2ND FL PL – AREA 5 – FIRE ALARM
FILE NAME	FA-125-N0095730.DWG
FLOOR NO.	SECOND FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 25
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

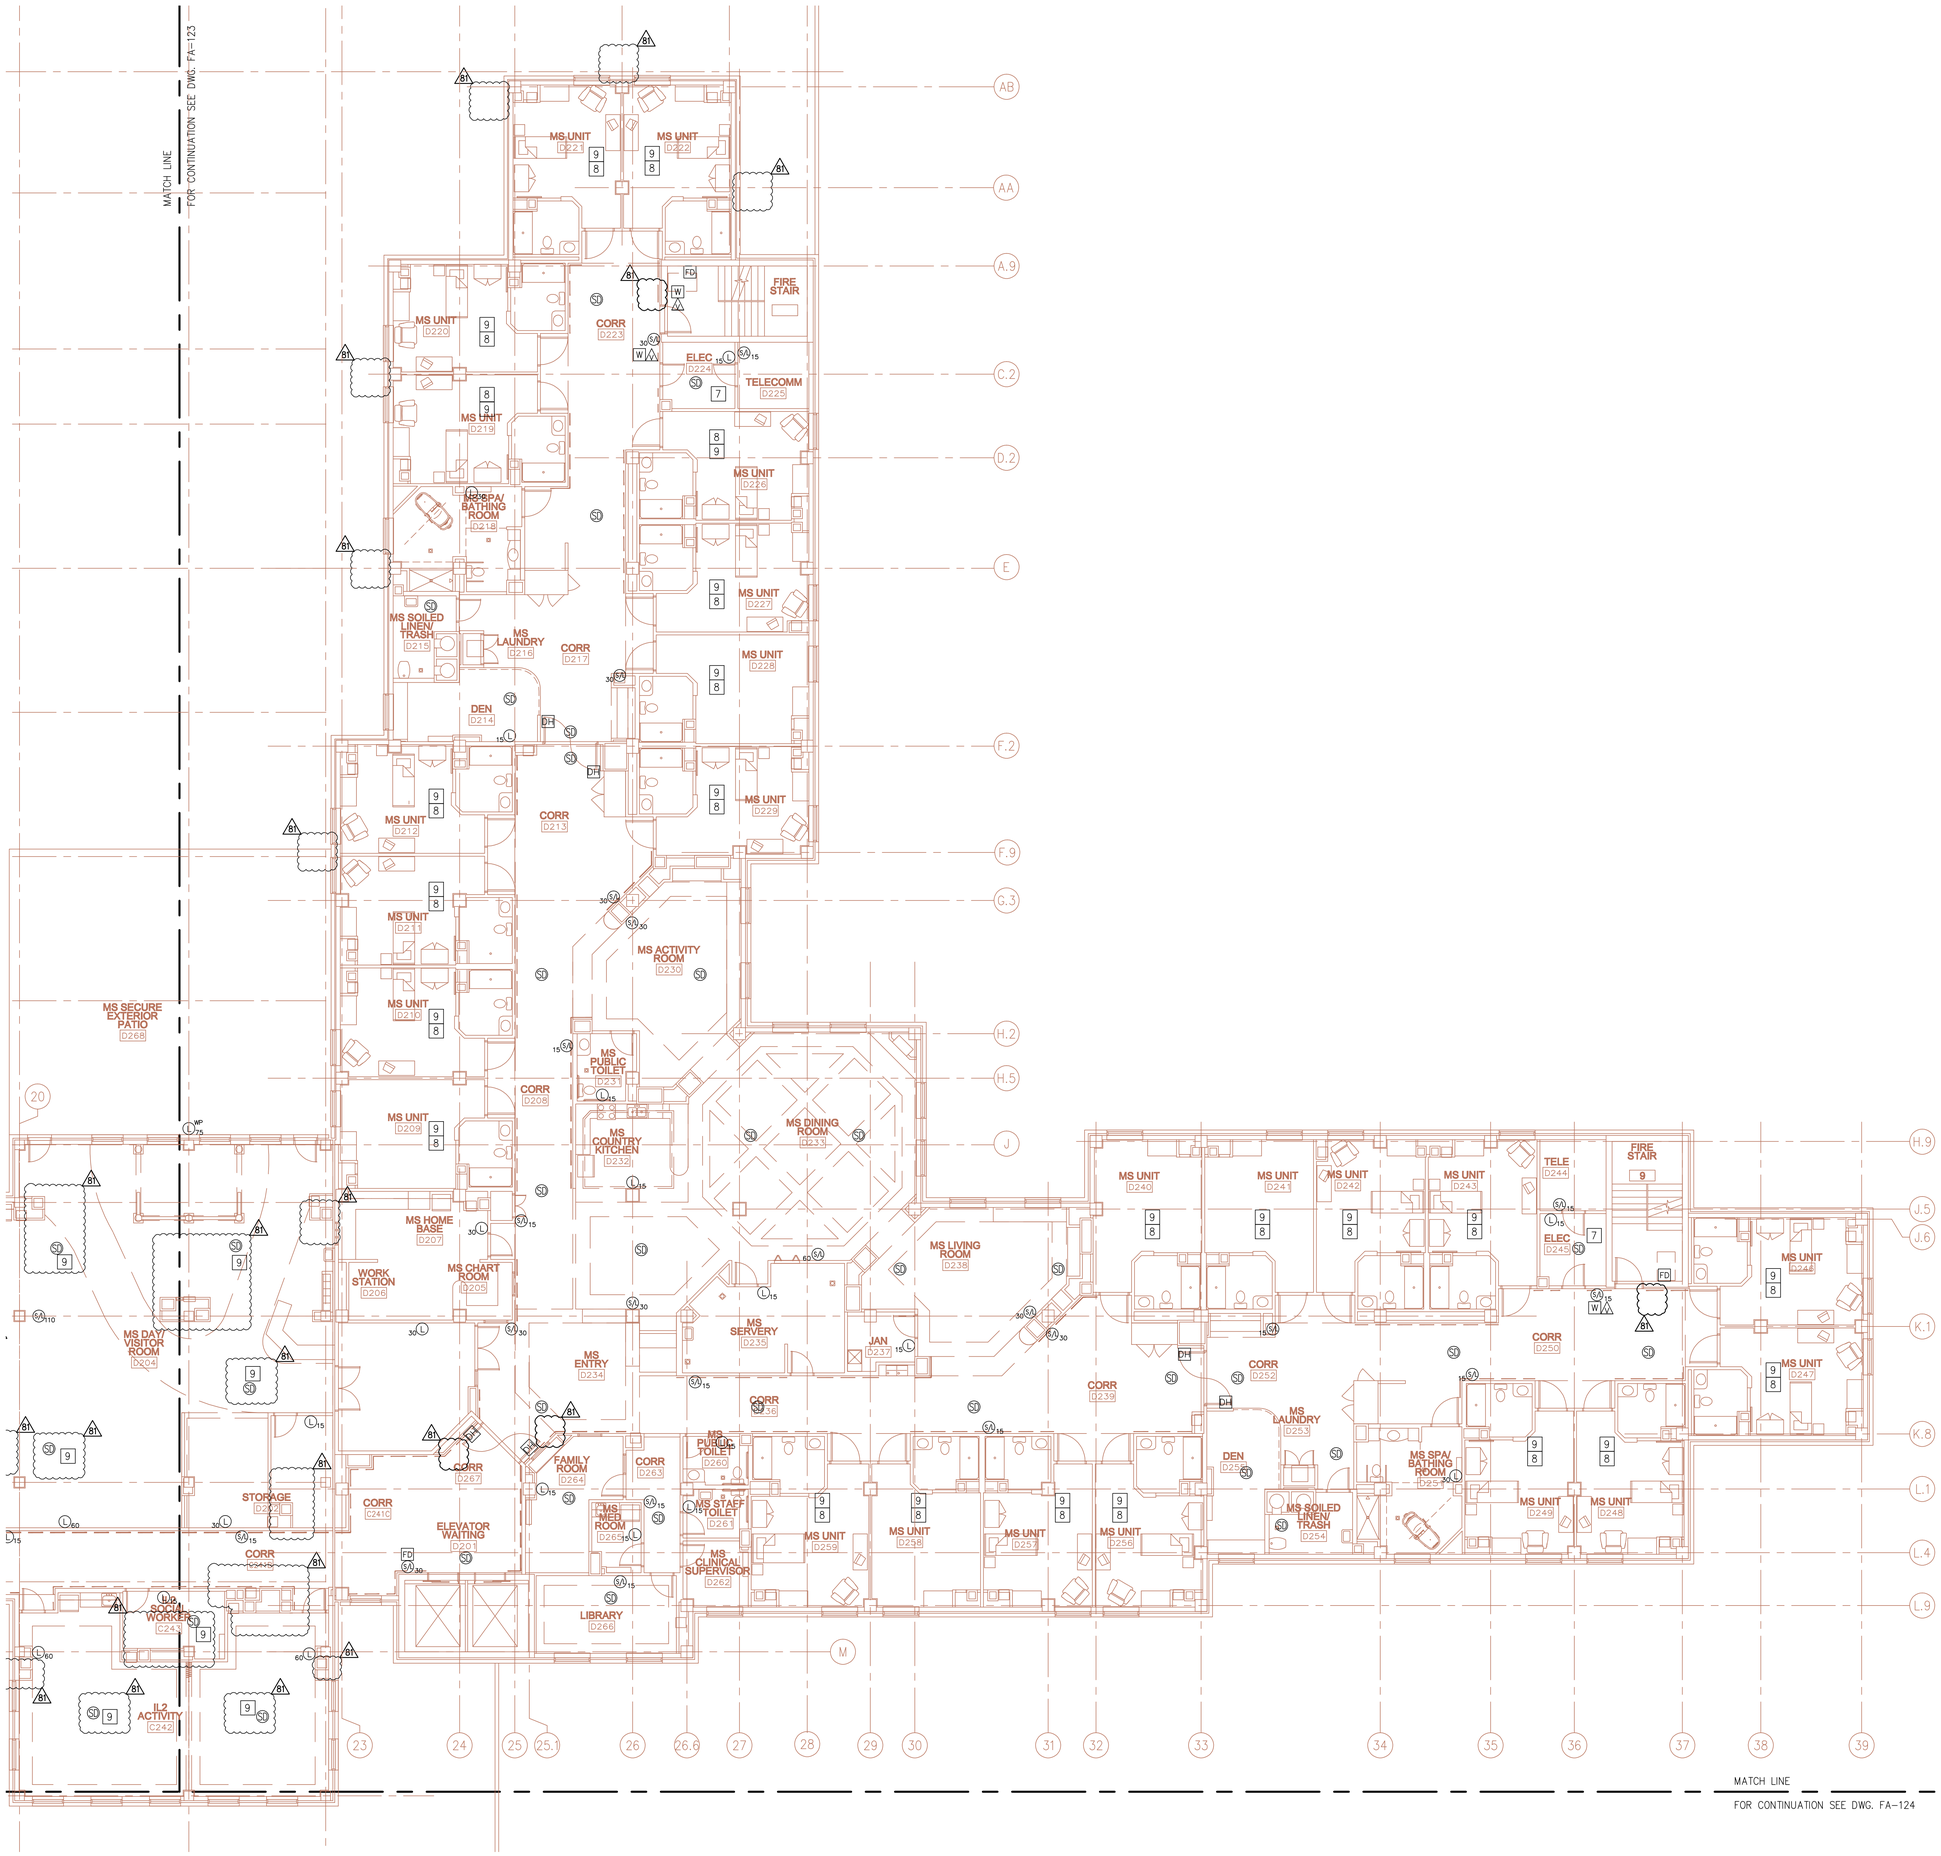

1 FA125 FA125 **PARTIAL SECOND FLOOR - AREA 5 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

B1 ACTIVATION OF SMOKE DUCT DETECTOR SHALL CLOSE FIRE/SMOKE DAMPER SERVING THE FLOOR/CEILING ASSY DUCT PENETRATION (PER SECTION 716.3.2.1(1) OF THE 2006 IBC).

CERTIFICATIONS

7/10/09

KEY PLAN

AREA 5
SECOND FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS
3	07/10/09	FIRE PROTECTION & SPEC REV

GRAPHIC SCALE



1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 2ND FL PL – AREA 5 – FIRE ALARM
FILE NAME	FA-125-N0095730.DWG
FLOOR NO.	SECOND FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 25
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

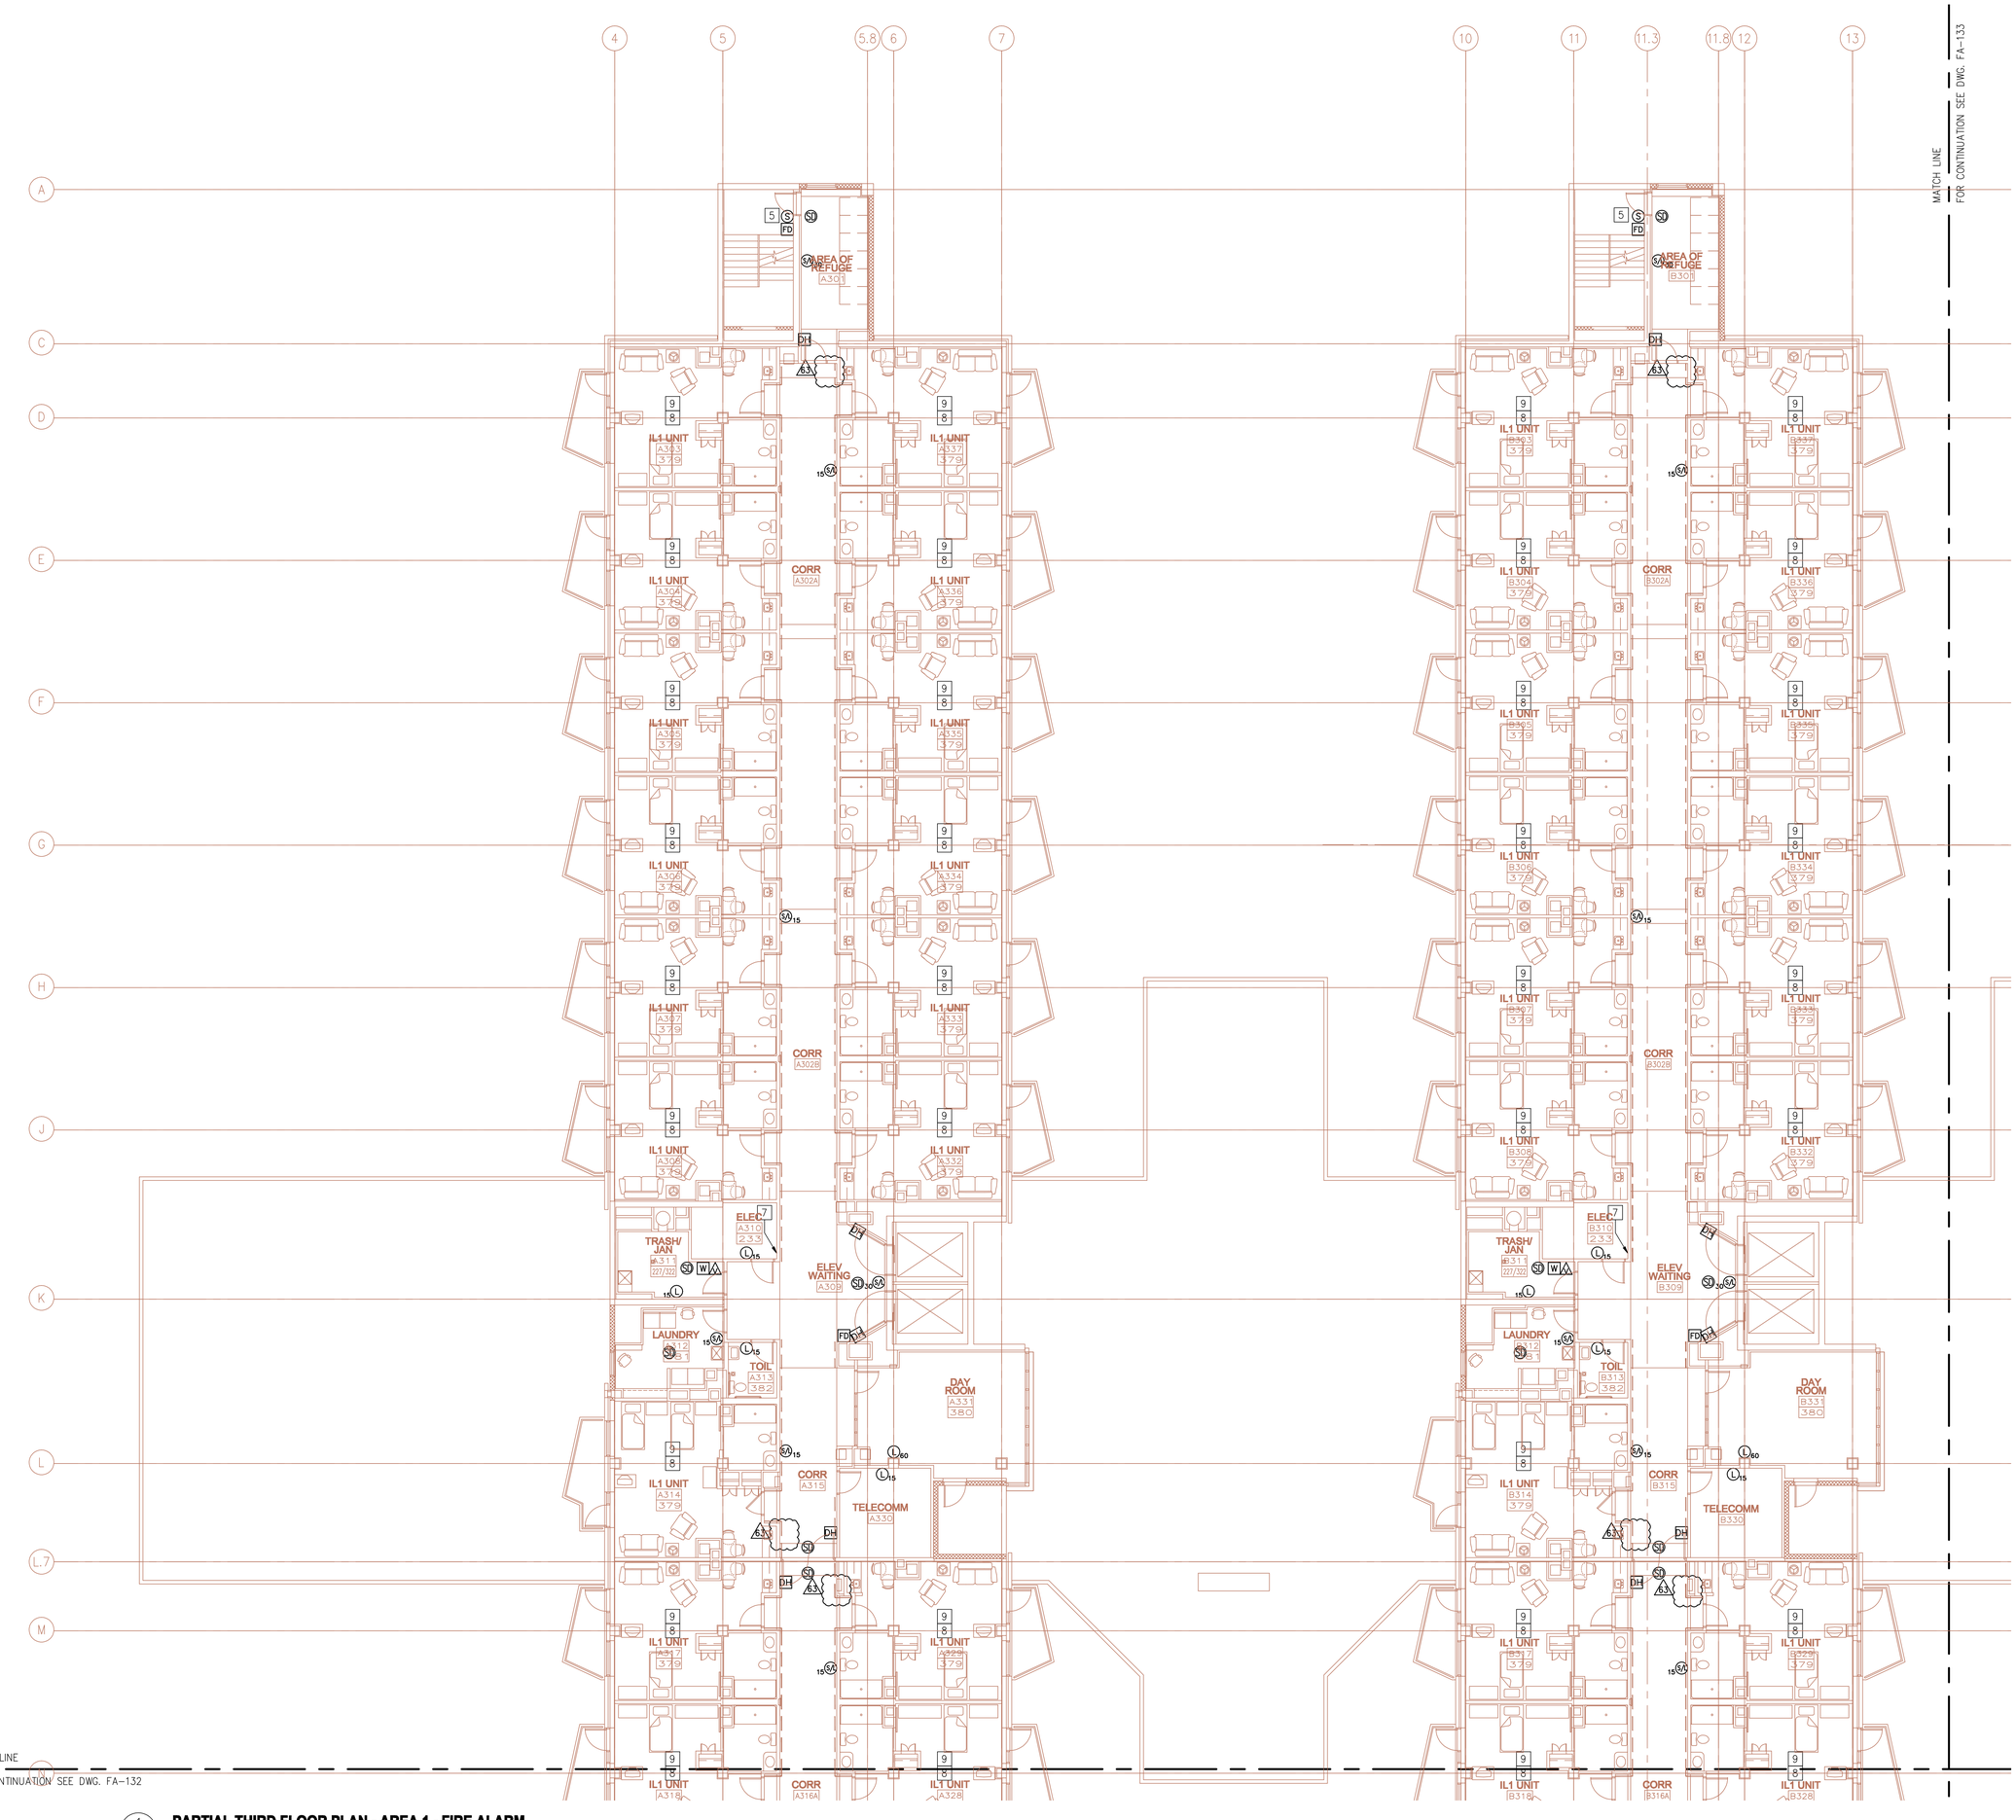

1 FA131|FA131 **PARTIAL THIRD FLOOR PLAN - AREA 1 - FIRE ALARM**

1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

CERTIFICATIONS

DWANE HATHORN — Registered — ENGINEER — 16355 — STATE OF MISSISSIPPI — Issued 2009.04.17

KEY PLAN

AREA 1
THIRD FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 3RD FL PL – AREA 1 – FIRE ALARM
FILE NAME	FA-131-N0095730.DWG
FLOOR NO.	THIRD FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 31 DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

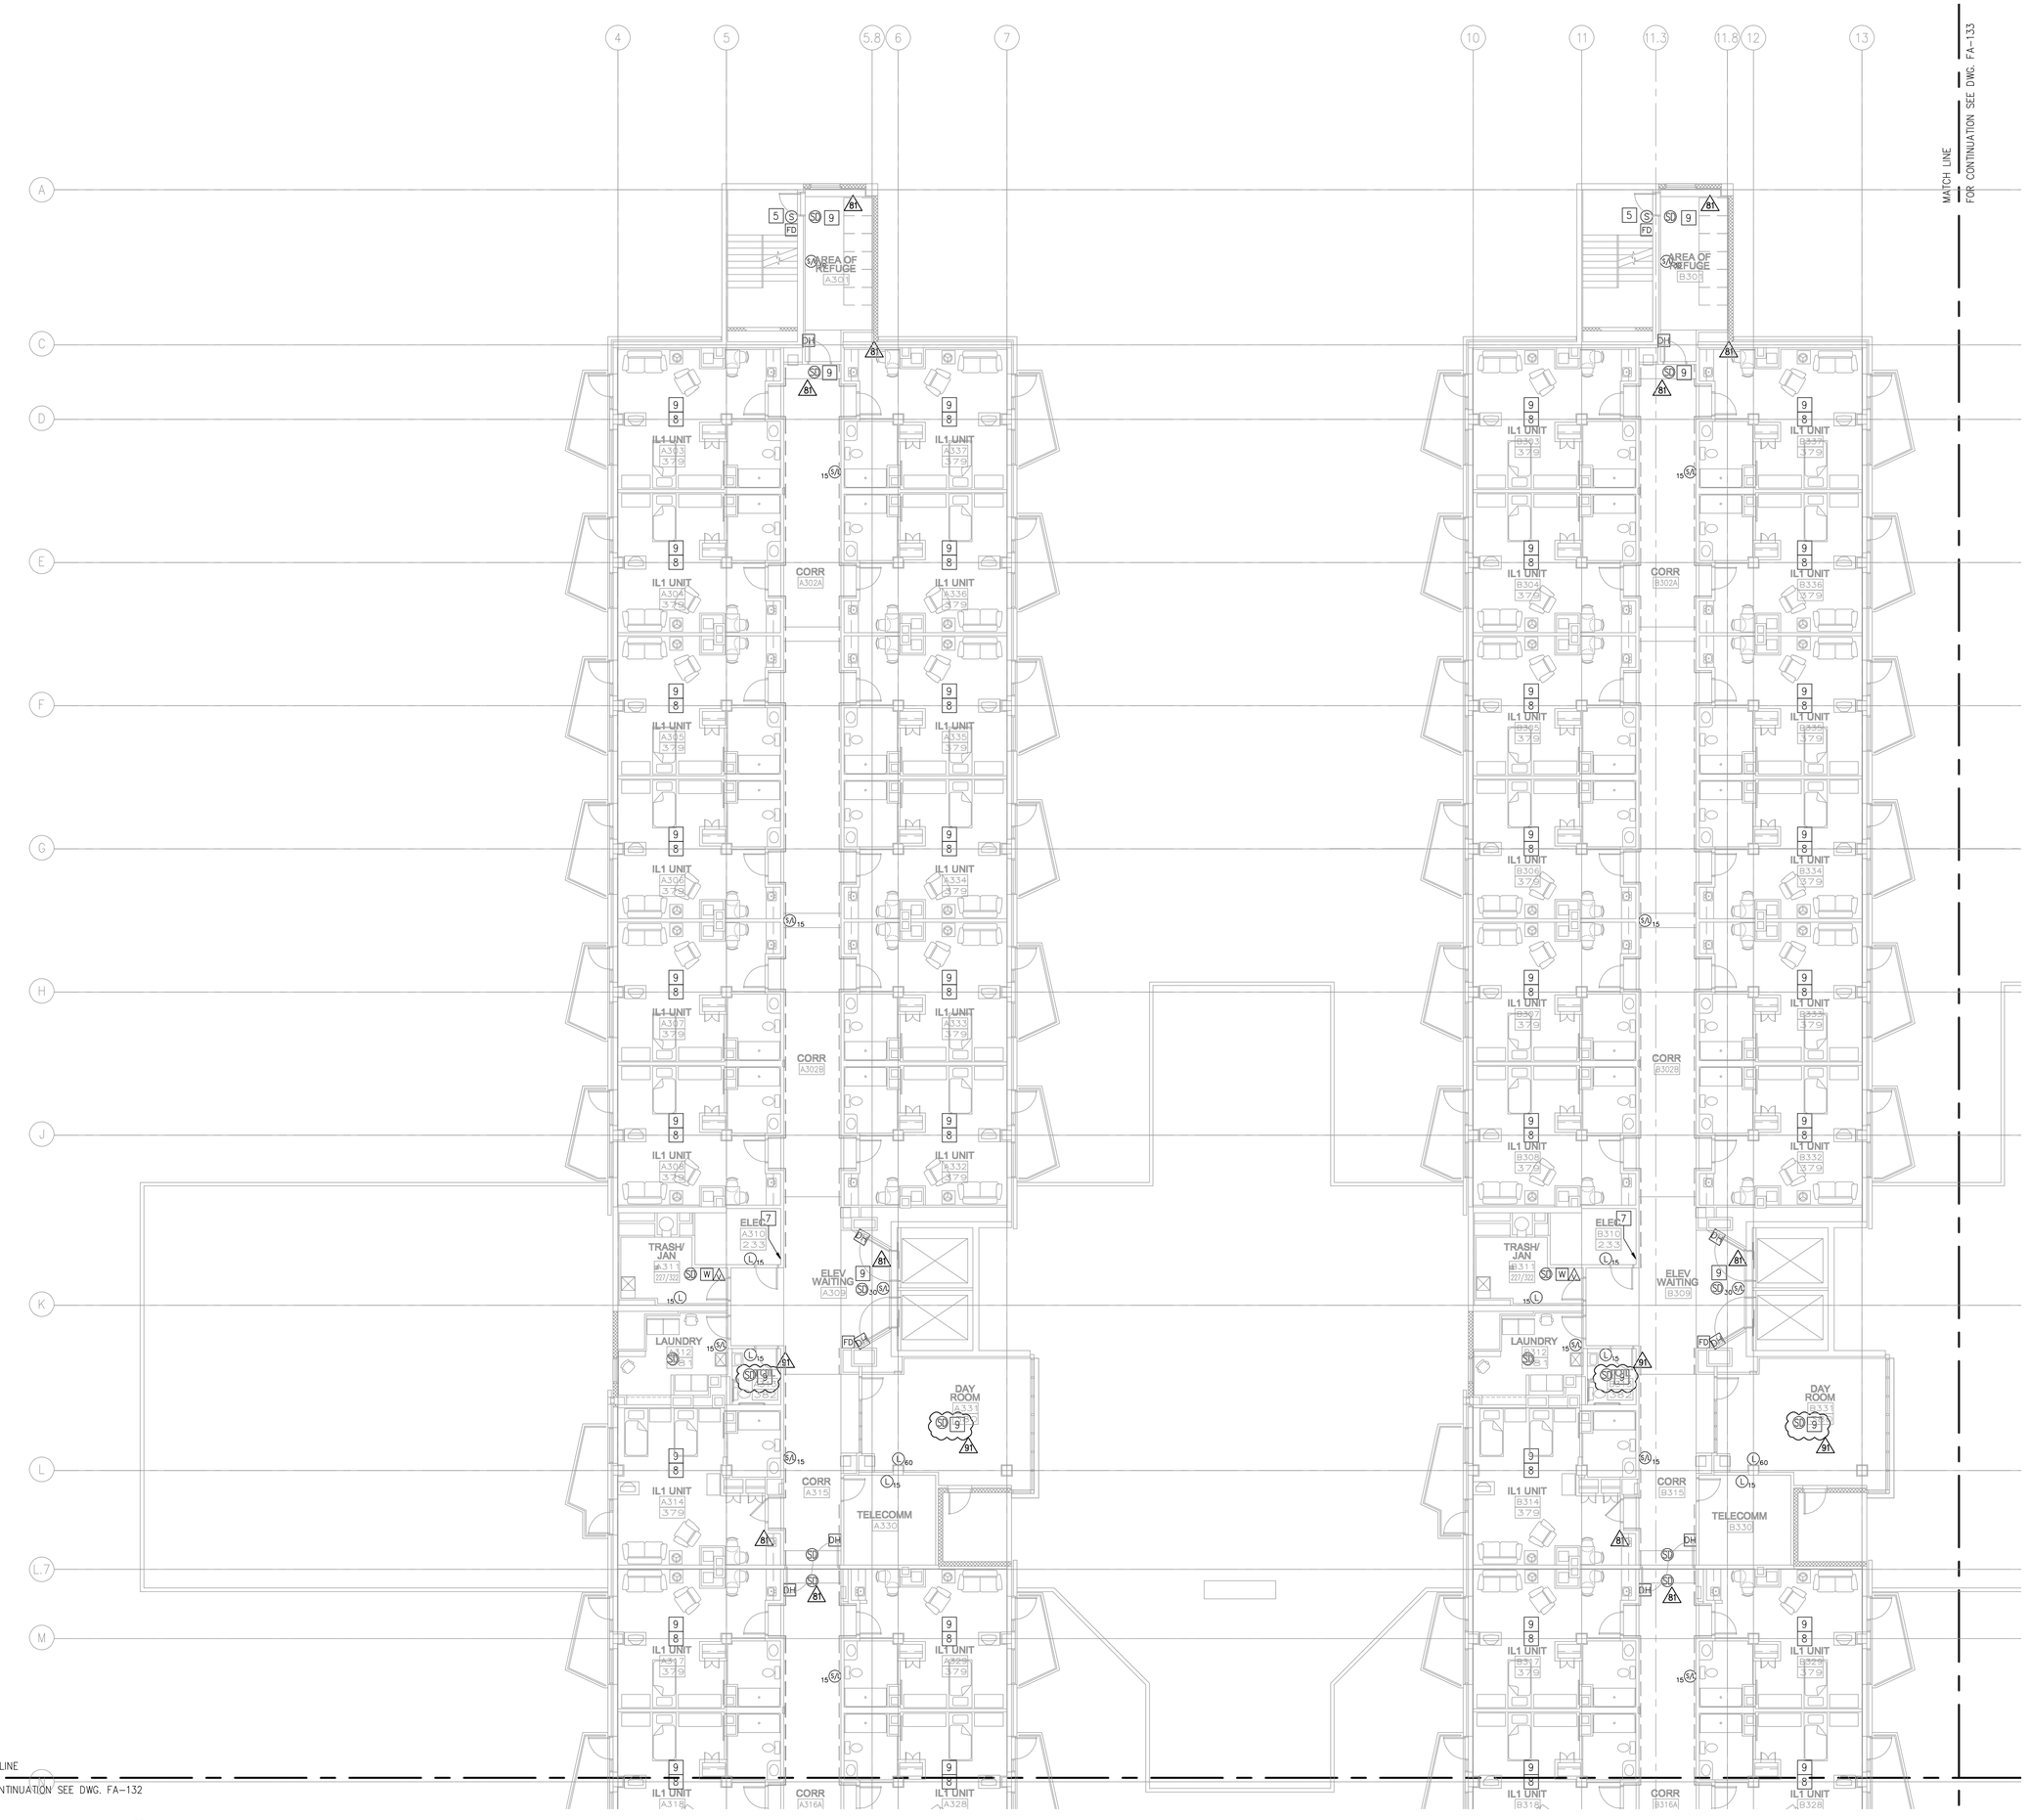

1 FA1.31 | FA1.31 **PARTIAL THIRD FLOOR PLAN - AREA 1 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

CERTIFICATIONS

MARK THOMAS MAGEE 11/4/09
CERTIFICATE OF AUTHORIZATION
ENGINEER
16355
STATE OF MISSISSIPPI

KEY PLAN



AREA 1
THIRD FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS
3	07/10/09	FIRE PROTECTION & SPEC REV
4	11/04/09	FIRE ALARM CHANGES

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	P1 3RD FL PL – AREA 1 – FIRE ALARM
FILE NAME	FA-131-NX095730.DWG
FLOOR NO.	THIRD FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 31 DISCIPLINE SHEET TYPE SEQUENCE SHEET OF –

MATCH LINE
FOR CONTINUATION SEE DWG. FA-131

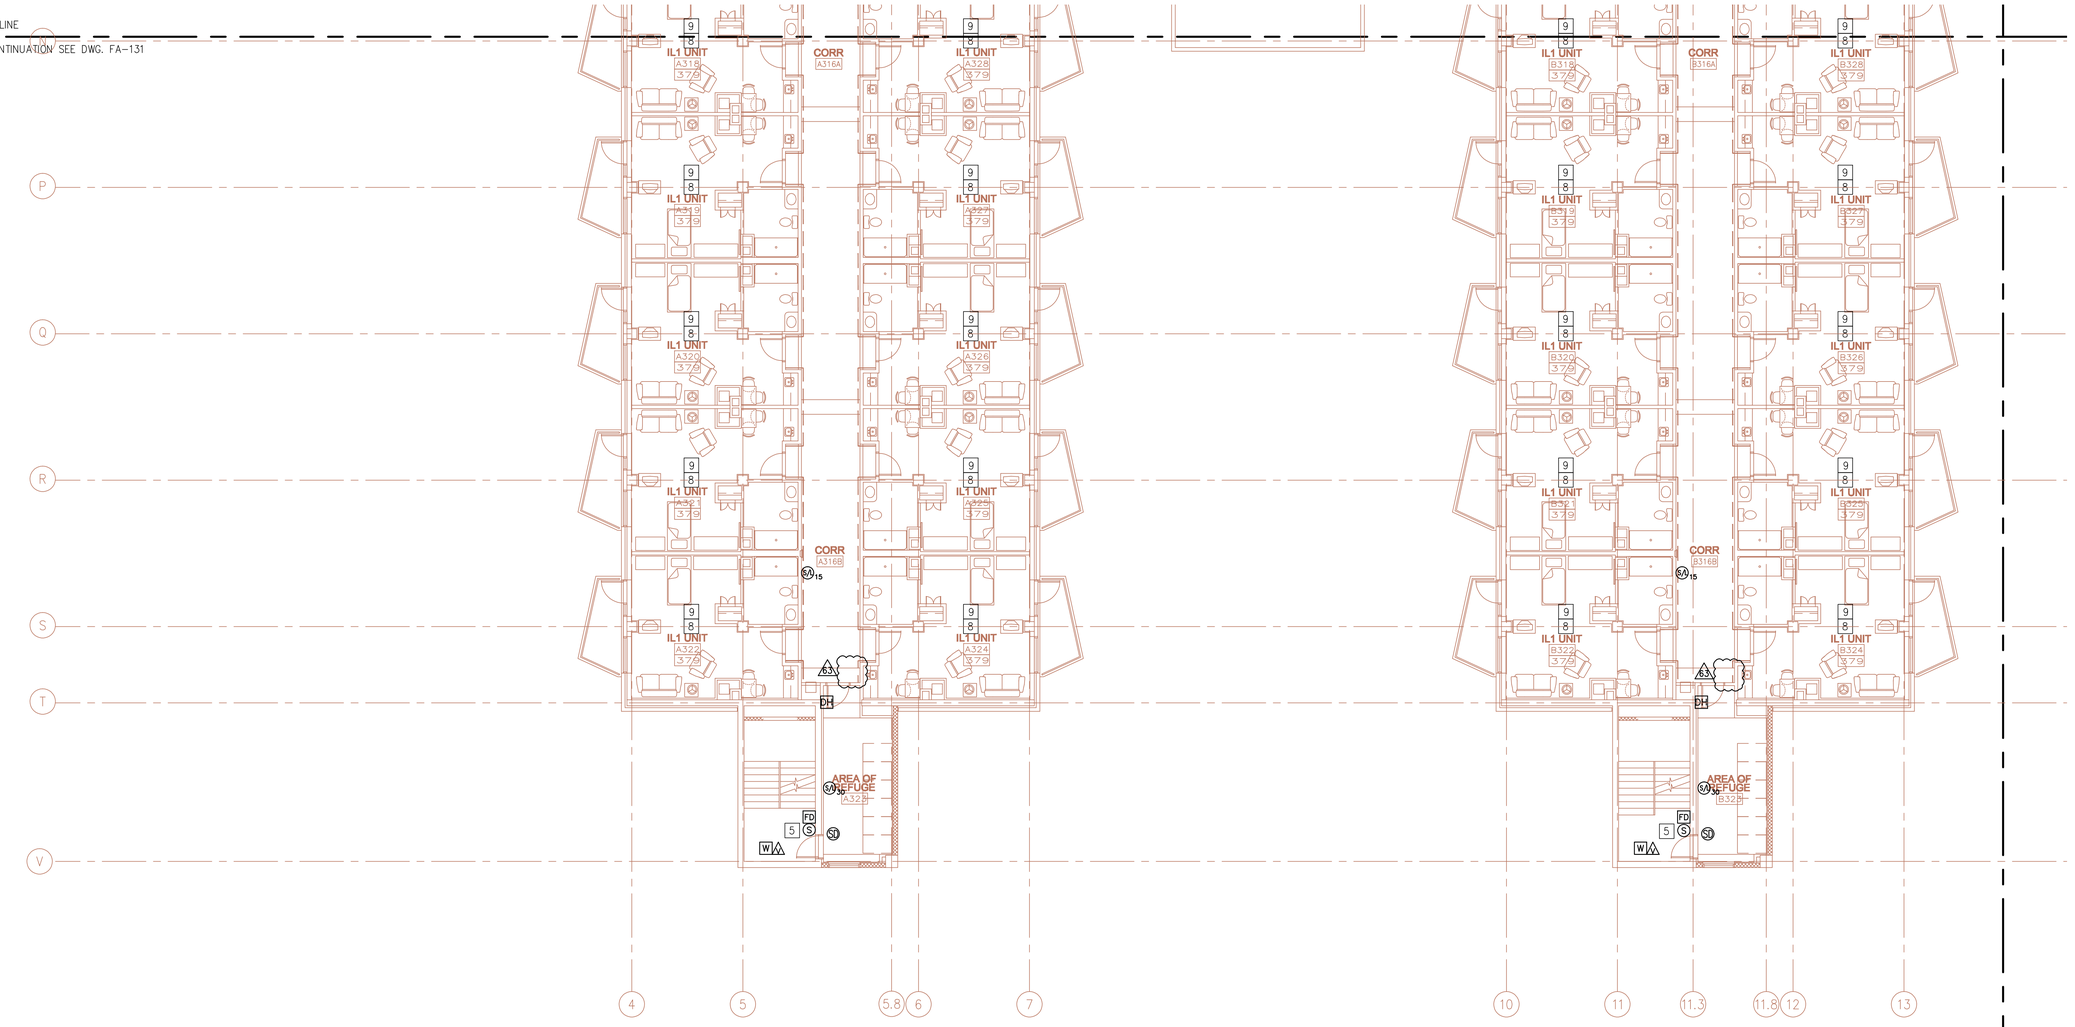

MATCH LINE
FOR CONTINUATION SEE DWG. FA-134

1 FA1.32/FA1.32 **PARTIAL THIRD FLOOR PLAN - AREA 2 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 6.3 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

CERTIFICATIONS

KEY PLAN



AREA 2
THIRD FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 3RD FL PL – AREA 2 – FIRE ALARM
FILE NAME	FA-132-N0095730.DWG
FLOOR NO.	THIRD FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 32

DISCIPLINE SHEET TYPE SEQUENCE
SHEET OF –

MATCH LINE

FOR CONTINUATION SEE DWG. FA-131

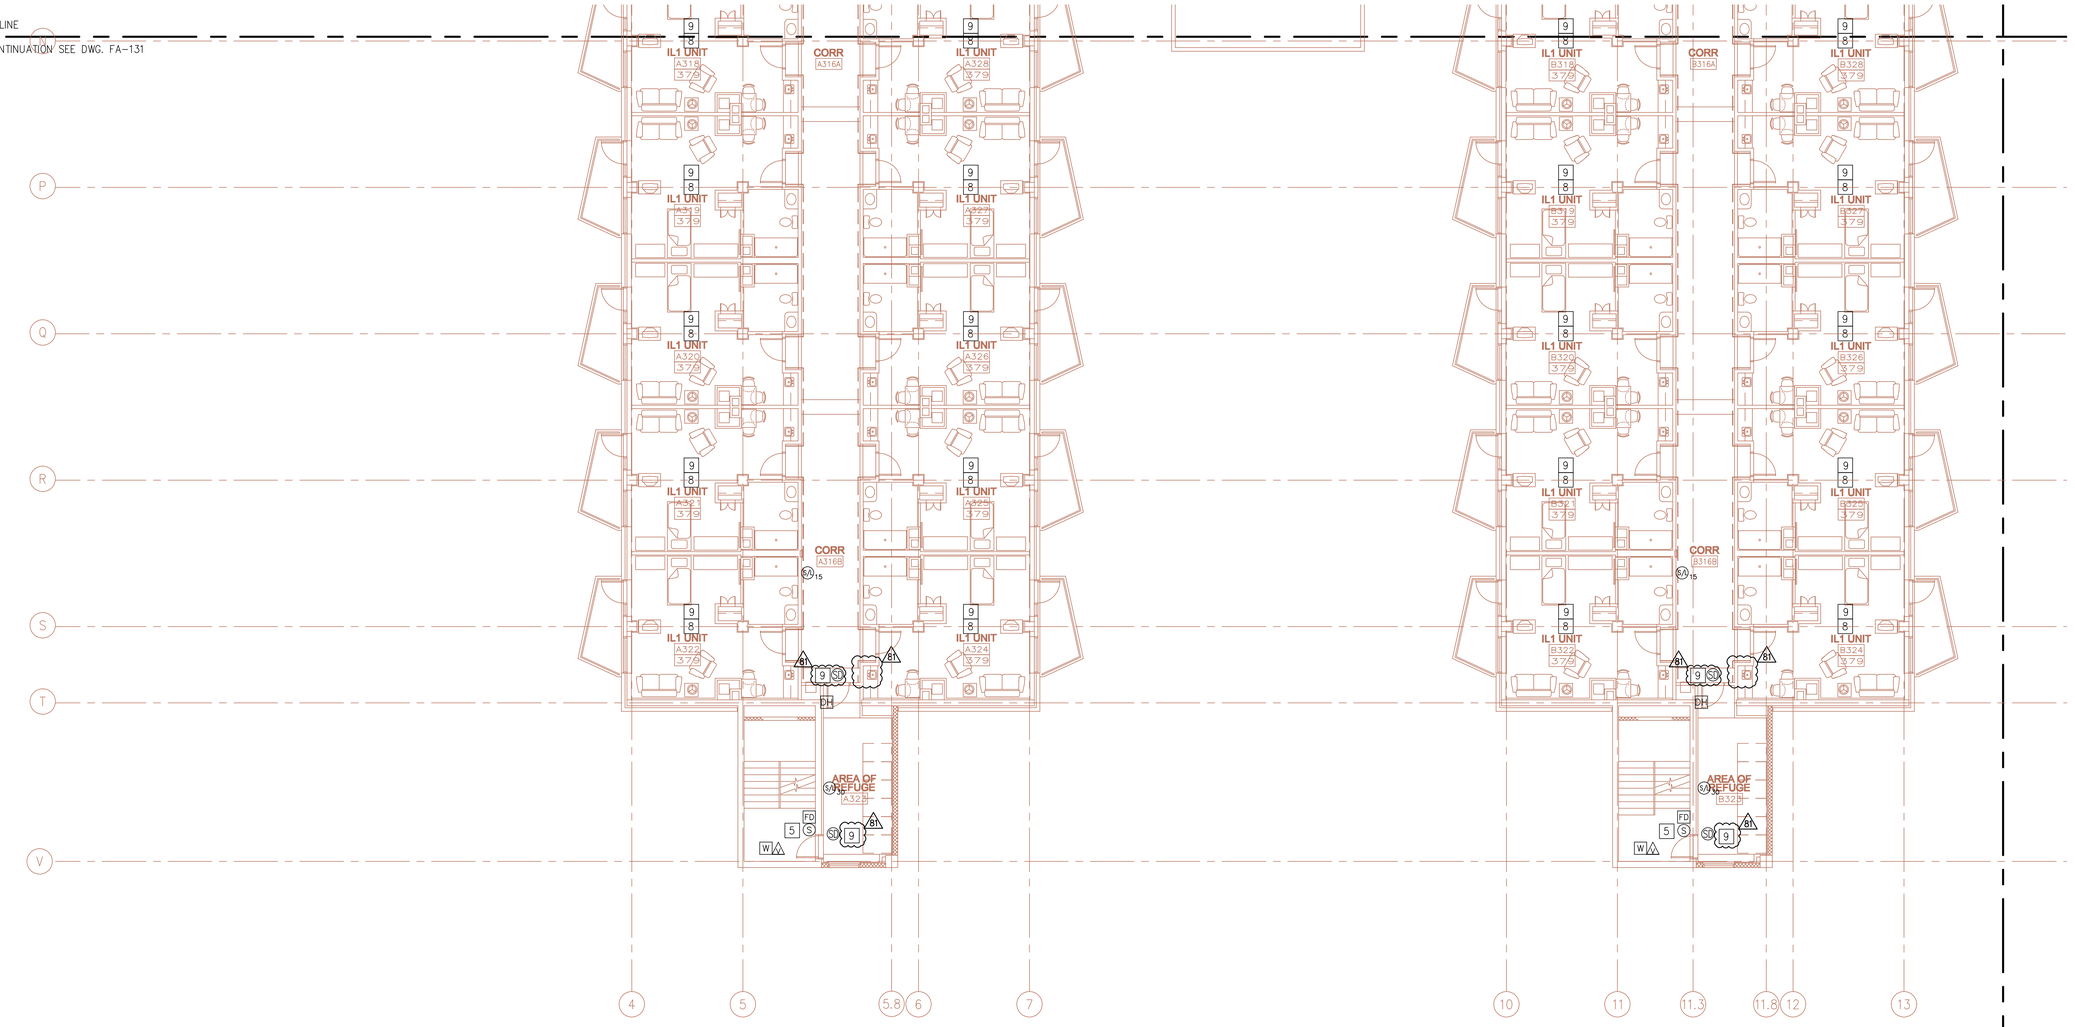

MATCH LINE

FOR CONTINUATION SEE DWG. FA-134

1 FA1.32 / FA1.32 **PARTIAL THIRD FLOOR PLAN - AREA 2 - FIRE ALARM**

1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 / B1 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

CERTIFICATIONS

JOHANNE HATMAKER — REGISTERED PROFESSIONAL ENGINEER — 16355 — STATE OF MISSISSIPPI — 7/10/09

KEY PLAN



AREA 2
THIRD FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS
3	07/10/09	FIRE PROTECTION & SPEC REV

GRAPHIC SCALE

0 4 8 16

1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 3RD FL PL – AREA 2 – FIRE ALARM
FILE NAME	FA-132-N0095730.DWG
FLOOR NO.	THIRD FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 32 (DISCIPLINE SHEET TYPE SEQUENCE)
	SHEET OF –

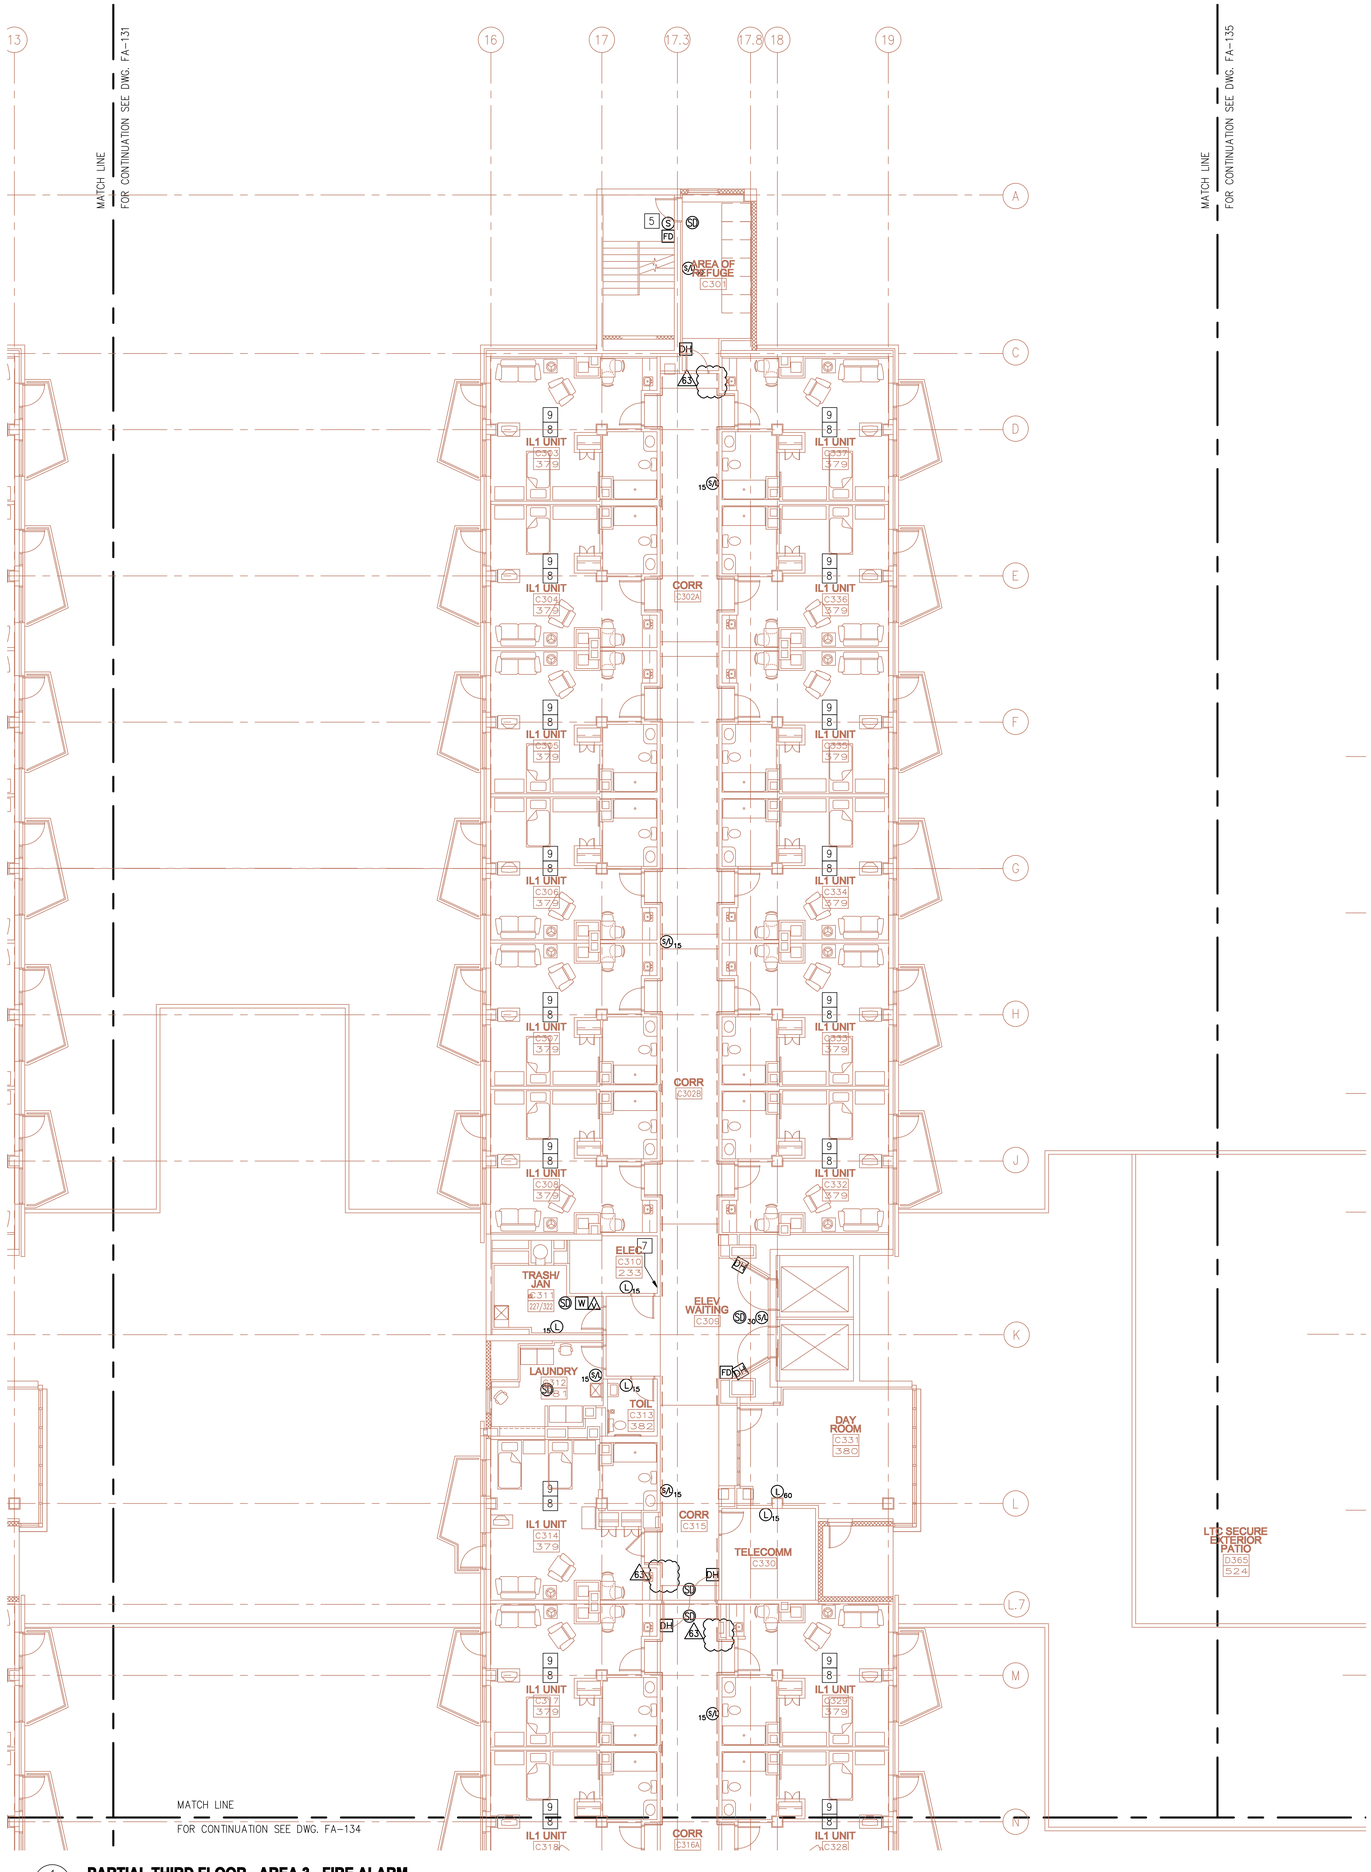

1 FA133/FA133 **PARTIAL THIRD FLOOR - AREA 3 - FIRE ALARM** 1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH
The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

CERTIFICATIONS

JOHANNE HATHAWAY
SPECIFICATIONS
ENGINEER
16355
STATE OF MISSISSIPPI
2009.04.17

KEY PLAN

N

AREA 3
THIRD FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

DRAWING SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT. 3RD FL PL – AREA 3 – FIRE ALARM
FILE NAME	FA-133-N0095730.DWG
FLOOR NO.	THIRD FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 33 DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

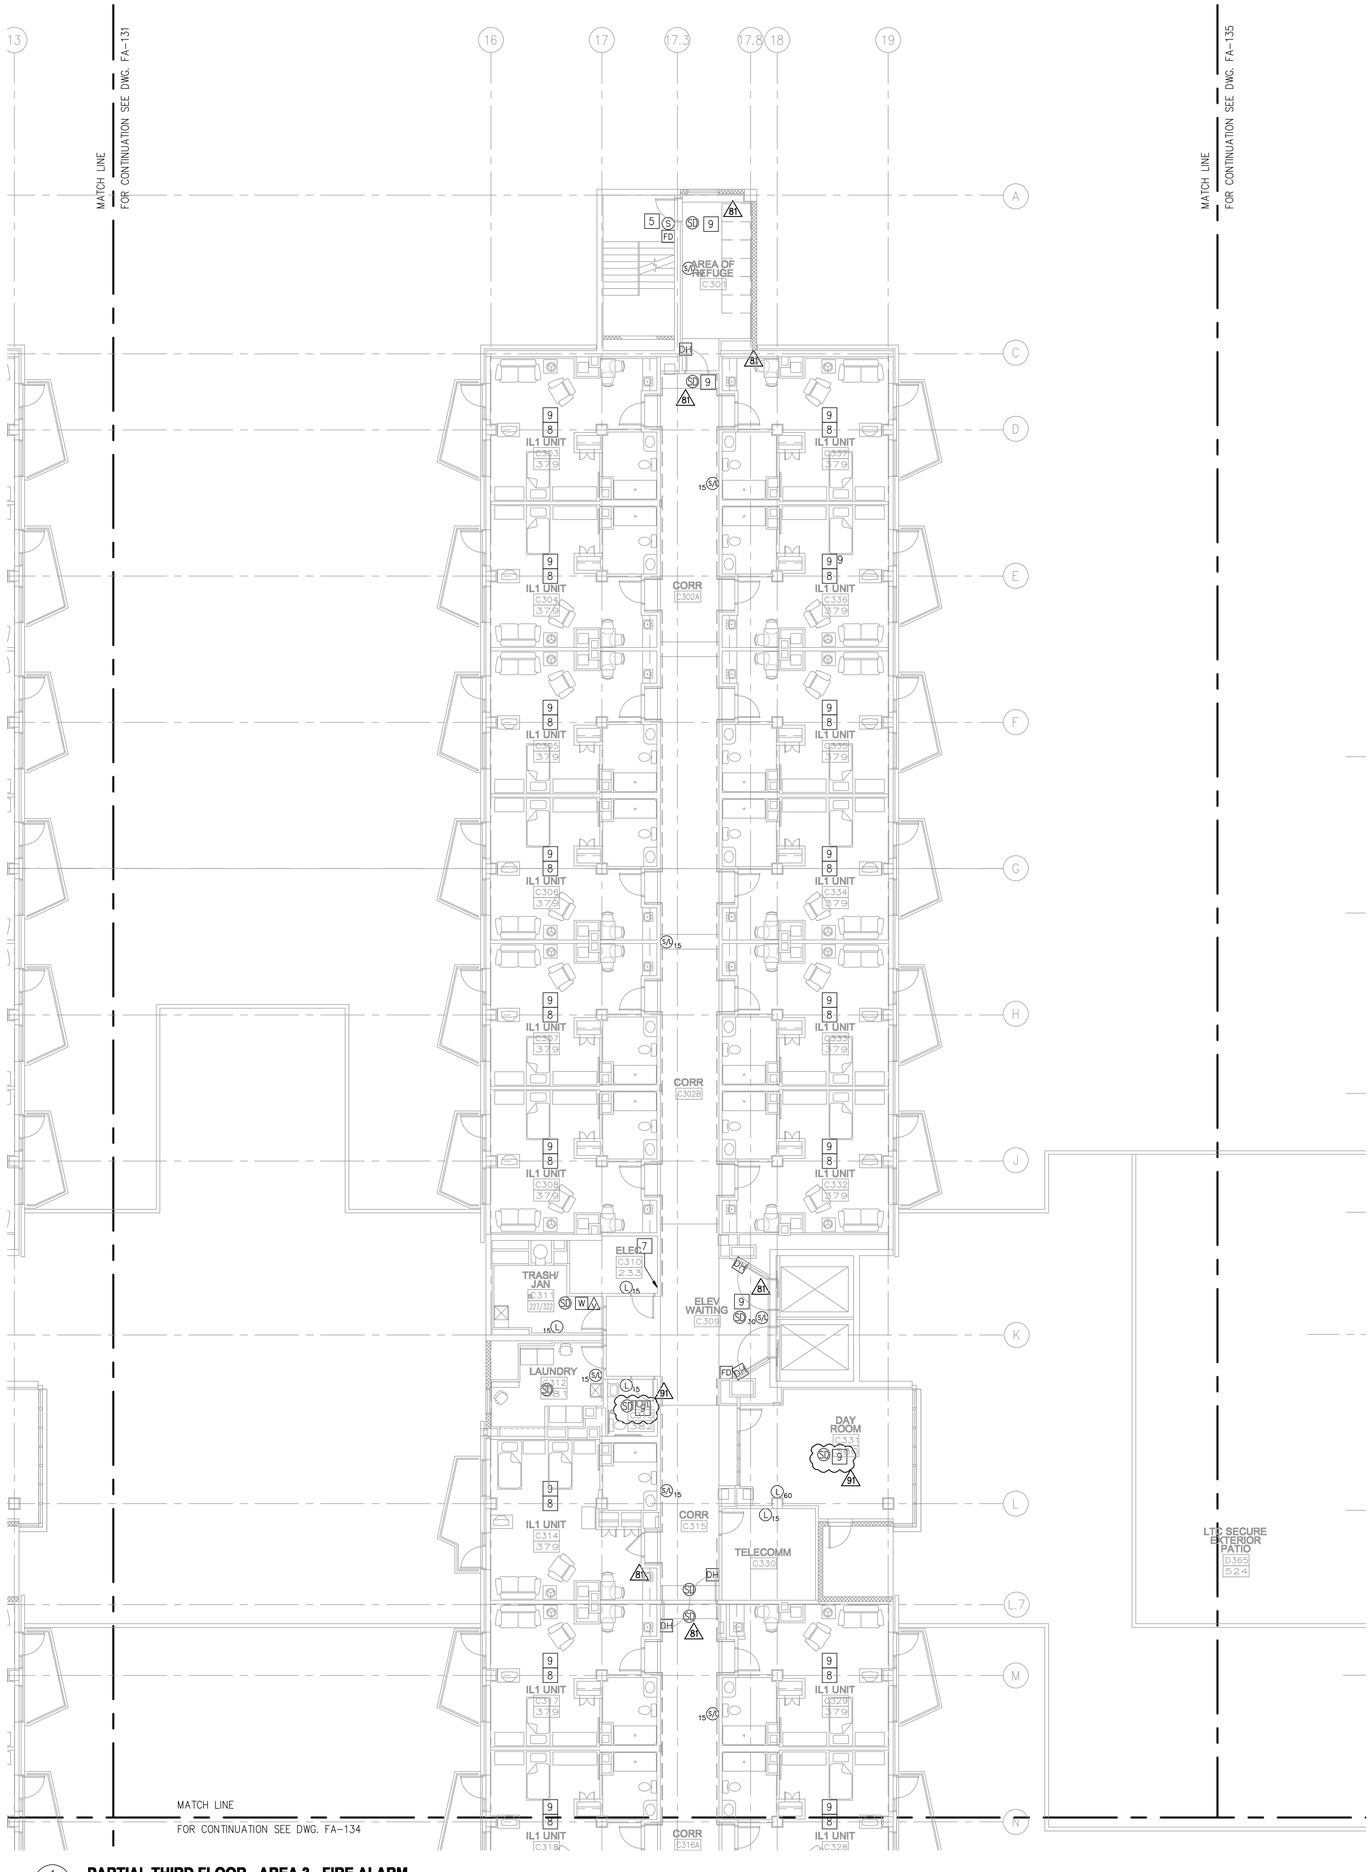

1 FA133 / FA133 **PARTIAL THIRD FLOOR - AREA 3 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

CERTIFICATIONS

STATE OF MISSISSIPPI — JAMES NATHAN RAY — 11/4/09 — REGISTERED — ENGINEER — 18355

KEY PLAN

N

AREA 3
THIRD FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS
3	07/10/09	FIRE PROTECTION & SPEC REV
4	11/04/09	FIRE ALARM CHANGES

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 380 FL PL – AREA 3 – FIRE ALARM
FILE NAME	FA-133-N0095730.DWG
FLOOR NO.	THIRD FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 33 DISCIPLINE SHEET TYPE SEQUENCE SHEET OF –

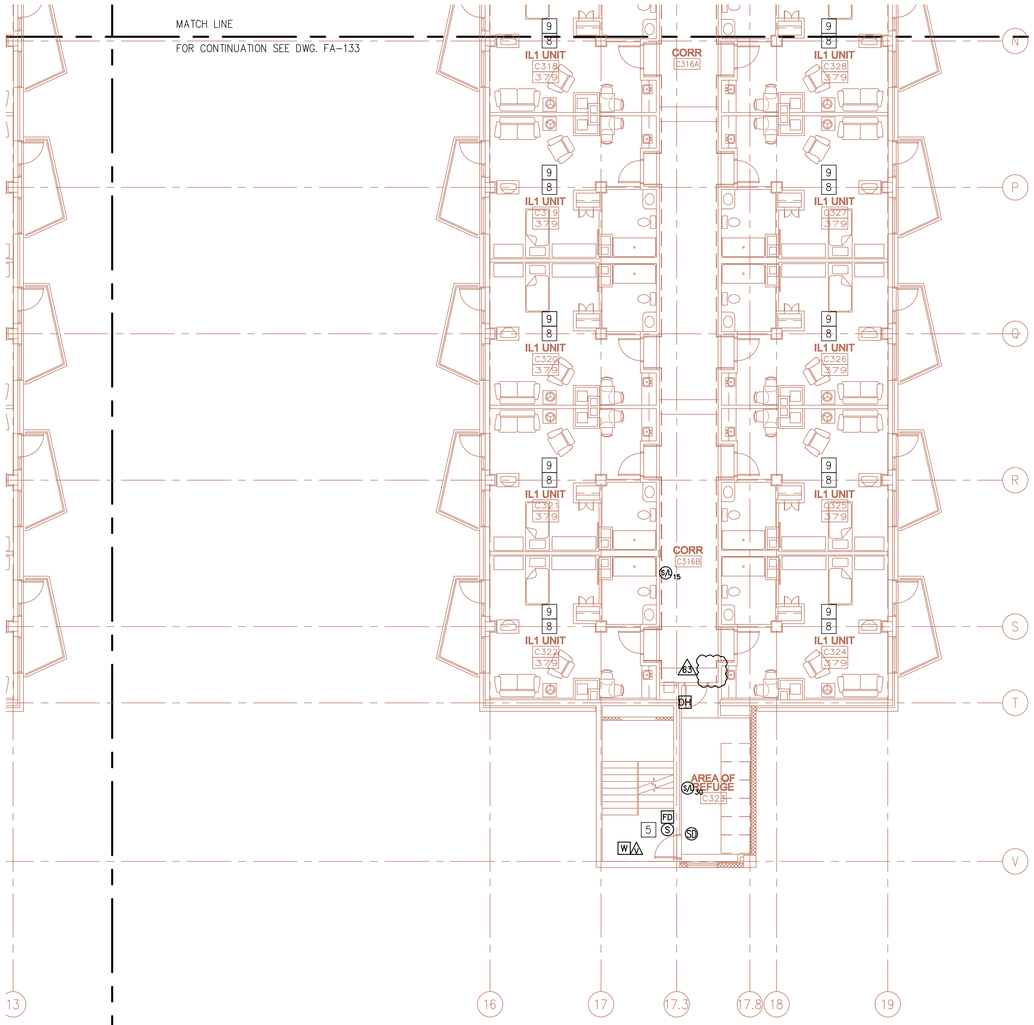

1 FA134/FA134 **PARTIAL THIRD FLOOR - AREA 4 - FIRE ALARM**
1/8"=1'-0"

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

63

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans
JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CERTIFICATIONS

DWAYNE HATHORN — ENGINEER — 18355 — STATE OF MISSISSIPPI
Issued 2009.04.17

KEY PLAN



AREA 4
THIRD FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 3RD FL PLAN - AREA 4 - FIRE ALARM
FILE NAME	FA-134-N0095730.DWG
FLOOR NO.	THIRD FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 34 (DISCIPLINE SHEET TYPE SEQUENCE)
	SHEET OF -

PROPERTY OF THE UNITED STATES GOVERNMENT - FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

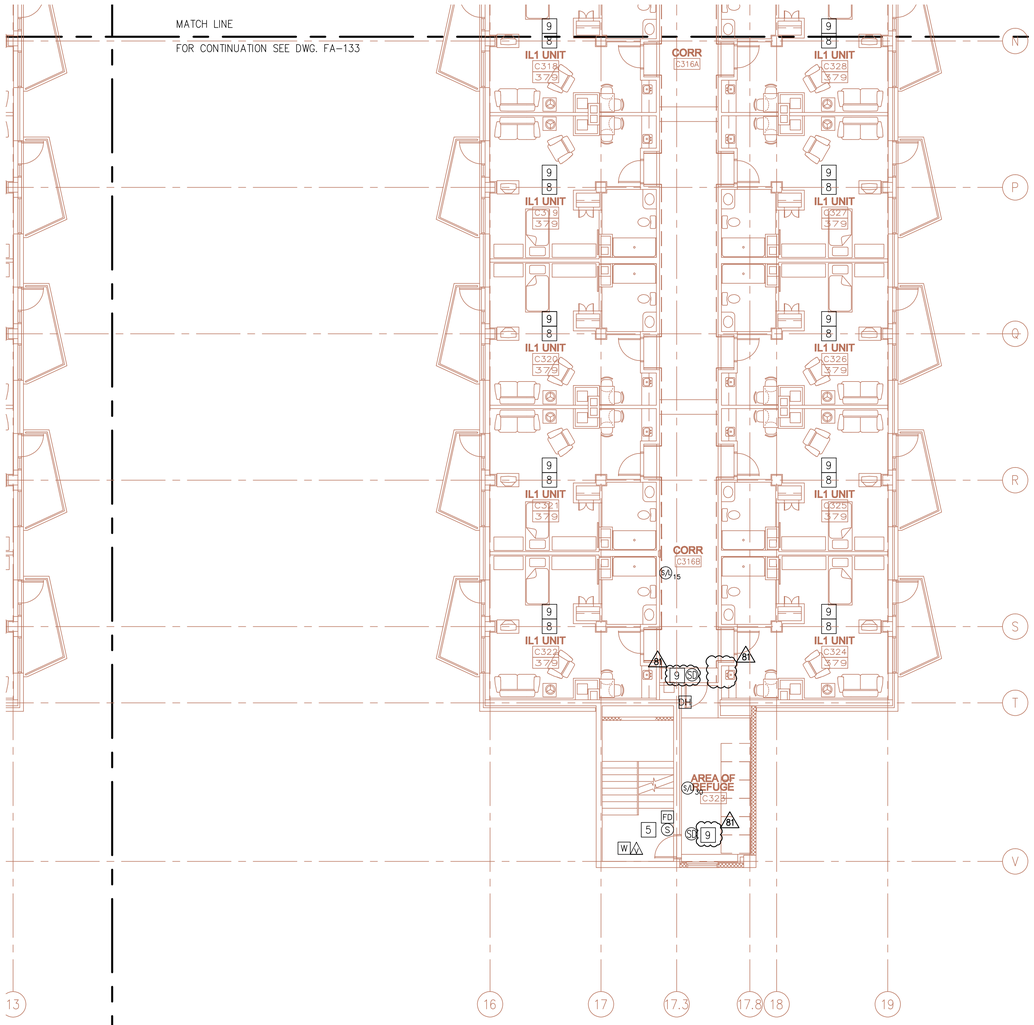

1 FA134 FA134 **PARTIAL THIRD FLOOR - AREA 4 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans
JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

81

CERTIFICATIONS

SHANE HATMAKER — 07/10/09 — ENGINEER — 18355 — STATE OF MISSISSIPPI

KEY PLAN

N

AREA 4
THIRD FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS
3	07/10/09	FIRE PROTECTION & SPEC REV

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 3RD FL PLAN – AREA 4 – FIRE ALARM
FILE NAME	FA-134-N0095730.DWG
FLOOR NO.	THIRD FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 34 (DISCIPLINE SHEET TYPE SEQUENCE) SHEET OF –

1 FA135 FA135 **PARTIAL THIRD FLOOR - AREA 5 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans
JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

63

CERTIFICATIONS

DUANE HATTAWAY
REGISTERED PROFESSIONAL
ENGINEER
16355
STATE OF MISSISSIPPI
2009.04.17

KEY PLAN

N

AREA 5
THIRD FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 3RD FL PLAN – AREA 5 – FIRE ALARM
FILE NAME	FA-135-N0095730.DWG
FLOOR NO.	THIRD FLOOR
DRAWN BY	INR
DATE DRAFTED:	
CHECKED BY	SH
SHEET SIZE:	34 X 44
DRAWING NO.	FA 1 35
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

PARTIAL THIRD FLOOR - AREA 5 - FIRE ALARM

1 / FA135 | FA135 1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

KEY PLAN

AREA 5
THIRD FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 3RD FL PLAN – AREA 5 – FIRE ALARM
FILE NAME	FA-135-N0095730.DWG
FLOOR NO.	THIRD FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 35
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

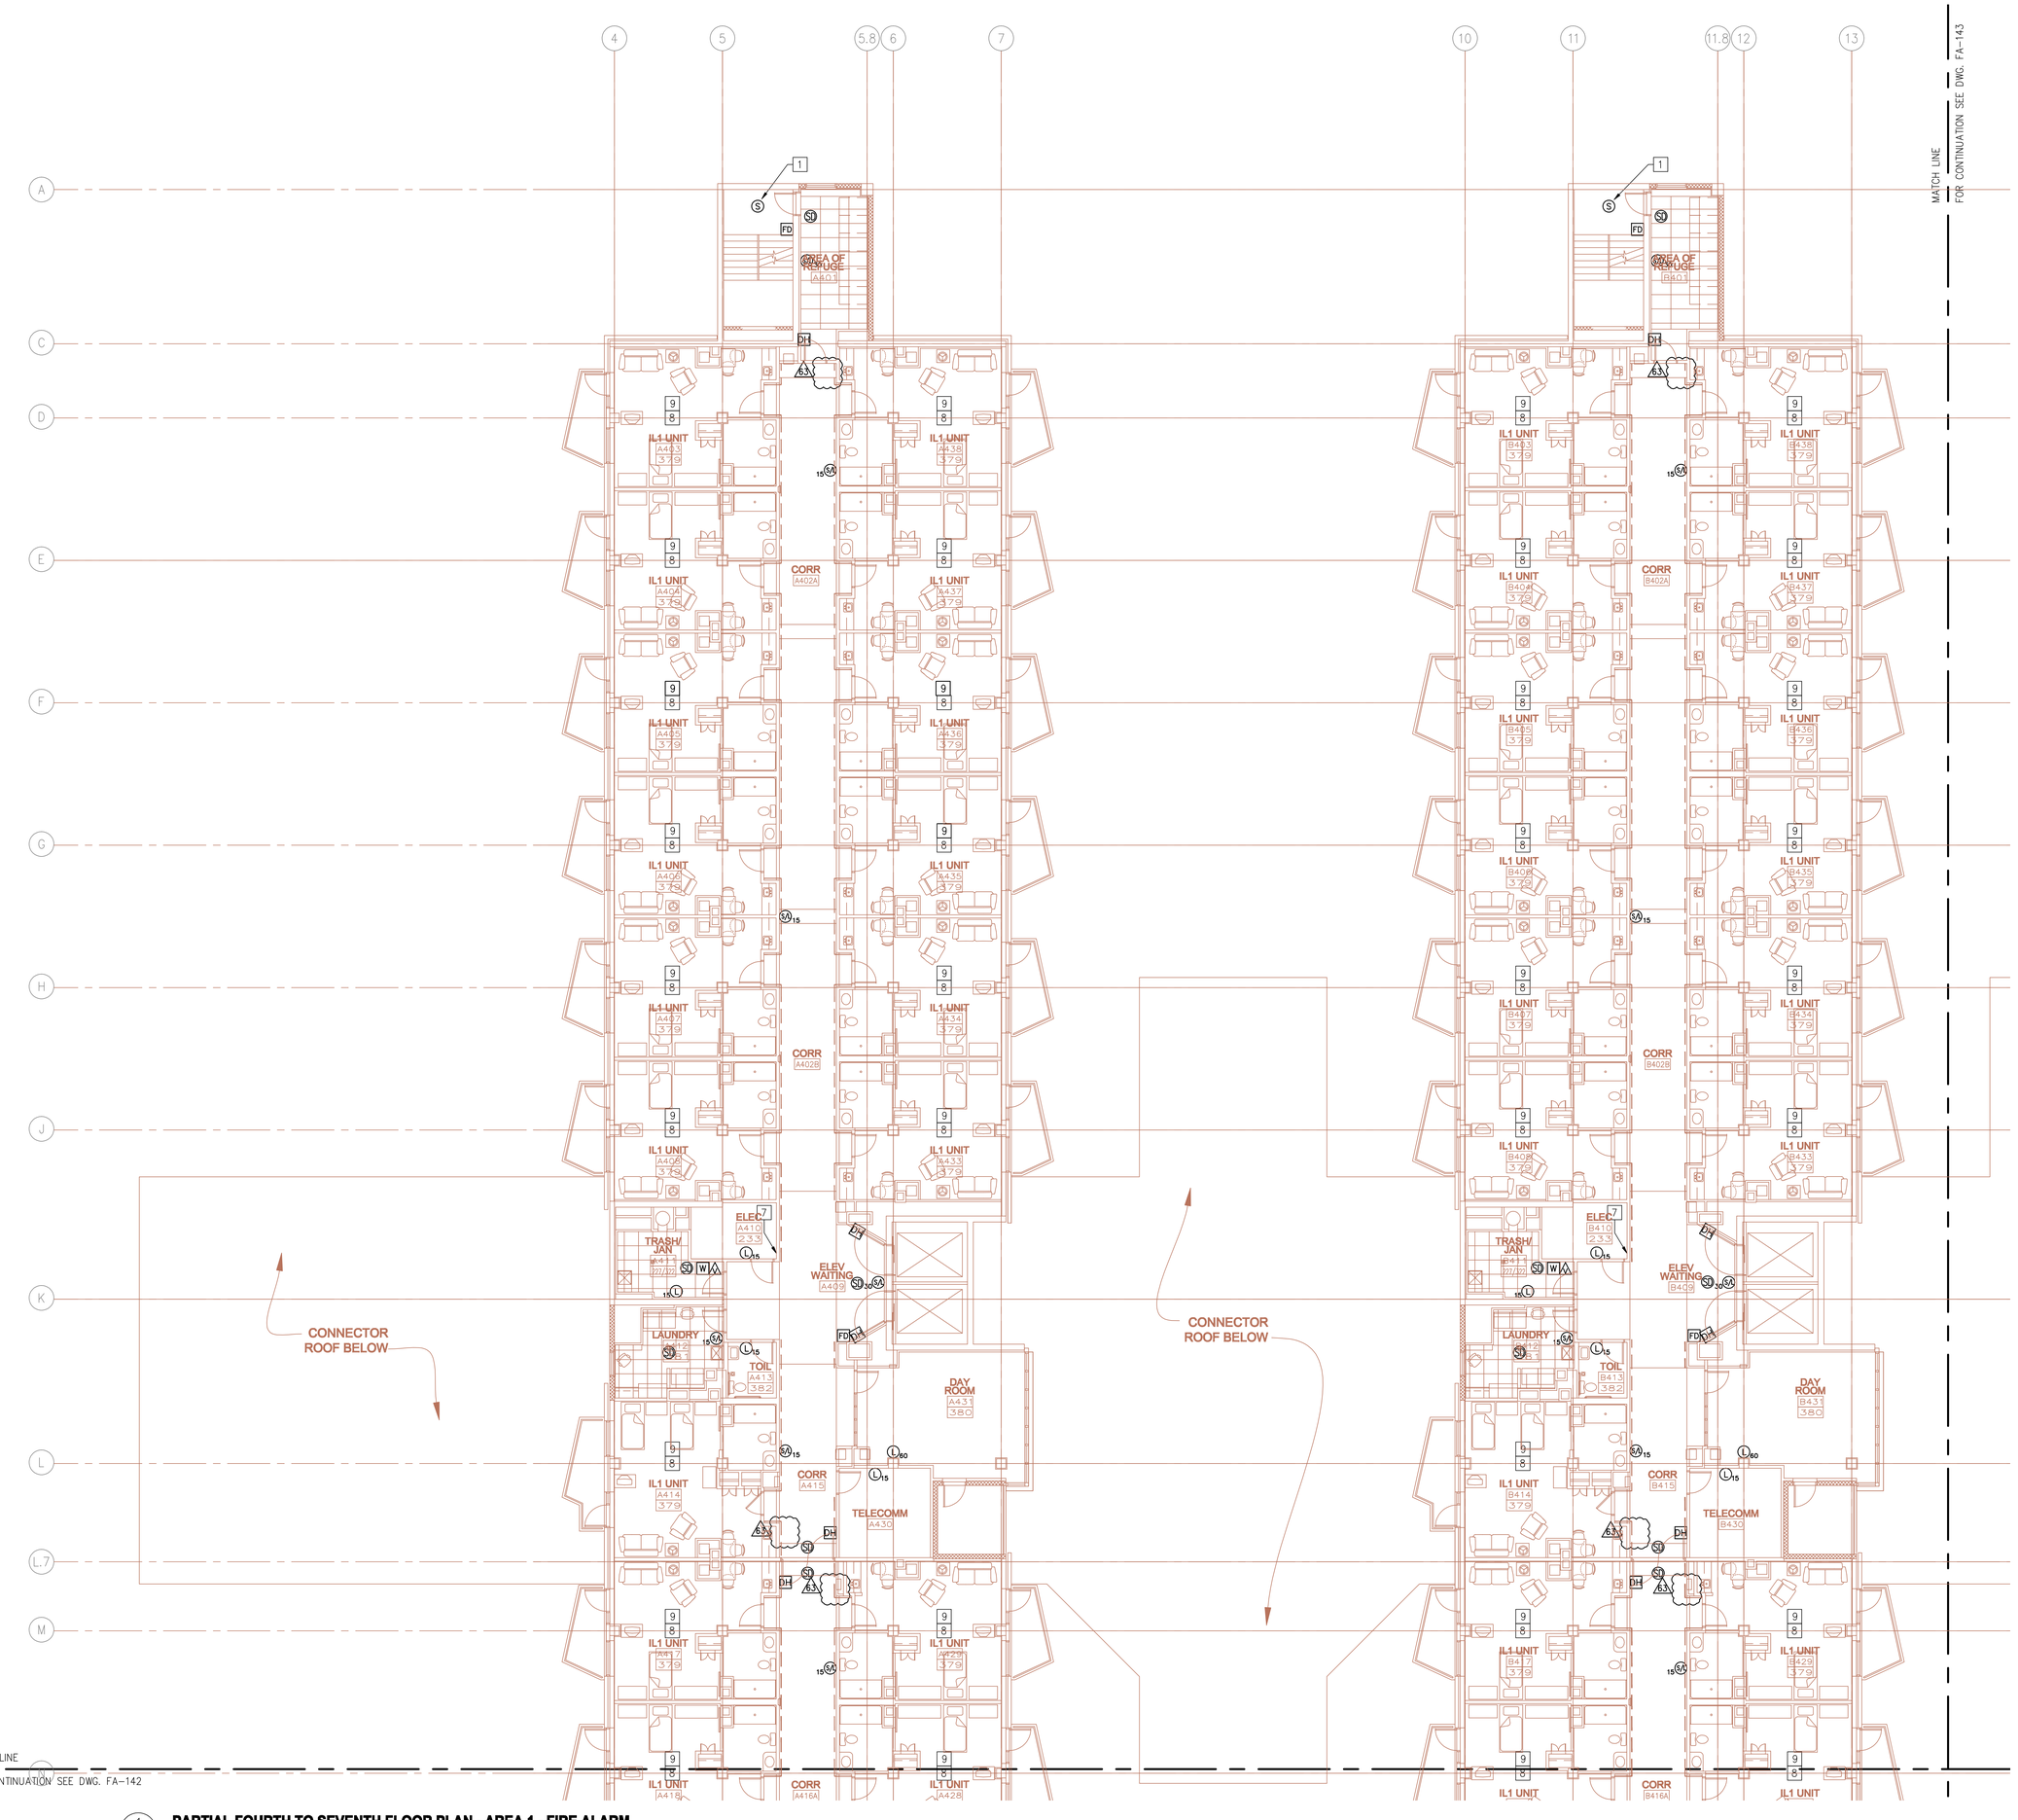

1 FA141|FA141 1/8"=1'-0"

PARTIAL FOURTH TO SEVENTH FLOOR PLAN - AREA 1 - FIRE ALARM

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

1 PROVIDE FIRE ALARM SPEAKER ON 5TH AND 7TH FLOOR.

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

63

CERTIFICATIONS

DWANE HATHAWAY
REGISTERED PROFESSIONAL
ENGINEER
16355
STATE OF MISSISSIPPI
Dwane Hathaway
2009.04.17

KEY PLAN

AREA 1
FOURTH TO EIGHTH FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 4 -7 FL PL - AREA 1 - FIRE ALARM
FILE NAME	FA-141-N0095730.DWG
FLOOR NO.	FOURTH TO SEVENTH FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 41 DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

1 FA141 FA141 **PARTIAL FOURTH TO SEVENTH FLOOR PLAN - AREA 1 - FIRE ALARM**

1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

1. PROVIDE FIRE ALARM SPEAKER ON 5TH AND 7TH FLOOR.
7. DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.
8. PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.
9. ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

CERTIFICATIONS

MARK HATCH 11/4/09
ENGINEER
16355
STATE OF MISSISSIPPI

KEY PLAN

AREA 1
FOURTH TO EIGHTH FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS
3	07/10/09	FIRE PROTECTION & SPEC REV
4	11/04/09	FIRE ALARM CHANGES

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 4 -7 FL PL – AREA 1 – FIRE ALARM
FILE NAME	FA-141-N0095730.DWG
FLOOR NO.	FOURTH TO SEVENTH FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 41
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

MATCH LINE

FOR CONTINUATION SEE DWG. FA-141

MATCH LINE

FOR CONTINUATION SEE DWG. FA-144

1 FA142|FA142 **PARTIAL FOURTH TO SEVENTH FLOOR PLAN - AREA 2 - FIRE ALARM**

1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

1 PROVIDE FIRE ALARM SPEAKER ON 5TH AND 7TH FLOOR.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 63 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

CERTIFICATIONS

DUANE HATTENBACH REGISTERED PROFESSIONAL ENGINEER 16355 STATE OF MISSISSIPPI 2009.04.17

KEY PLAN



AREA 2
FOURTH TO EIGHTH FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16

1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 4 – 7 FL PL – AREA 2 – FIRE ALARM
FILE NAME	FA-142-N0095730.DWG
FLOOR NO.	FOURTH TO SEVENTH FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 42
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

1 FA142/FA142 **PARTIAL FOURTH TO SEVENTH FLOOR PLAN - AREA 2 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

1 PROVIDE FIRE ALARM SPEAKER ON 5TH AND 7TH FLOOR.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

81

CERTIFICATIONS



7/10/09

KEY PLAN



AREA 2
FOURTH TO EIGHTH FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS
3	07/10/09	FIRE PROTECTION & SPEC REV

GRAPHIC SCALE

1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 4 – 7 FL PL – AREA 2 – FIRE ALARM
FILE NAME	FA-142-N0095730.DWG
FLOOR NO.	FOURTH TO SEVENTH FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 42
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

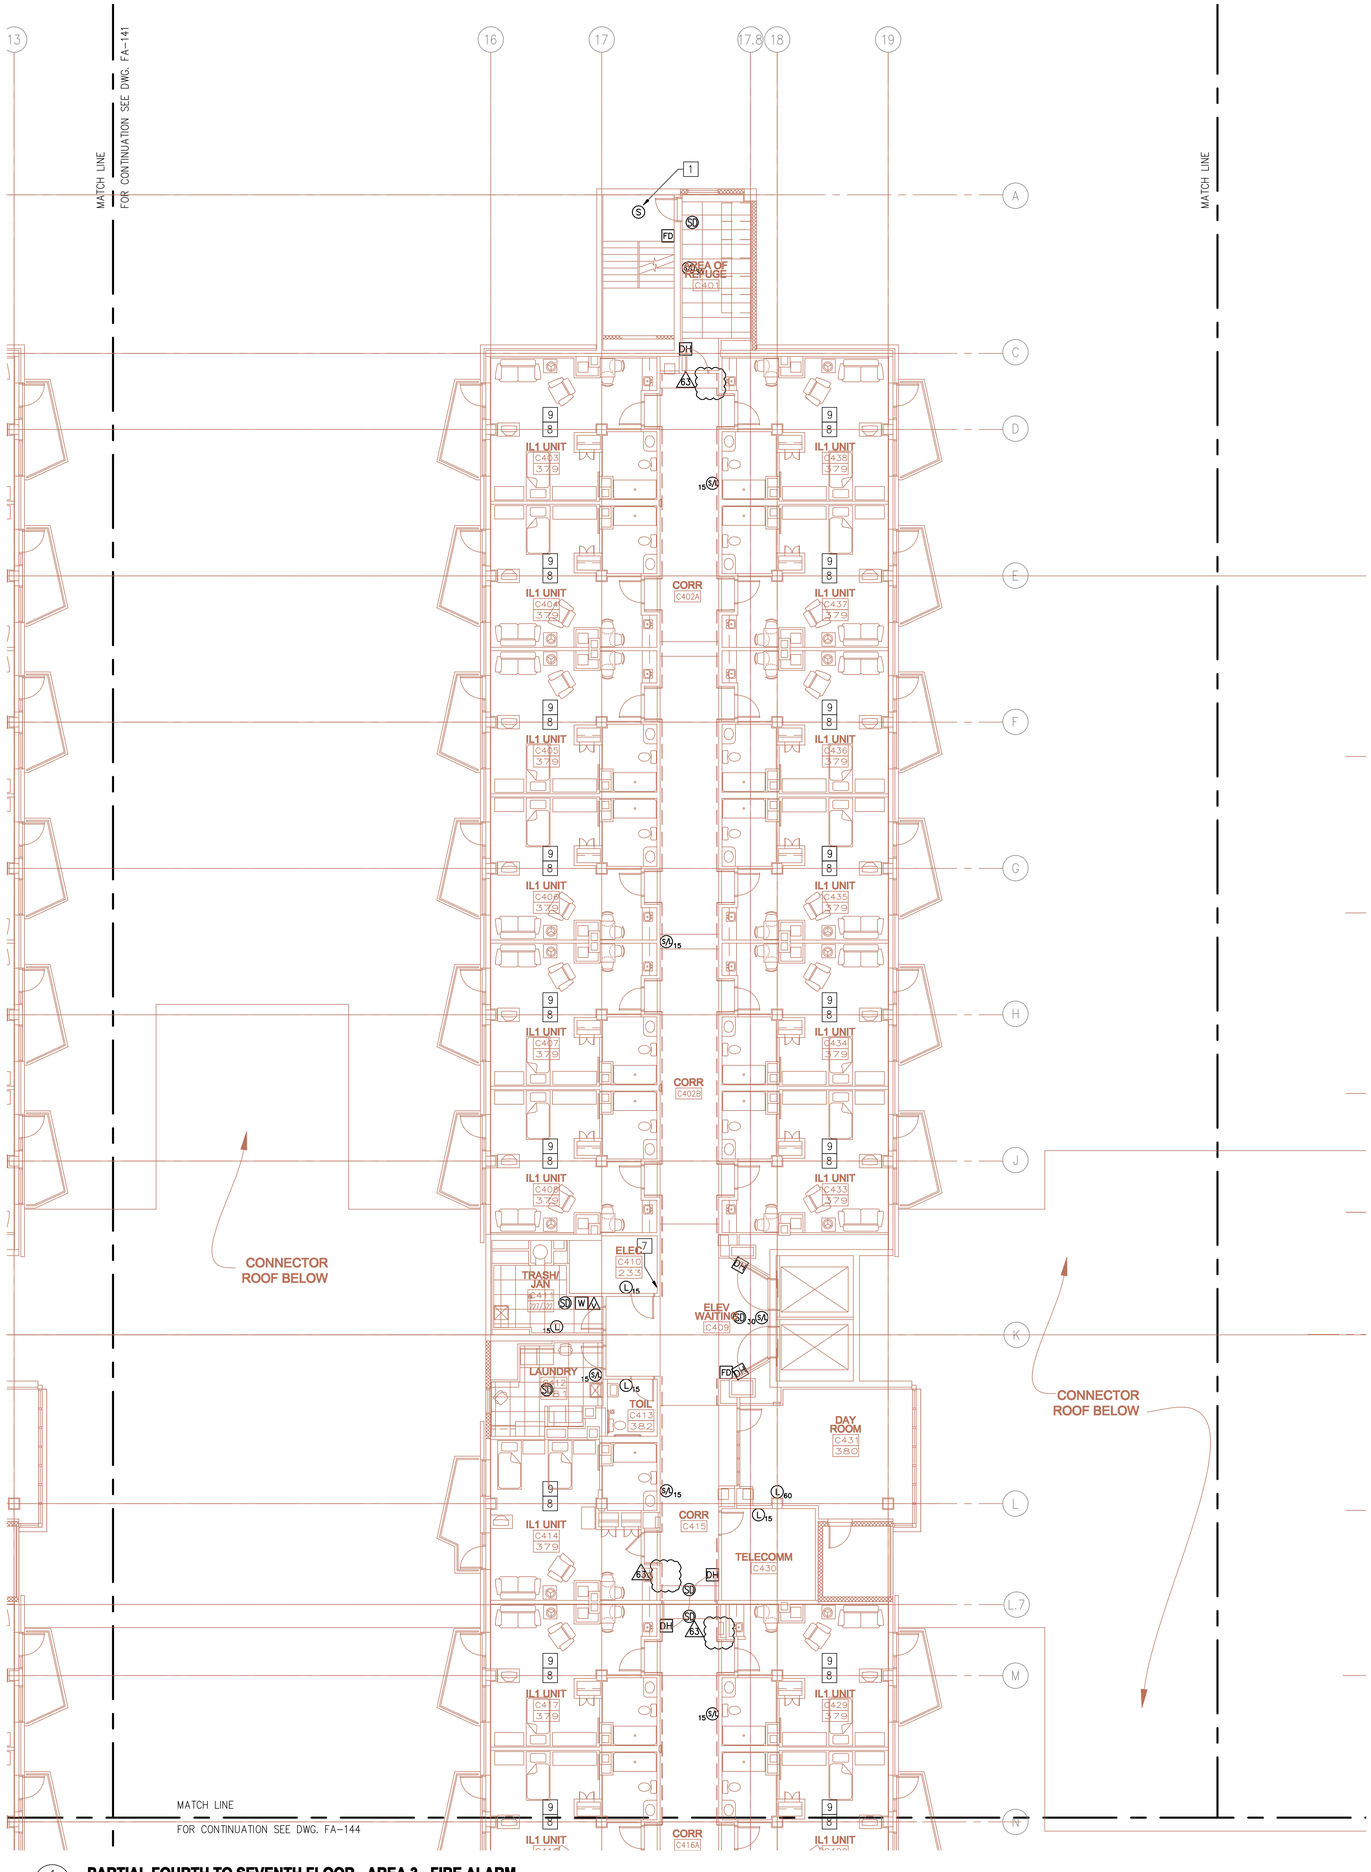

1 FA143 | FA143 1/8"=1'-0"

PARTIAL FOURTH TO SEVENTH FLOOR - AREA 3 - FIRE ALARM

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 / 63 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

CERTIFICATIONS

SHANE HATTAWAY — SPECIFICATIONS — ENGINEER — 16355 — STATE OF MISSISSIPPI — 2009.04.17

KEY PLAN

N

AREA 3
FOURTH TO EIGHTH FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

DRAWING SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 4 – 7 FL PL – AREA 3 – FIRE ALARM
FILE NAME	FA-143-N0095730.DWG
FLOOR NO.	FOURTH TO SEVENTH FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 43 (DISCIPLINE SHEET TYPE SEQUENCE)
	SHEET OF –

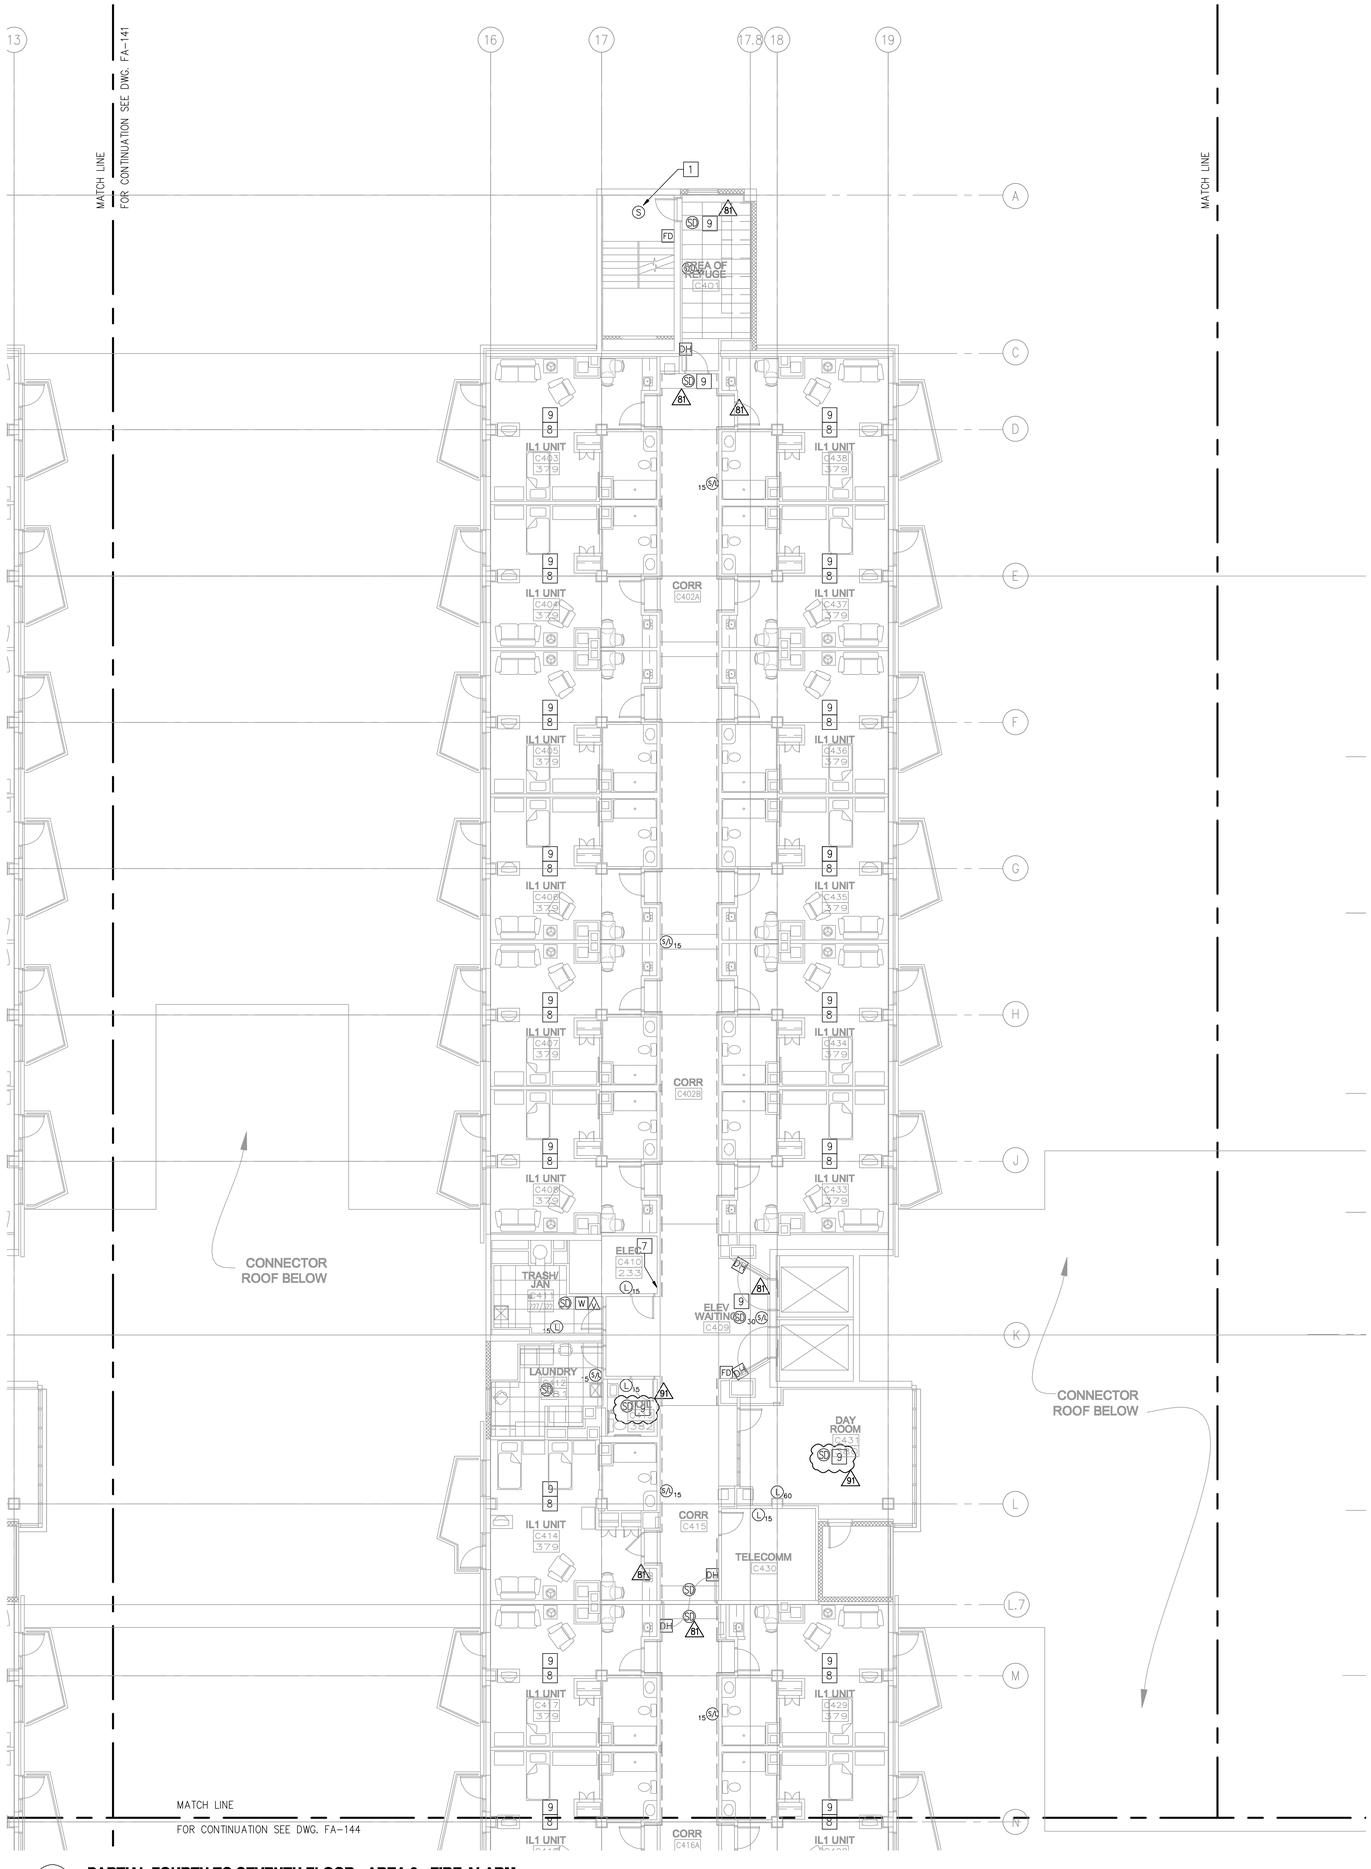

1 FA143 | FA143 1/8"=1'-0"

PARTIAL FOURTH TO SEVENTH FLOOR - AREA 3 - FIRE ALARM

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

CERTIFICATIONS

STATE OF MISSISSIPPI — SCOTT MATHENY — REGISTERED — PROFESSIONAL — ENGINEER — 18365 — 11/4/09

KEY PLAN



AREA 3
FOURTH TO EIGHTH FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS
3	07/10/09	FIRE PROTECTION & SPEC REV
4	11/04/09	FIRE ALARM CHANGES

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 4 – 7 FL PL – AREA 3 – FIRE ALARM
FILE NAME	FA-143-N0095730.DWG
FLOOR NO.	FOURTH TO SEVENTH FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 43
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

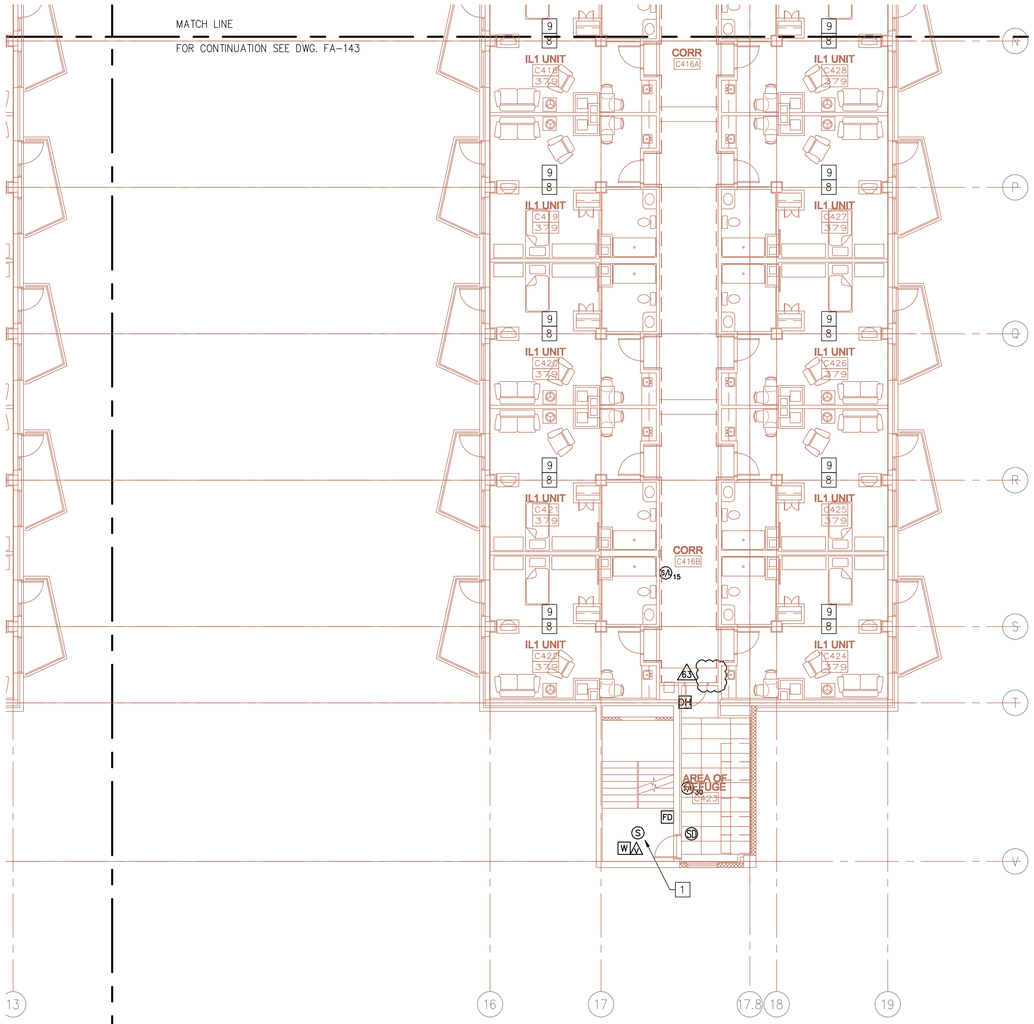

F

1 FA144 | FA144 **PARTIAL FOURTH TO SEVENTH FLOOR - AREA 4 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

1 PROVIDE FIRE ALARM SPEAKER ON 5TH AND 7TH FLOOR.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

63

CERTIFICATIONS

JEROME HATTENBACH
REGISTERED PROFESSIONAL
ENGINEER
16355
STATE OF MISSISSIPPI
2009.04.17

KEY PLAN



AREA 4
FOURTH TO EIGHTH FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 4 – 7 FL PL – AREA 4 – FIRE ALARM
FILE NAME	FA-144-N0095730.DWG
FLOOR NO.	FOURTH TO SEVENTH FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 44
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

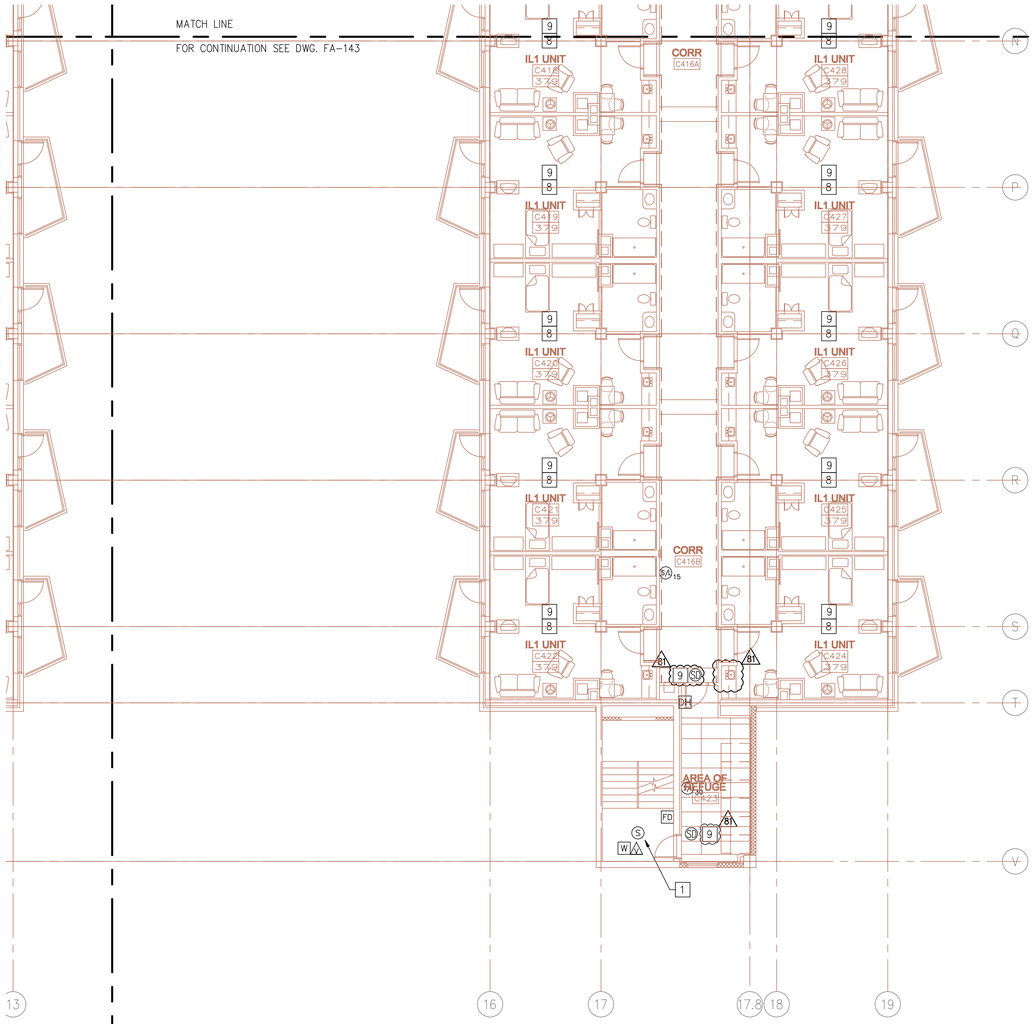

1 FA144 | FA144 — **PARTIAL FOURTH TO SEVENTH FLOOR - AREA 4 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

1 PROVIDE FIRE ALARM SPEAKER ON 5TH AND 7TH FLOOR.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

CERTIFICATIONS

ELAINE HATMAKER — ENGINEER — 16355 — STATE OF MISSISSIPPI — 7/1/09

KEY PLAN

N

AREA 4
FOURTH TO EIGHTH FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS
3	07/10/09	FIRE PROTECTION & SPEC REV

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PT 4 – 7 FL PL – AREA 4 – FIRE ALARM
FILE NAME	FA-144-N0095730.DWG
FLOOR NO.	FOURTH TO SEVENTH FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 44
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

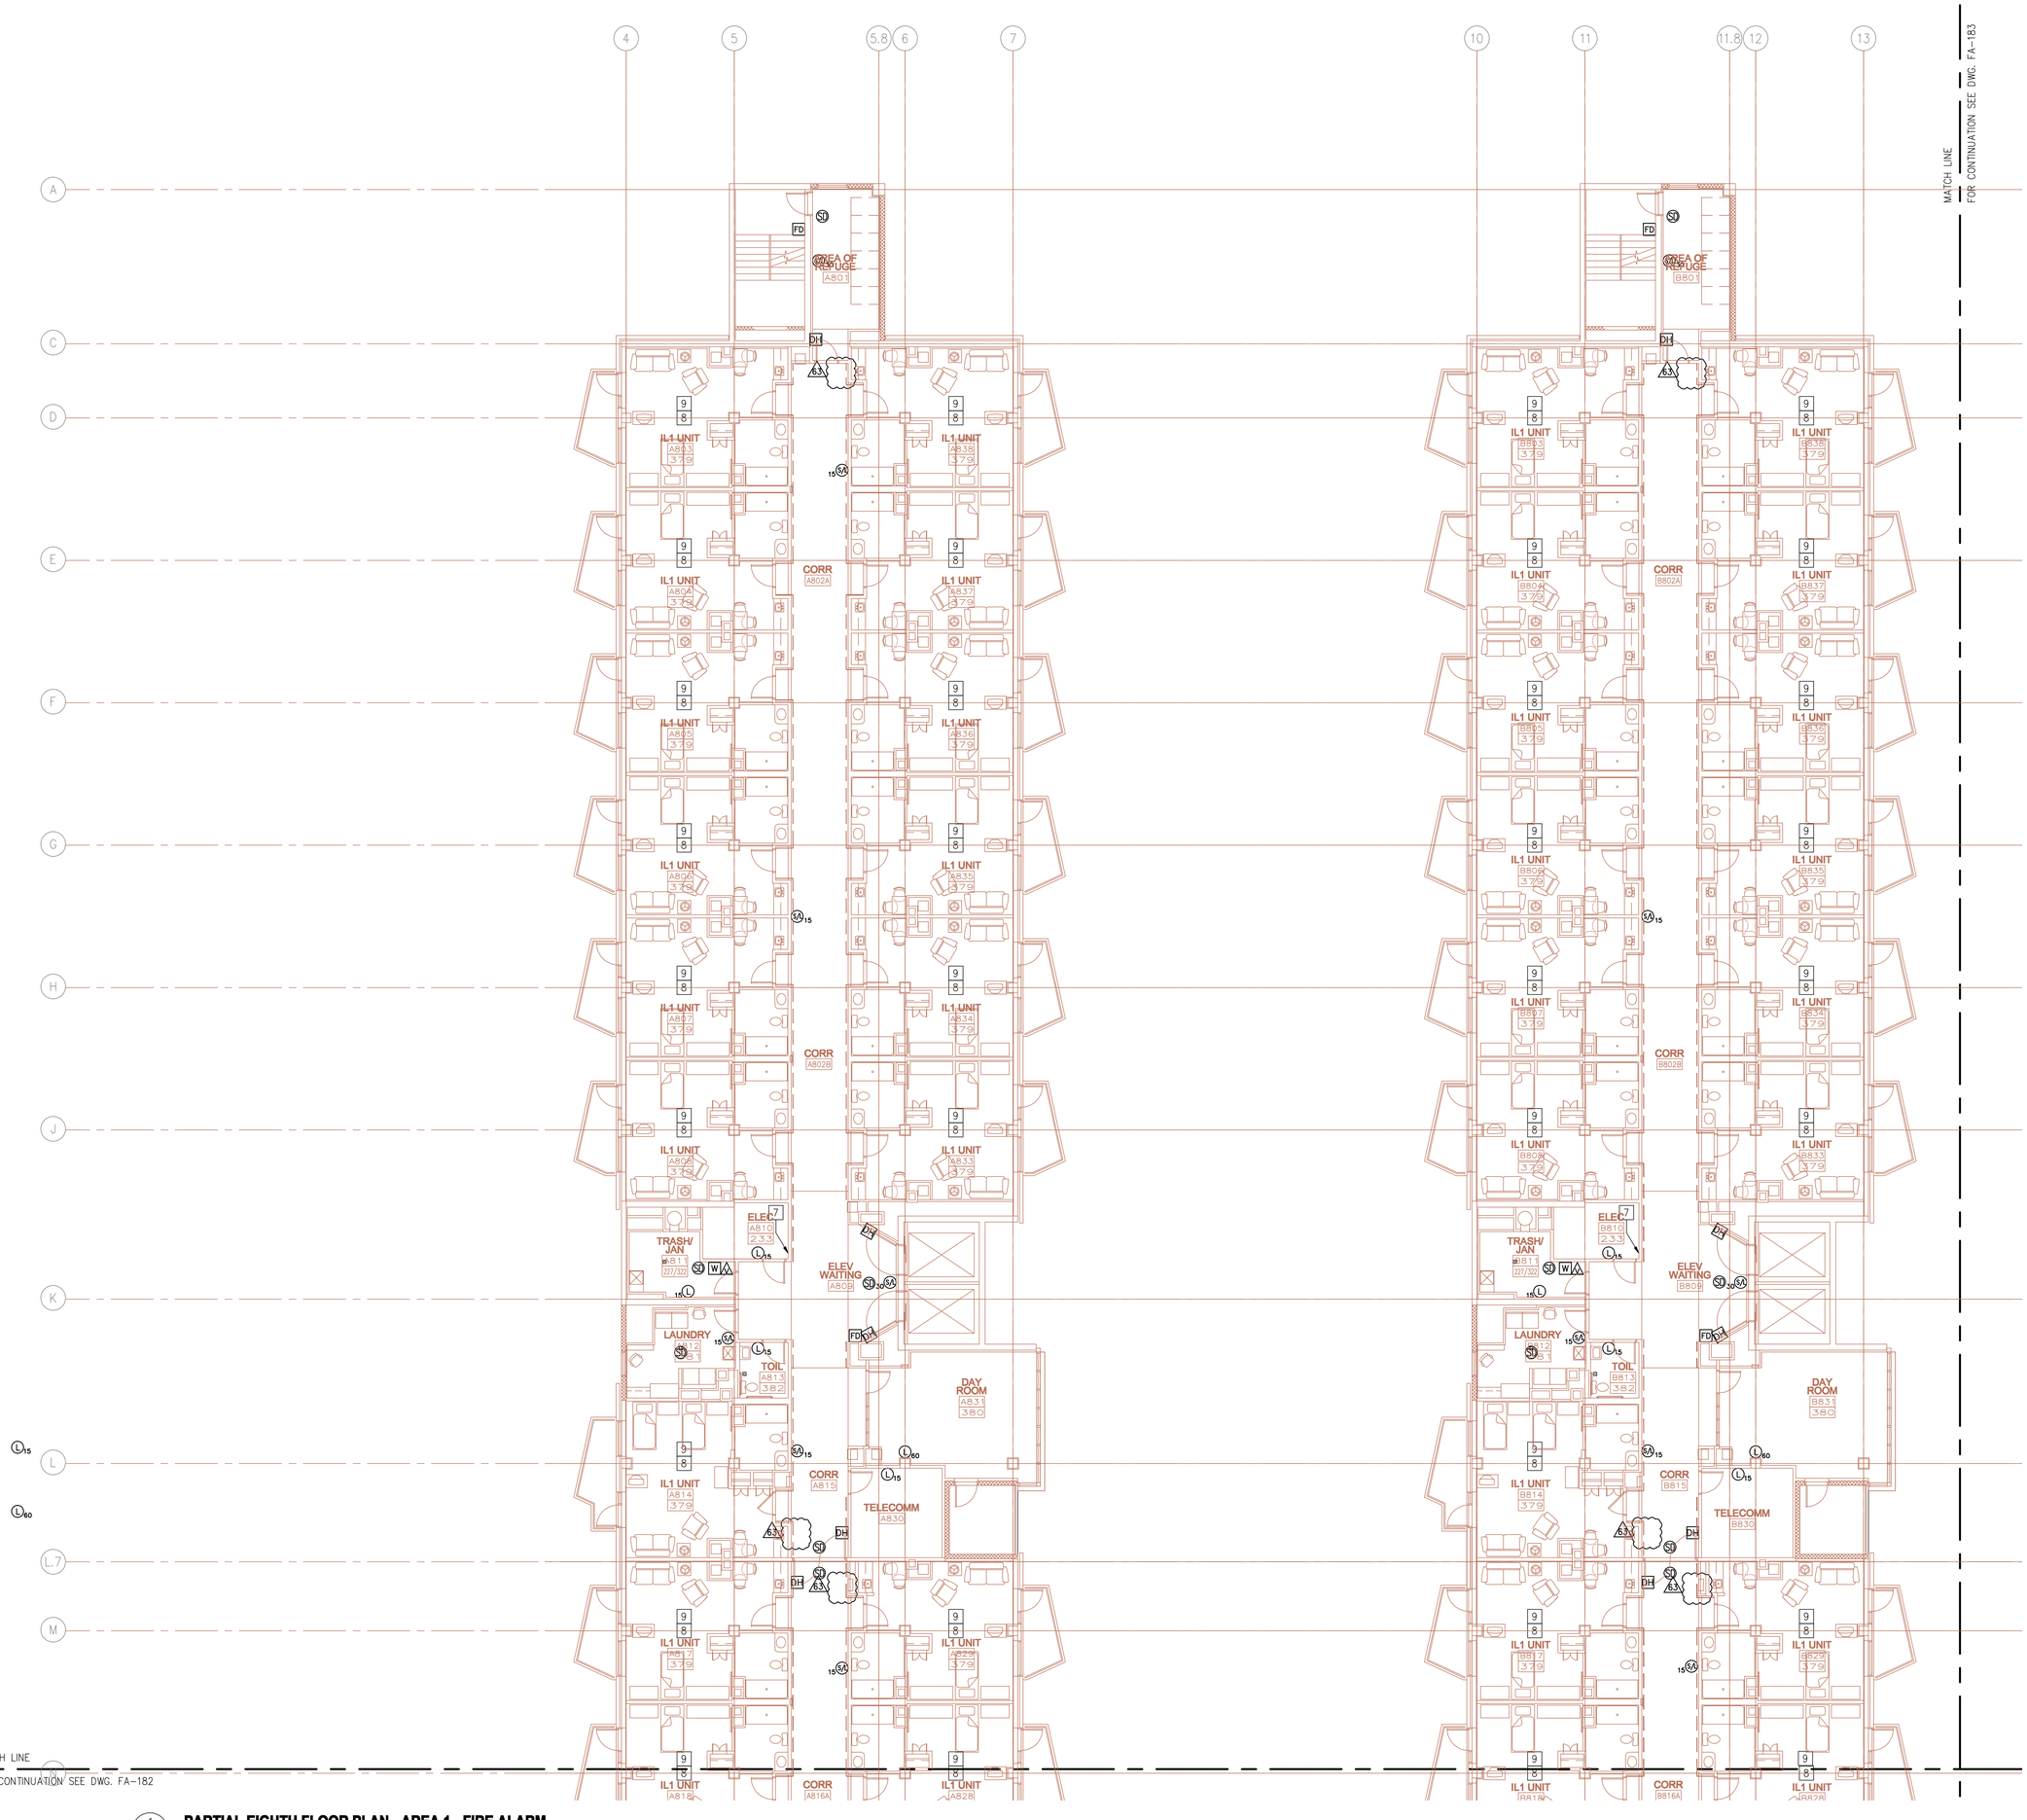

PARTIAL EIGHTH FLOOR PLAN - AREA 1 - FIRE ALARM

1 FA181 | FA181 — 1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

CERTIFICATIONS

DWANE HATHORN — ENGINEER — 16355 — STATE OF MISSISSIPPI — 2009.04.17

KEY PLAN

N

AREA 1
EIGHTH FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PART 8 FL PLAN – AREA 1 – FIRE ALARM
FILE NAME	FA-181-N0095730.DWG
FLOOR NO.	EIGHTH FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 81 DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

PARTIAL EIGHTH FLOOR PLAN - AREA 1 - FIRE ALARM

1 / FA181 | FA181 — 1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

CERTIFICATIONS

JAMES MATTHEW MAHER — 11/11/09 — REGISTERED PROFESSIONAL ENGINEER — 18355 — STATE OF MISSISSIPPI

KEY PLAN

N

AREA 1
EIGHTH FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS
3	07/10/09	FIRE PROTECTION & SPEC REV
4	11/04/09	FIRE ALARM CHANGES

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PART 8 FL PLAN – AREA 1 – FIRE ALARM
FILE NAME	FA-181-N0095730.DWG
FLOOR NO.	EIGHTH FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 81
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

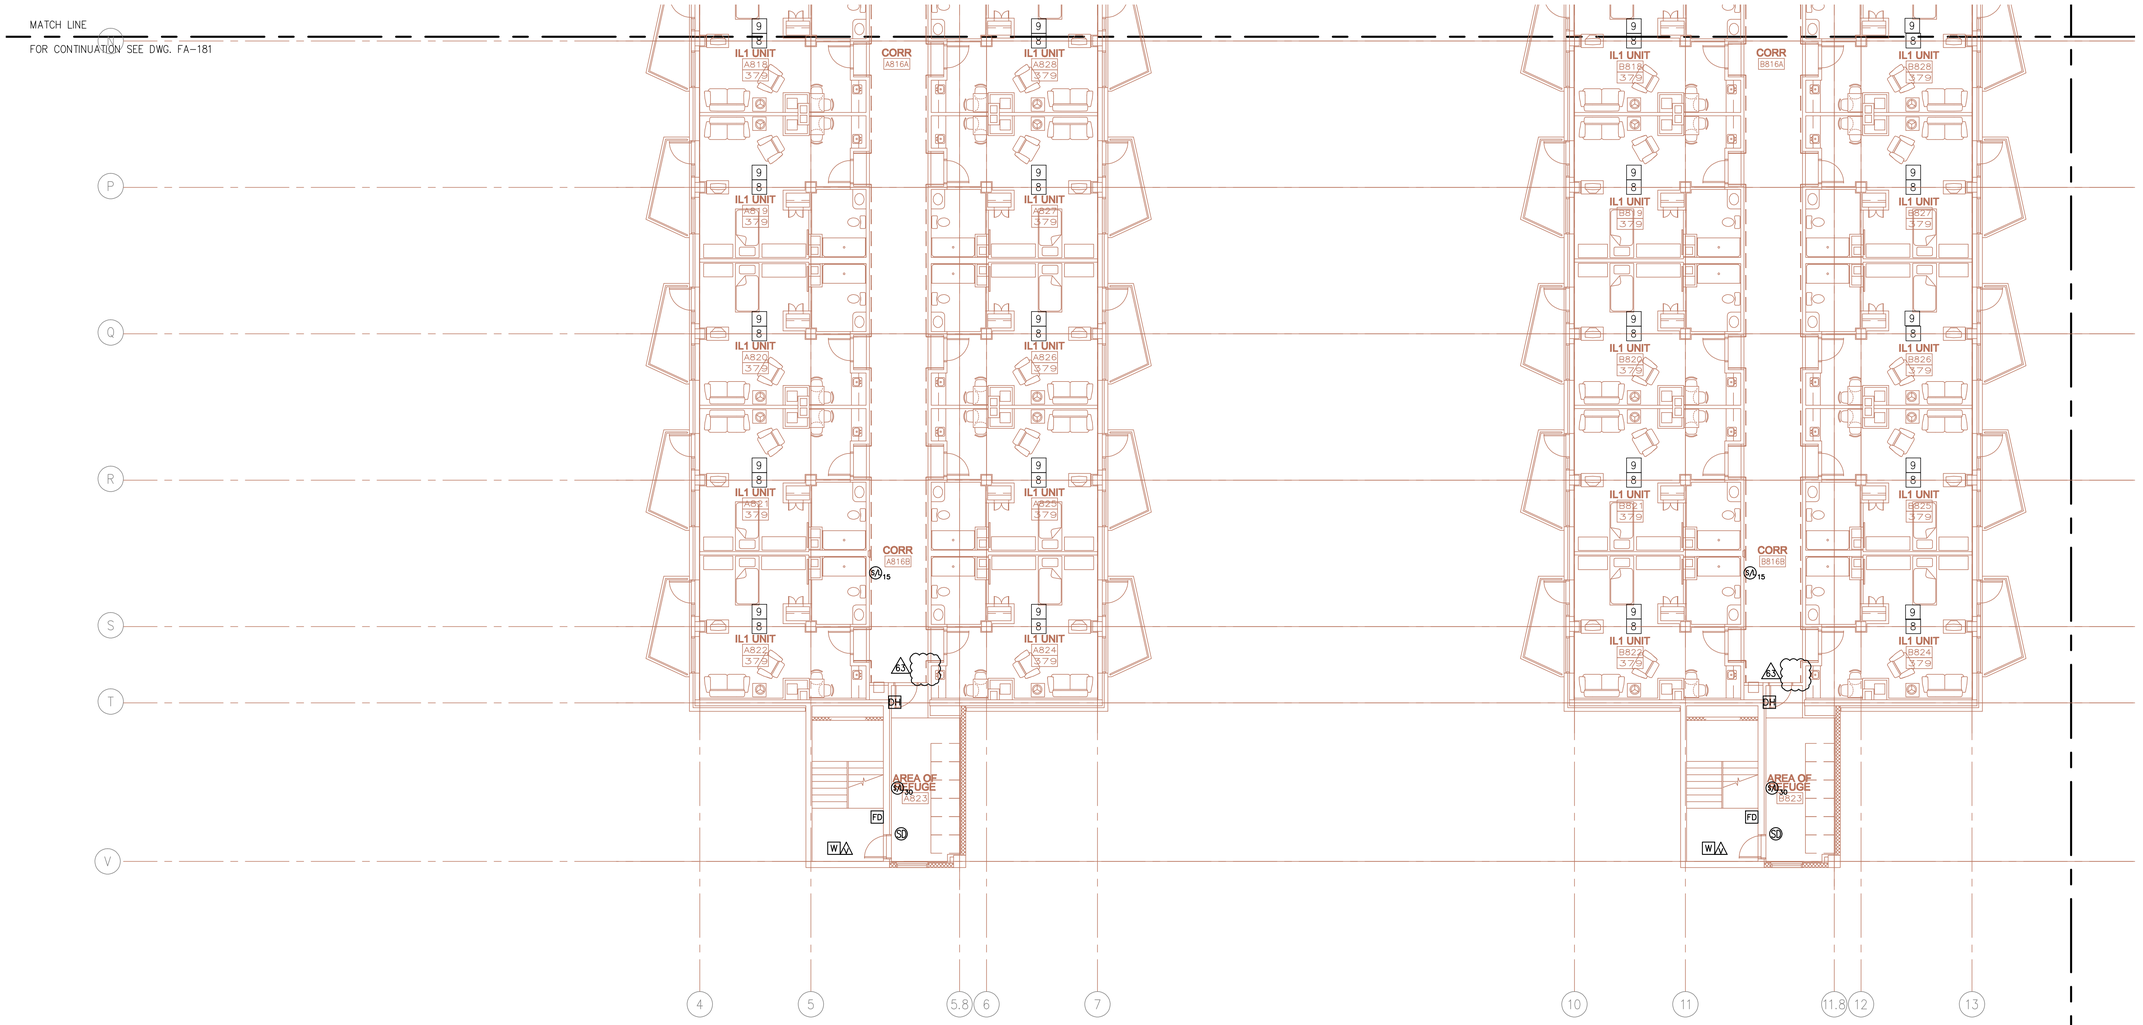

1 FA182/FA182 **PARTIAL EIGHTH FLOOR PLAN - AREA 2 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 / 63 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

CERTIFICATIONS

DWANE HATHMAKER
ENGINEER
18355
STATE OF MISSISSIPPI
2009.04.17

KEY PLAN



AREA 2
EIGHTH FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PART 8 FL PLAN – AREA 2 – FIRE ALARM
FILE NAME	FA-182-N0095730.DWG
FLOOR NO.	EIGHTH FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 82
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

MATCH LINE
FOR CONTINUATION SEE DWG. FA-181

1 FA182/FA182 **PARTIAL EIGHTH FLOOR PLAN - AREA 2 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans
JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 / S/I 15 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

CERTIFICATIONS

JAMES HAMMOND MISSISSIPPI REGISTERED ENGINEER 18355 STATE OF MISSISSIPPI 7/7/09

KEY PLAN

N

AREA 2
EIGHTH FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS
3	07/10/09	FIRE PROTECTION & SPEC REV

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PART 8 FL PLAN – AREA 2 – FIRE ALARM
FILE NAME	FA-182-N0095730.DWG
FLOOR NO.	EIGHTH FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 82
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

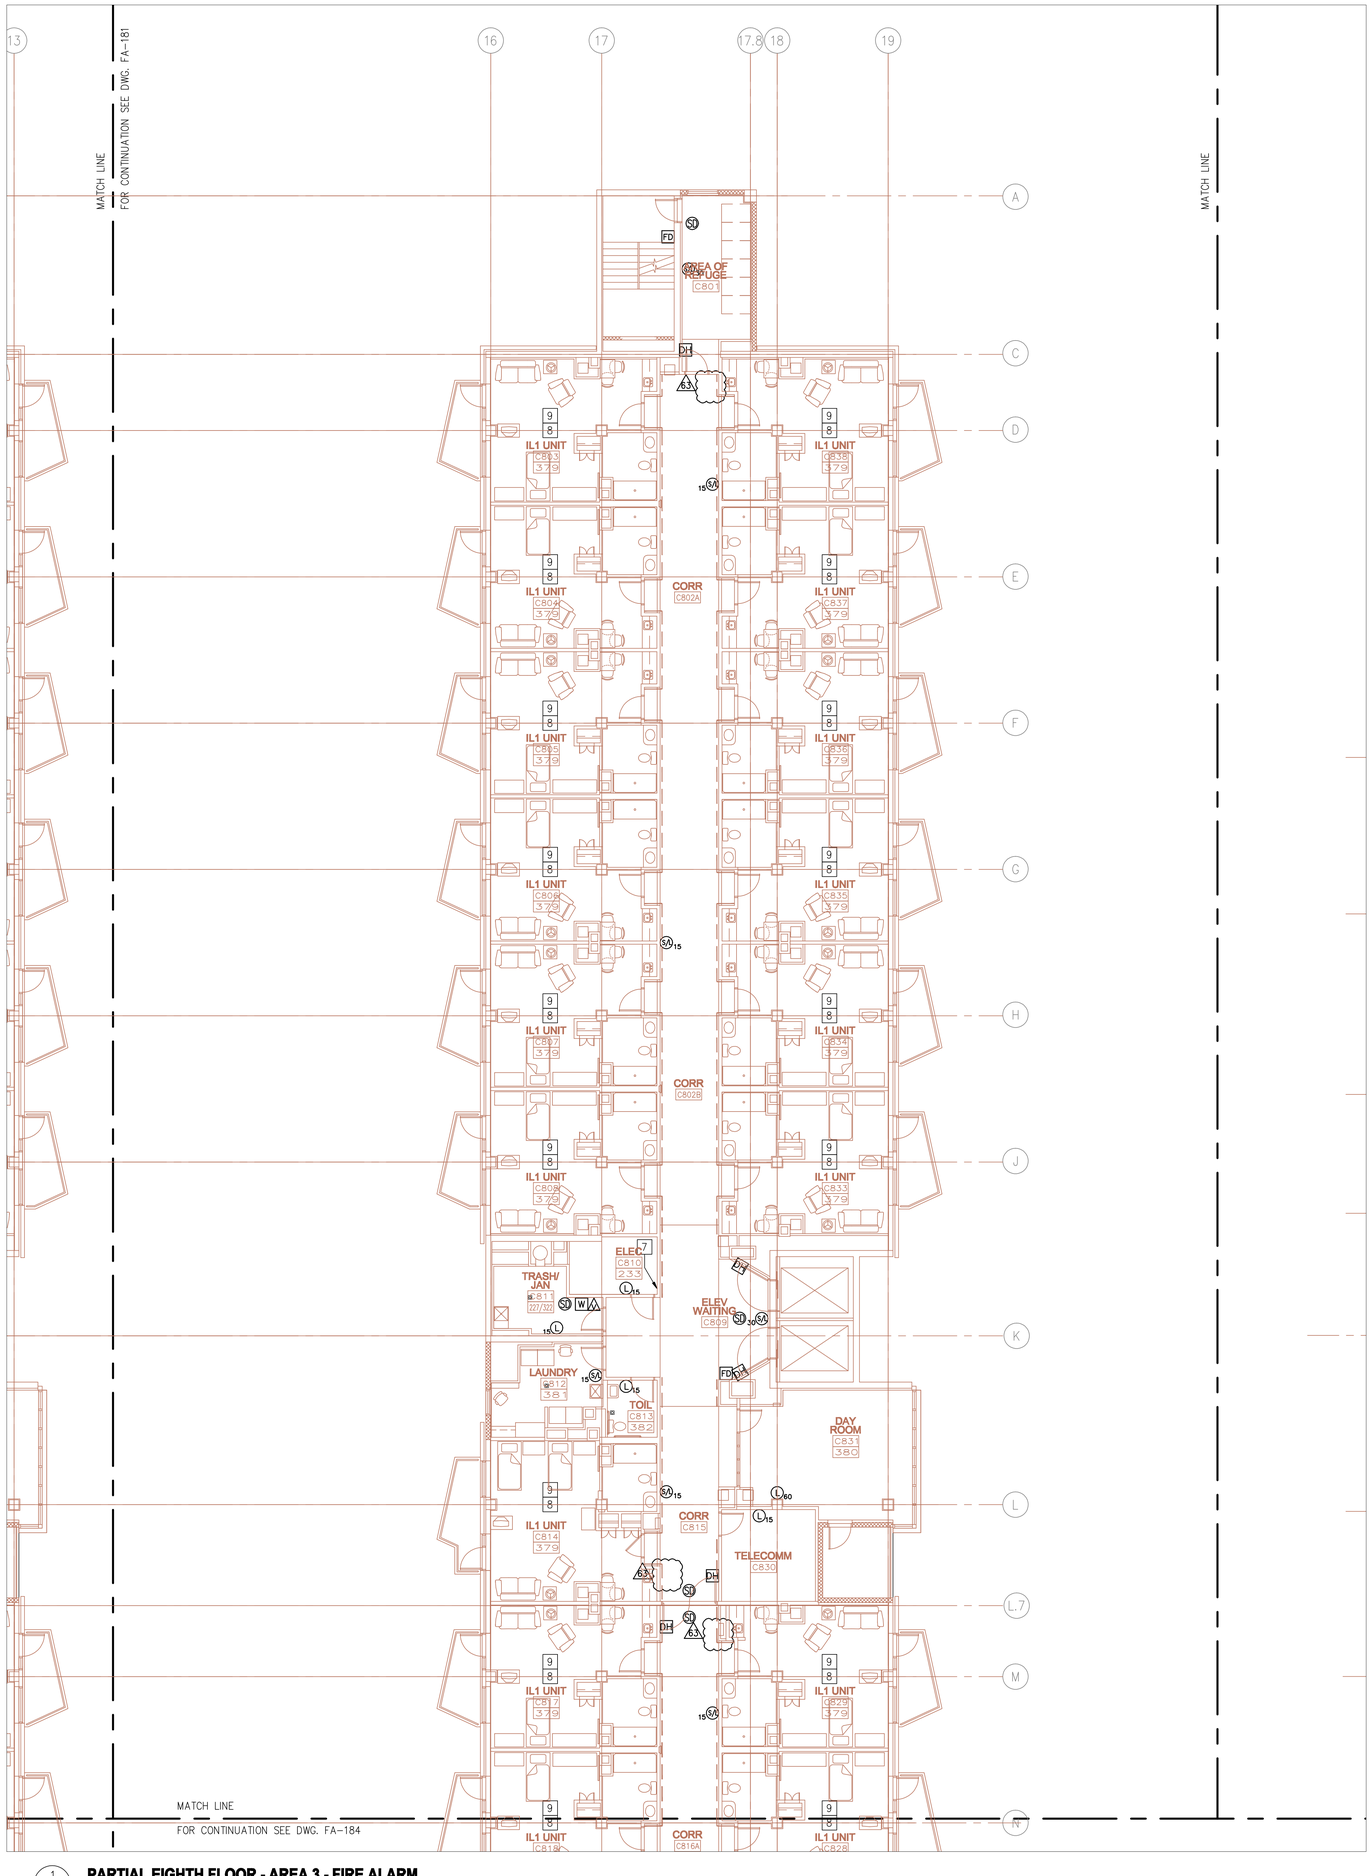

1 FA183 FA183 **PARTIAL EIGHTH FLOOR - AREA 3 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 / 63 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

CERTIFICATIONS

JOSHUA HATHAWAY — SPECIFICATIONS WRITER — ENGINEER — 16355 — STATE OF MISSISSIPPI — 2009.04.17

KEY PLAN

N

AREA 3
EIGHTH FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
2	09/08/08	ISSUED FOR CONSTRUCTION
3	04/17/09	ARCHITECTURAL & MEP REVISIONS

DRAWING SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PART 8 FL PLAN – AREA 3 – FIRE ALARM
FILE NAME	FA-183-N0095730.DWG
FLOOR NO.	EIGHTH FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 83 DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

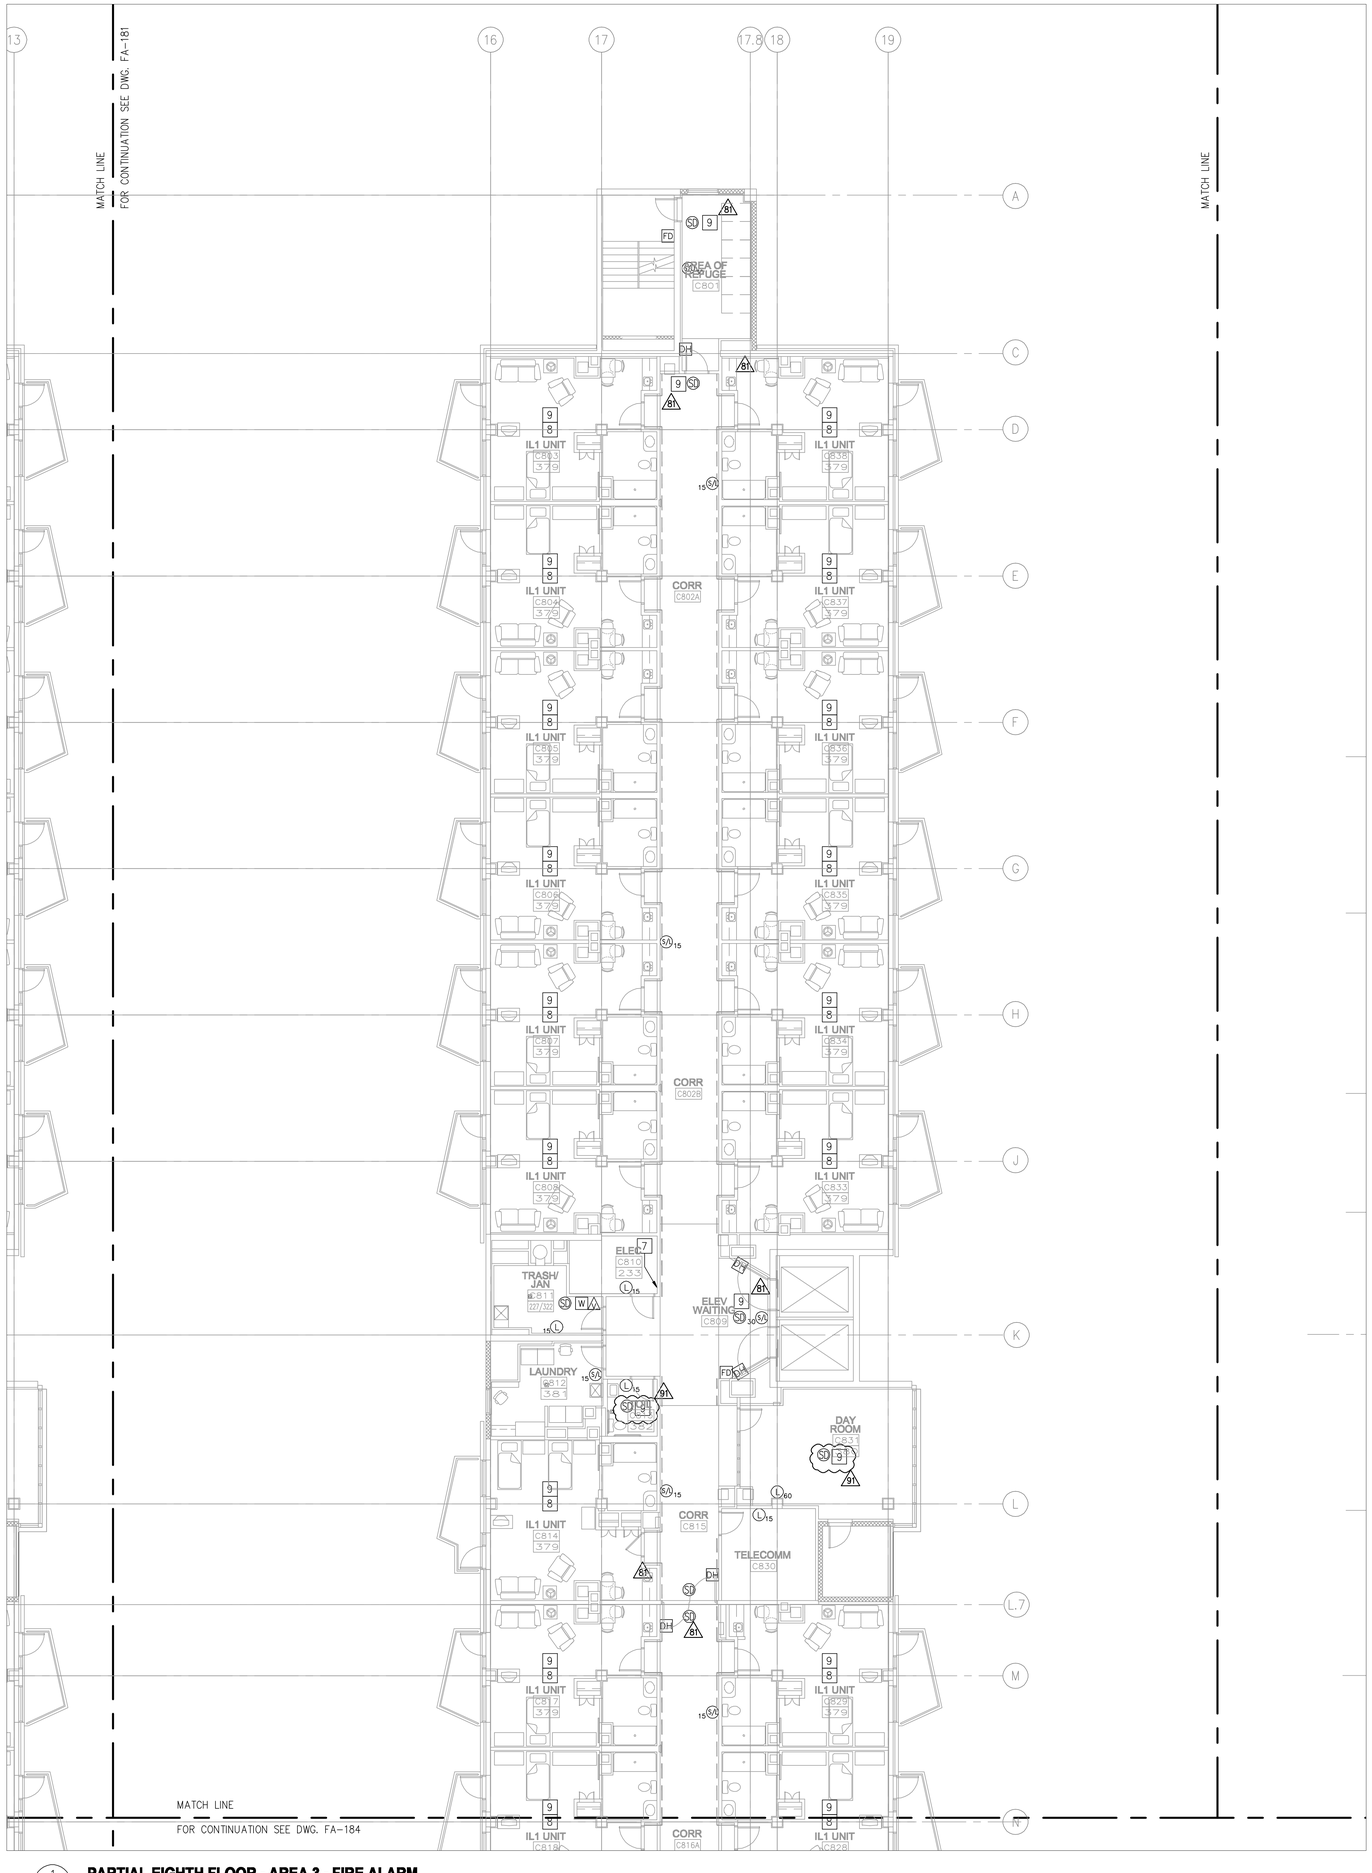

1 FA183 FA183 **PARTIAL EIGHTH FLOOR - AREA 3 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

7 DEDICATED LOCATION FOR FIRE ALARM TERMINAL CABINET.

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

CERTIFICATIONS

STATE OF MISSISSIPPI — REGISTERED PROFESSIONAL ENGINEER — 18365 — 11/4/09

KEY PLAN

AREA 3
EIGHTH FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS
3	07/10/09	FIRE PROTECTION & SPEC REV
4	11/04/09	FIRE ALARM CHANGES

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PART 8 FL PLAN – AREA 3 – FIRE ALARM
FILE NAME	FA-183-N0095730.DWG
FLOOR NO.	EIGHTH FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 83 DISCIPLINE SHEET TYPE SEQUENCE SHEET OF –

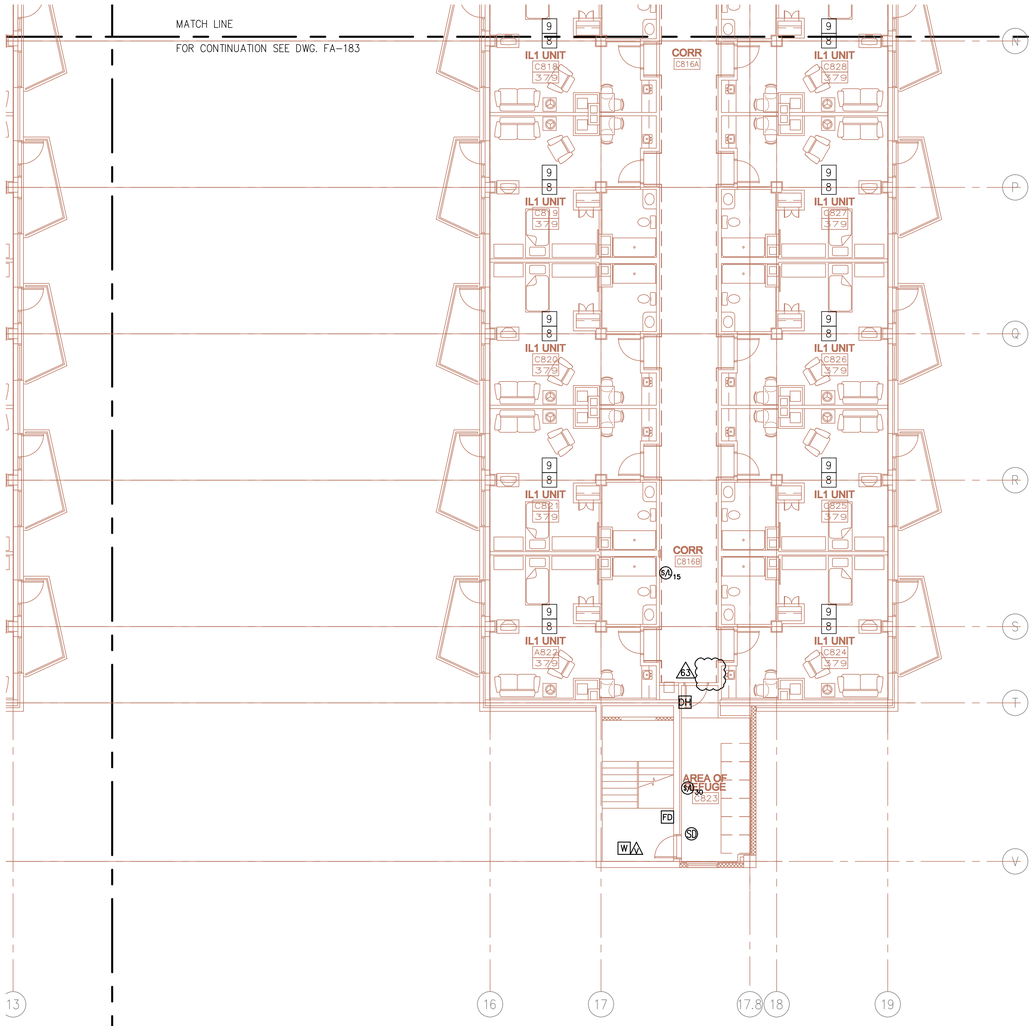

1 FA184 FA184 **PARTIAL EIGHTH FLOOR - AREA 4 - FIRE ALARM**
1/8"=1'-0"

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 6.3 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

CERTIFICATIONS

KEY PLAN



AREA 4
EIGHTH FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PART 8 FL PLAN - AREA 4 - FIRE ALARM
FILE NAME	FA-184-N0095730.DWG
FLOOR NO.	EIGHTH FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 84 (DISCIPLINE SHEET TYPE SEQUENCE)
	SHEET OF -

PROPERTY OF THE UNITED STATES GOVERNMENT - FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

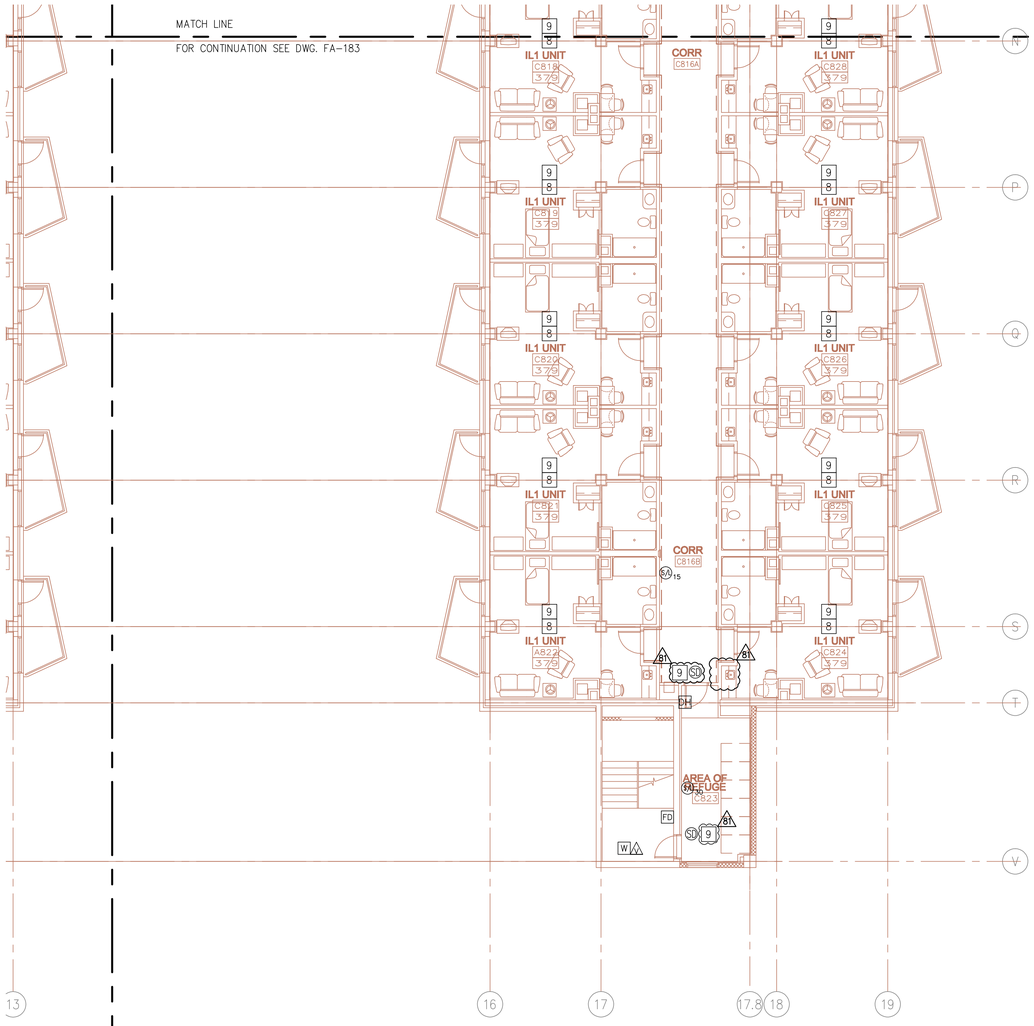

1 FA184 / FA184 **PARTIAL EIGHTH FLOOR - AREA 4 - FIRE ALARM**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

8 PROVIDE TYPICAL DWELLING UNIT FIRE ALARM LAYOUT.

9 / 81 ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

CERTIFICATIONS

KEY PLAN



AREA 4
EIGHTH FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS
3	07/10/09	FIRE PROTECTION & SPEC REV

GRAPHIC SCALE



1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PART 8 FL PLAN – AREA 4 – FIRE ALARM
FILE NAME	FA-184-N0095730.DWG
FLOOR NO.	EIGHTH FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	SH SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 84

DISCIPLINE SHEET TYPE SEQUENCE
SHEET OF –

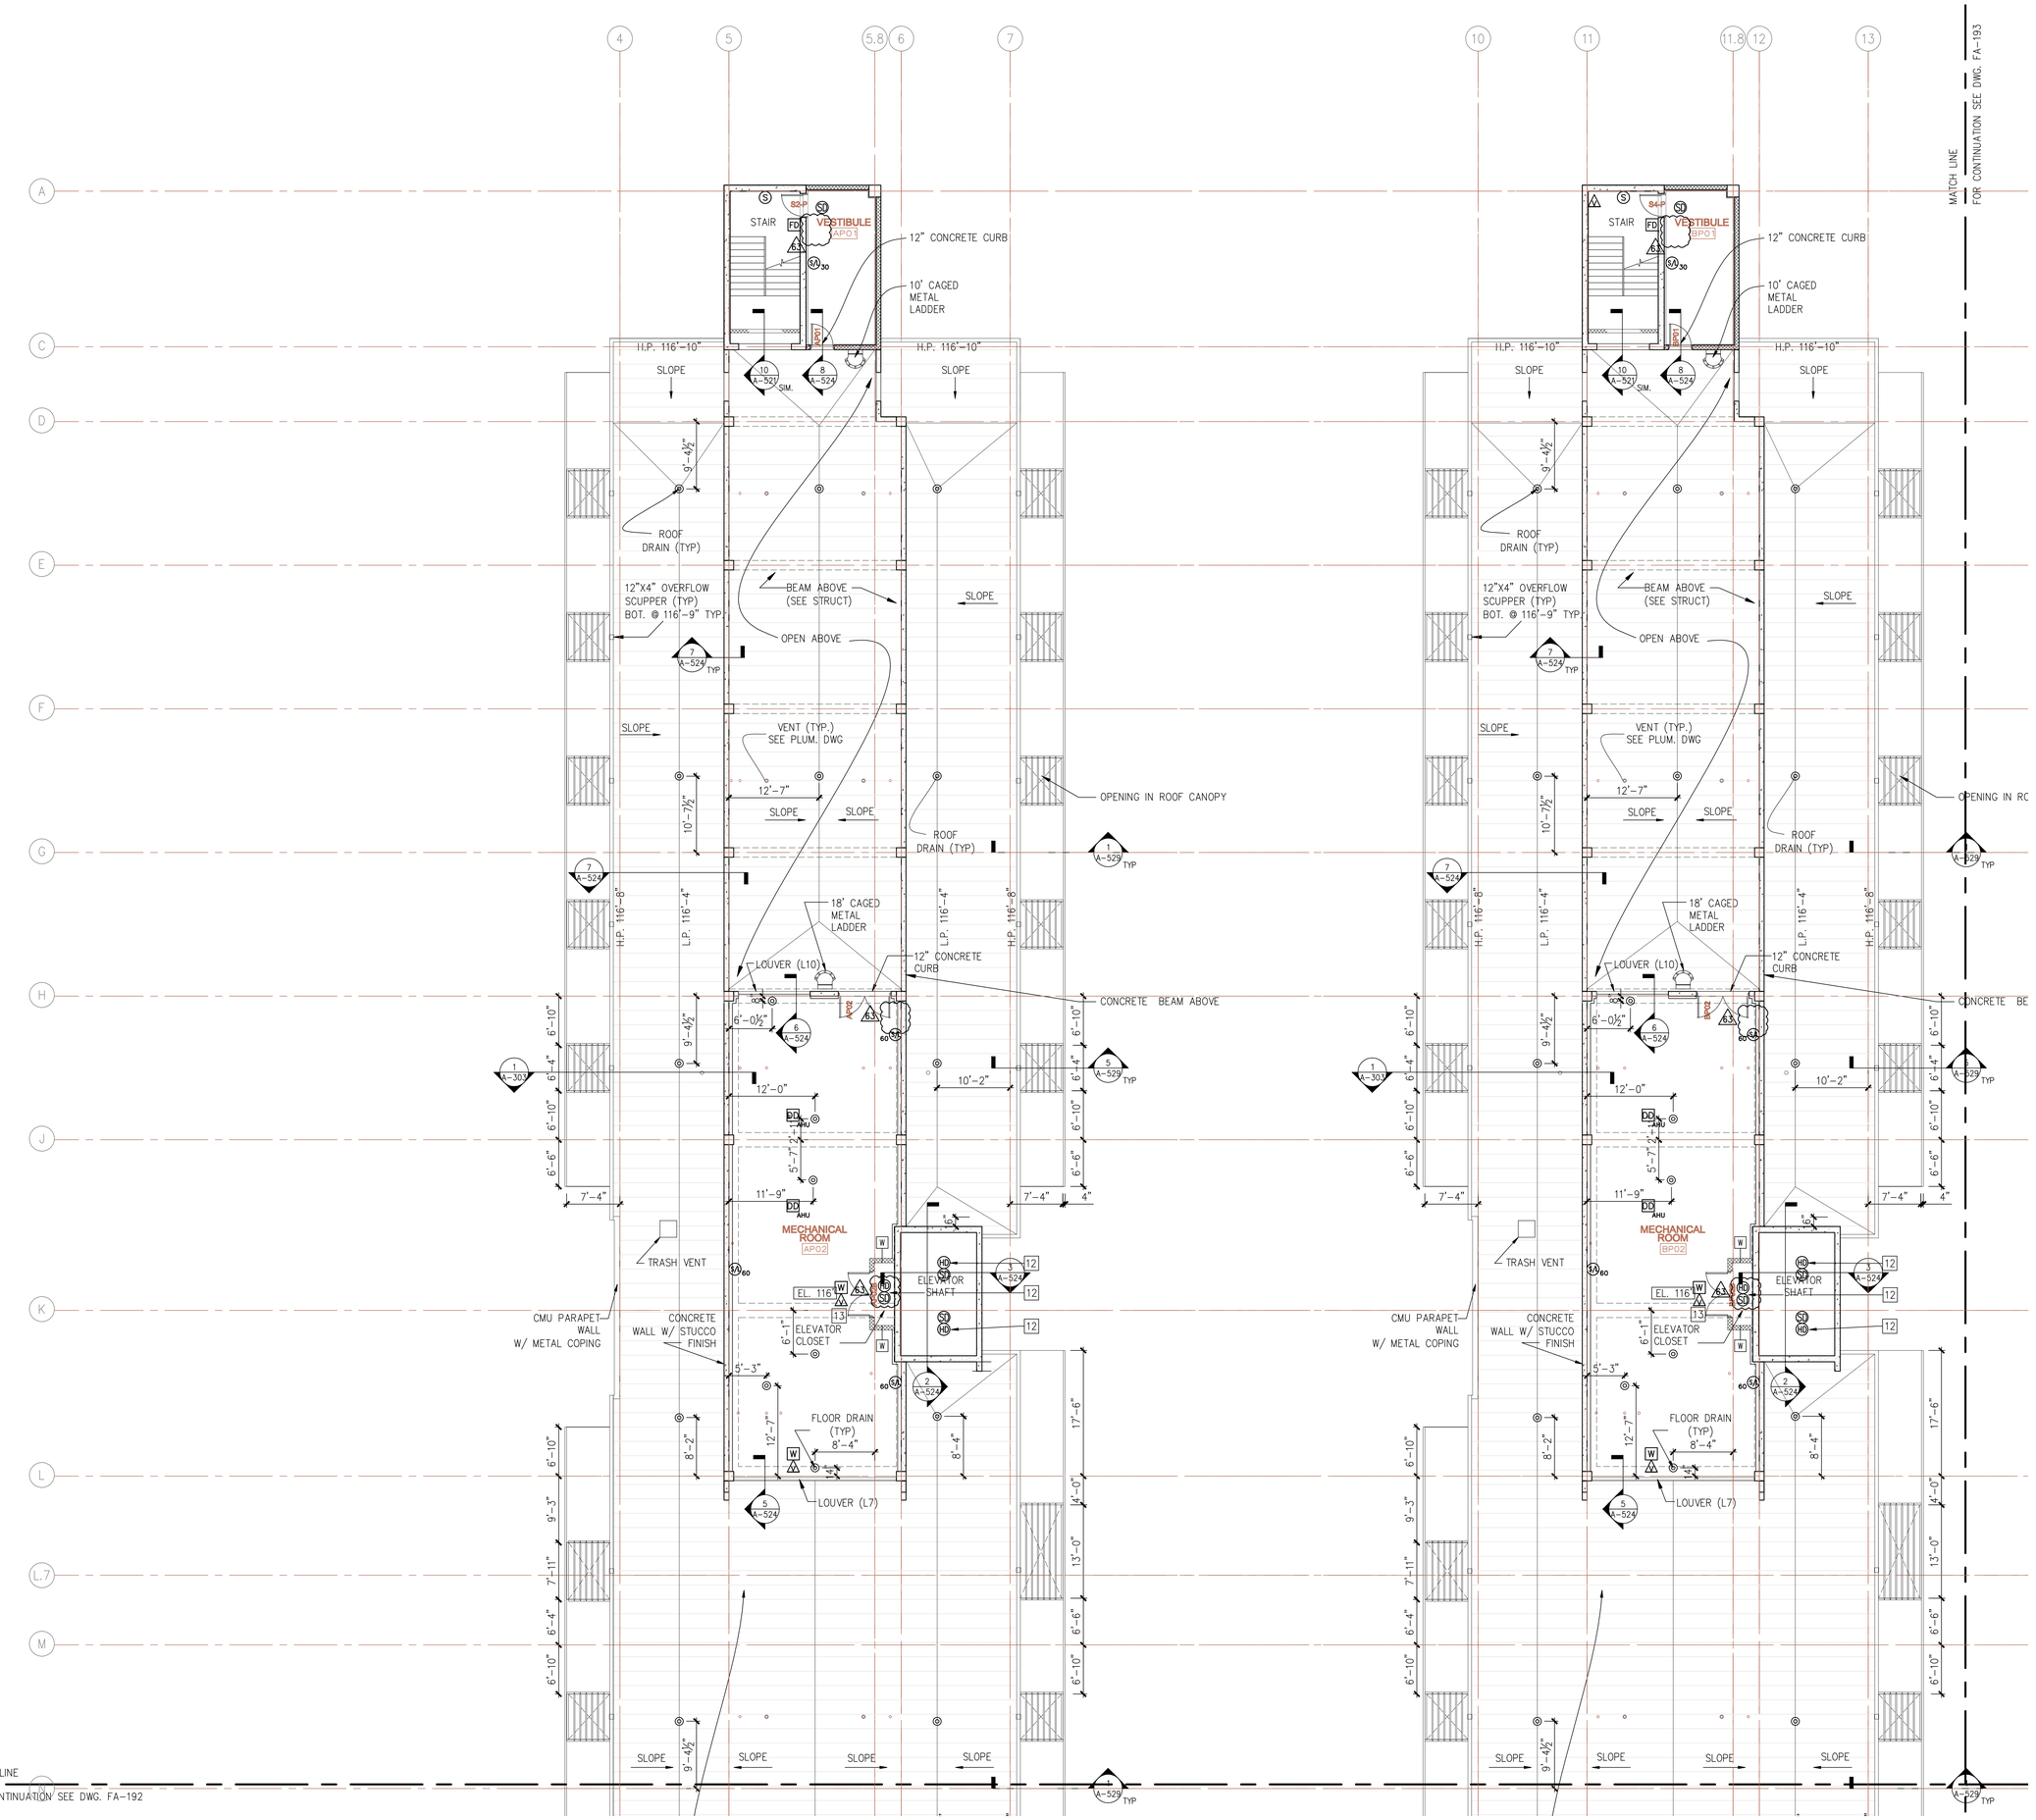

1 FA191 FA191 **PARTIAL ROOF PLAN - AREA 1**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

12 HEAT DETECTOR SHALL BE WITHIN 18" OF FIRE SPRINKLER.

13 THE WATER FLOW ALARAM AND HEAT DETECTOR SHALL AUTOMATICALLY DISCONNECT THE MAINELINE POWER TO THE ASSOCIATED ELEVATORS.

6.3

CERTIFICATIONS

DWANE HATTAWAY
REGISTERED PROFESSIONAL
ENGINEER
16355
STATE OF MISSISSIPPI
2009.04.17

KEY PLAN

AREA 1
ROOF PLAN

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PARTIAL ROOF PLAN – AREA 1
FILE NAME	FA-191-N0095730.DWG
FLOOR NO.	ROOF PLAN
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	DP/BB SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 91
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

1 FA191 FA191 **PARTIAL ROOF PLAN - AREA 1**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

2 HEAT DETECTOR SHALL BE WITHIN 18" OF FIRE SPRINKLER.

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

KEY PLAN



AREA 1
ROOF PLAN

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PARTIAL ROOF PLAN – AREA 1
FILE NAME	FA-191-N0095730.DWG
FLOOR NO.	ROOF PLAN
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	DP/BB SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 91
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

MATCH LINE
FOR CONTINUATION SEE DWG. FA-191

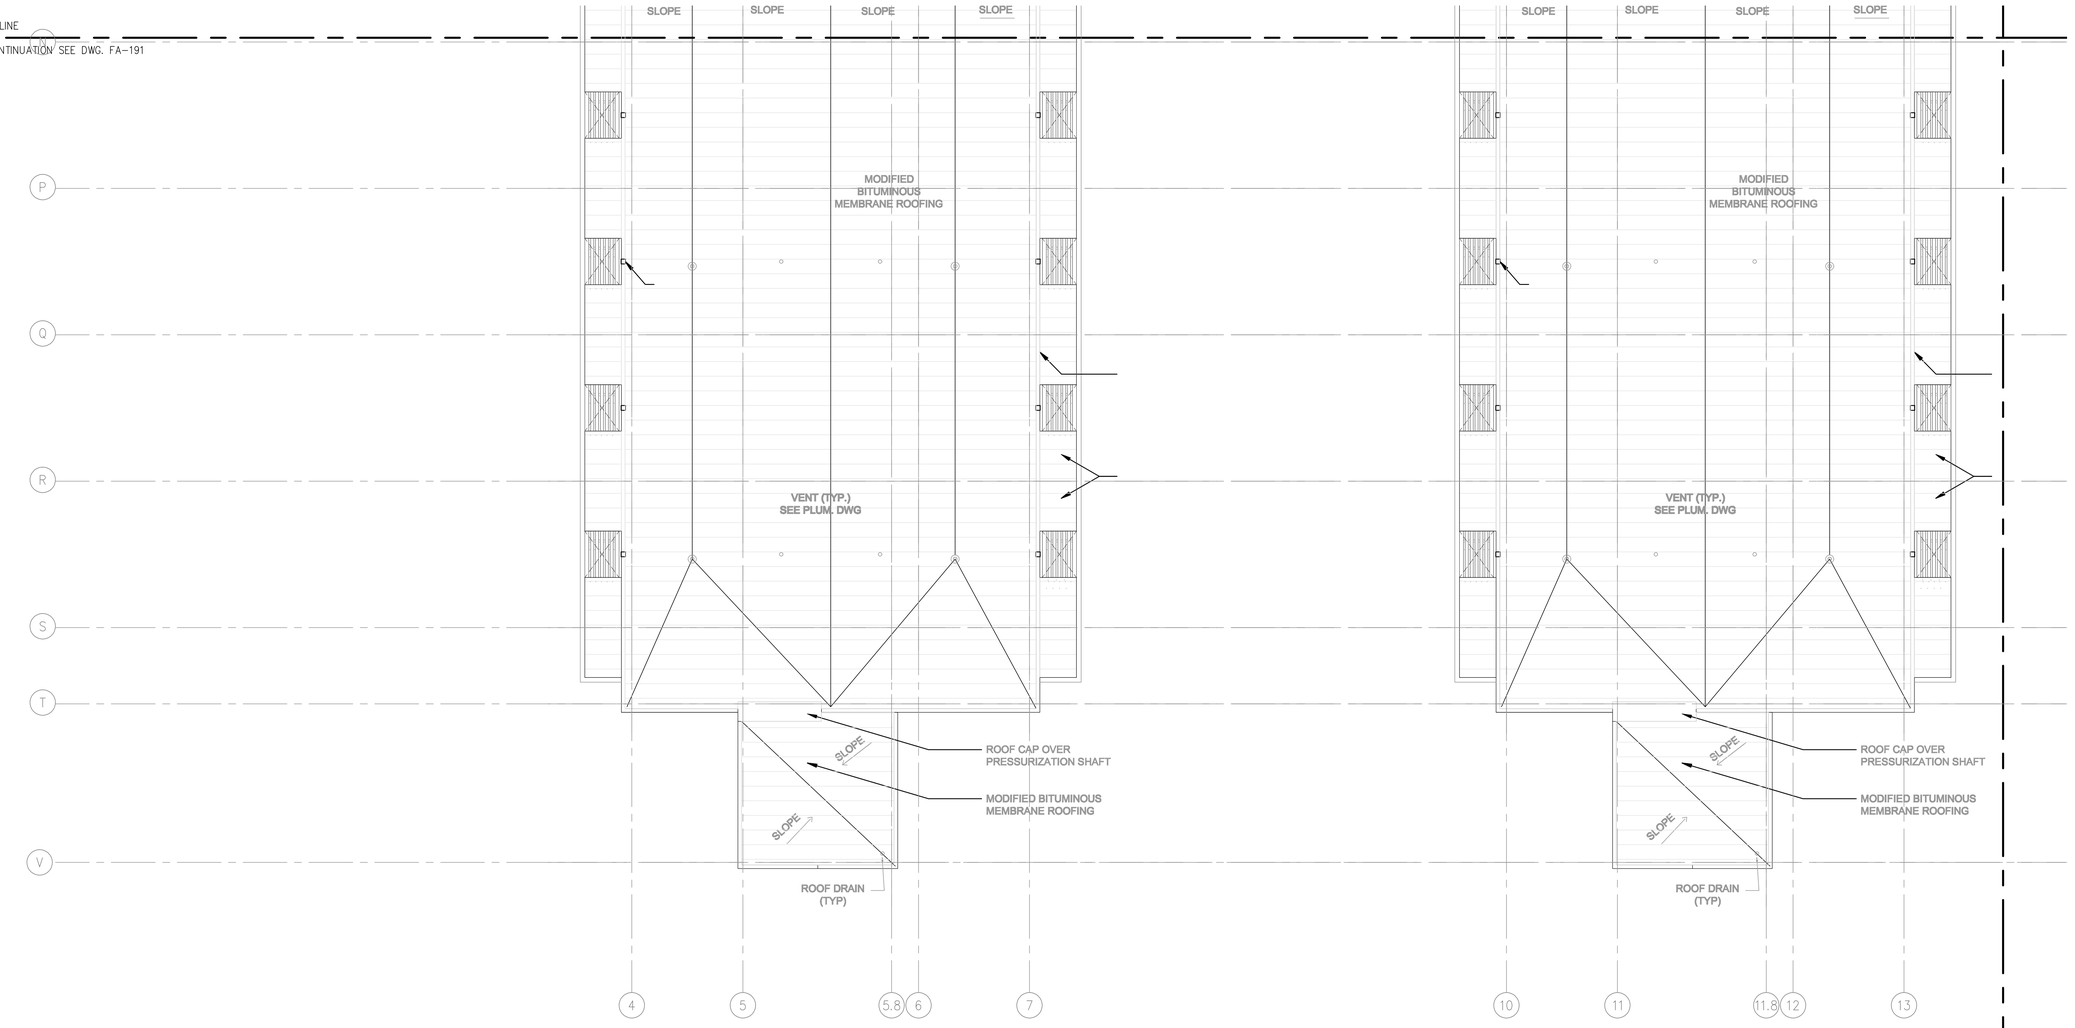

MATCH LINE
FOR CONTINUATION SEE DWG. FA-194

1 FA192/FA192 **PARTIAL ROOF PLAN - AREA 2**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

KEY PLAN



AREA 2
ROOF PLAN

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PARTIAL ROOF PLAN – AREA 2
FILE NAME	FA-192-N0095730.DWG
FLOOR NO.	ROOF PLAN
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	DP/BB SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 92
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

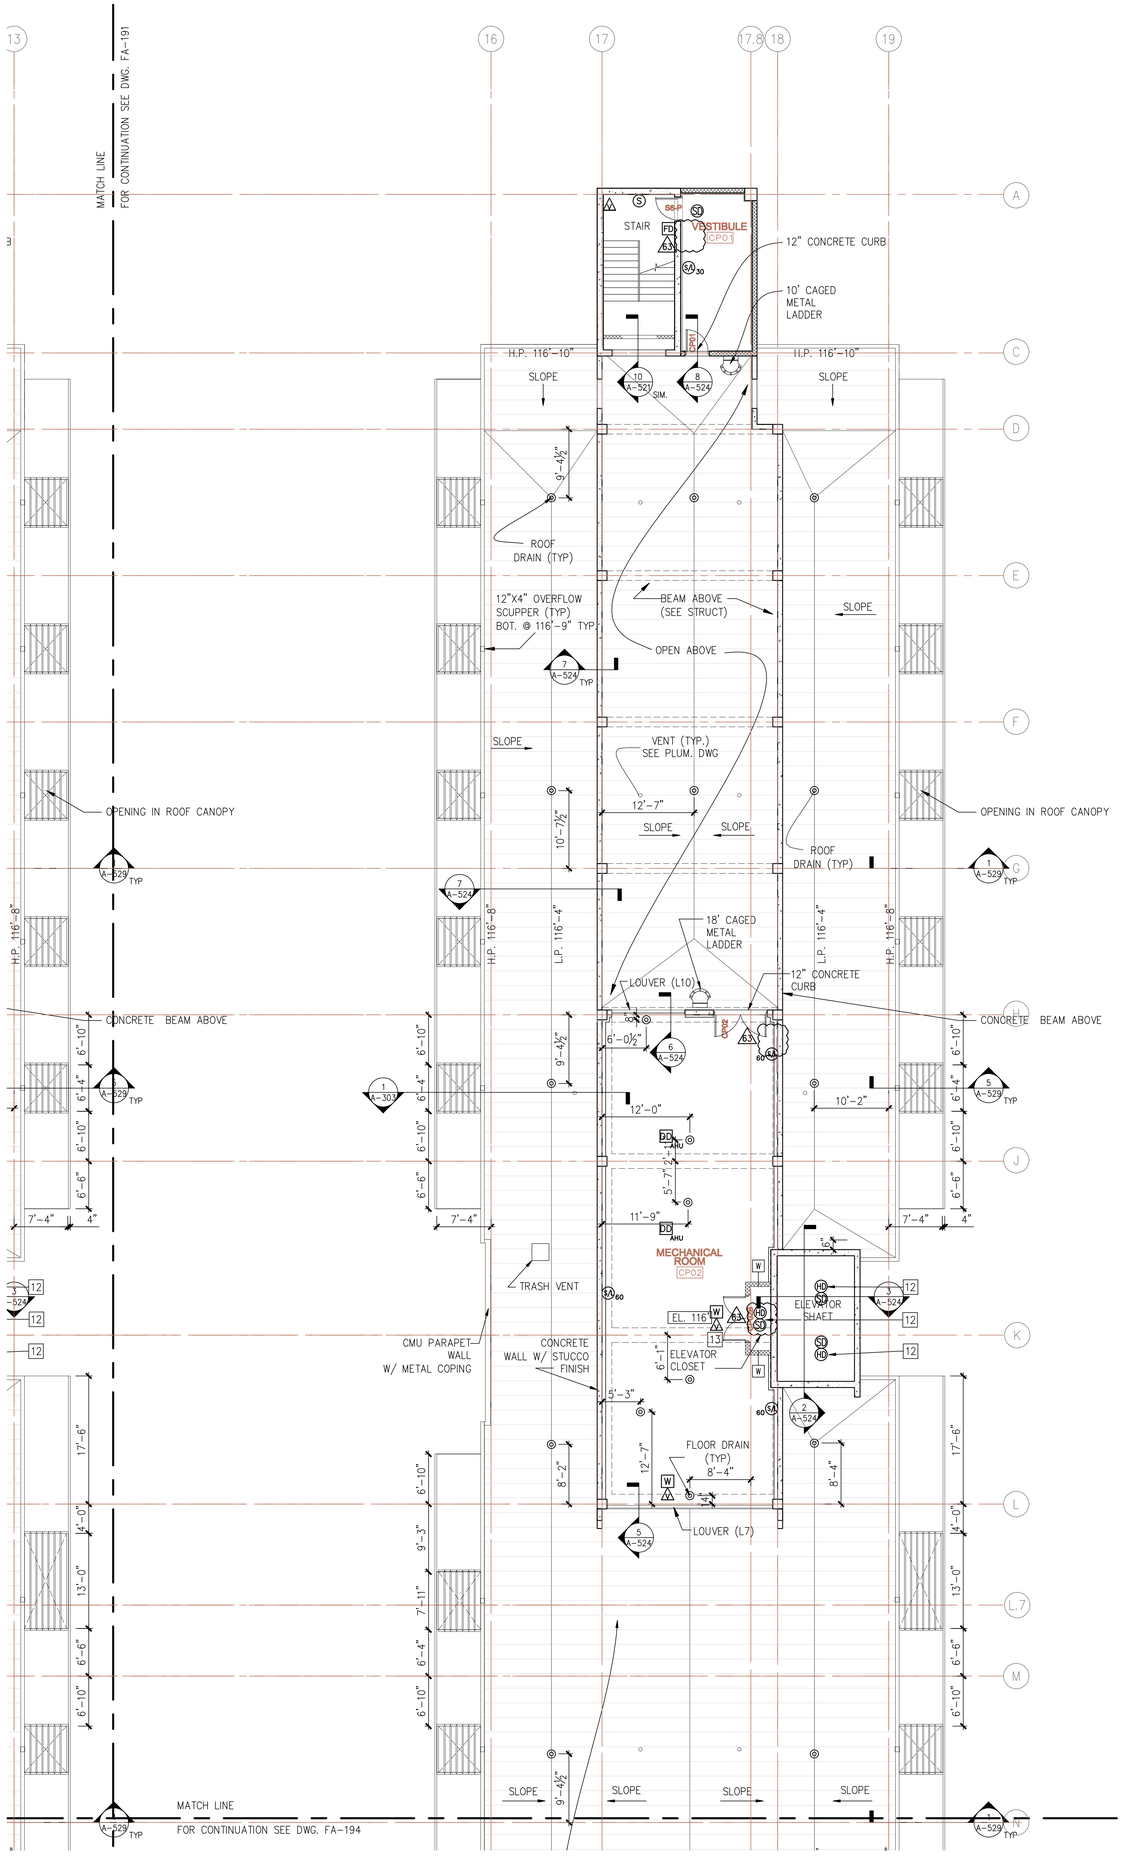

PARTIAL ROOF PLAN - AREA 3

1 FA193/FA193 1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

12 HEAT DETECTOR SHALL BE WITHIN 18" OF FIRE SPRINKLER.

13 THE WATER FLOW ALARAM AND HEAT DETECTOR SHALL AUTOMATICALLY DISCONNECT THE MAINELINE POWER TO THE ASSOCIATED ELEVATORS.

CERTIFICATIONS

JOHANNE HATHORNE — REGISTERED PROFESSIONAL ENGINEER — 16355 — STATE OF MISSISSIPPI — 2009.04.17

KEY PLAN

AREA 3
ROOF PLAN

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

DRAWING SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PARTIAL ROOF PLAN – AREA 3
FILE NAME	FA-193-N0095730.DWG
FLOOR NO.	ROOF PLAN
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	DP/BB SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 93
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

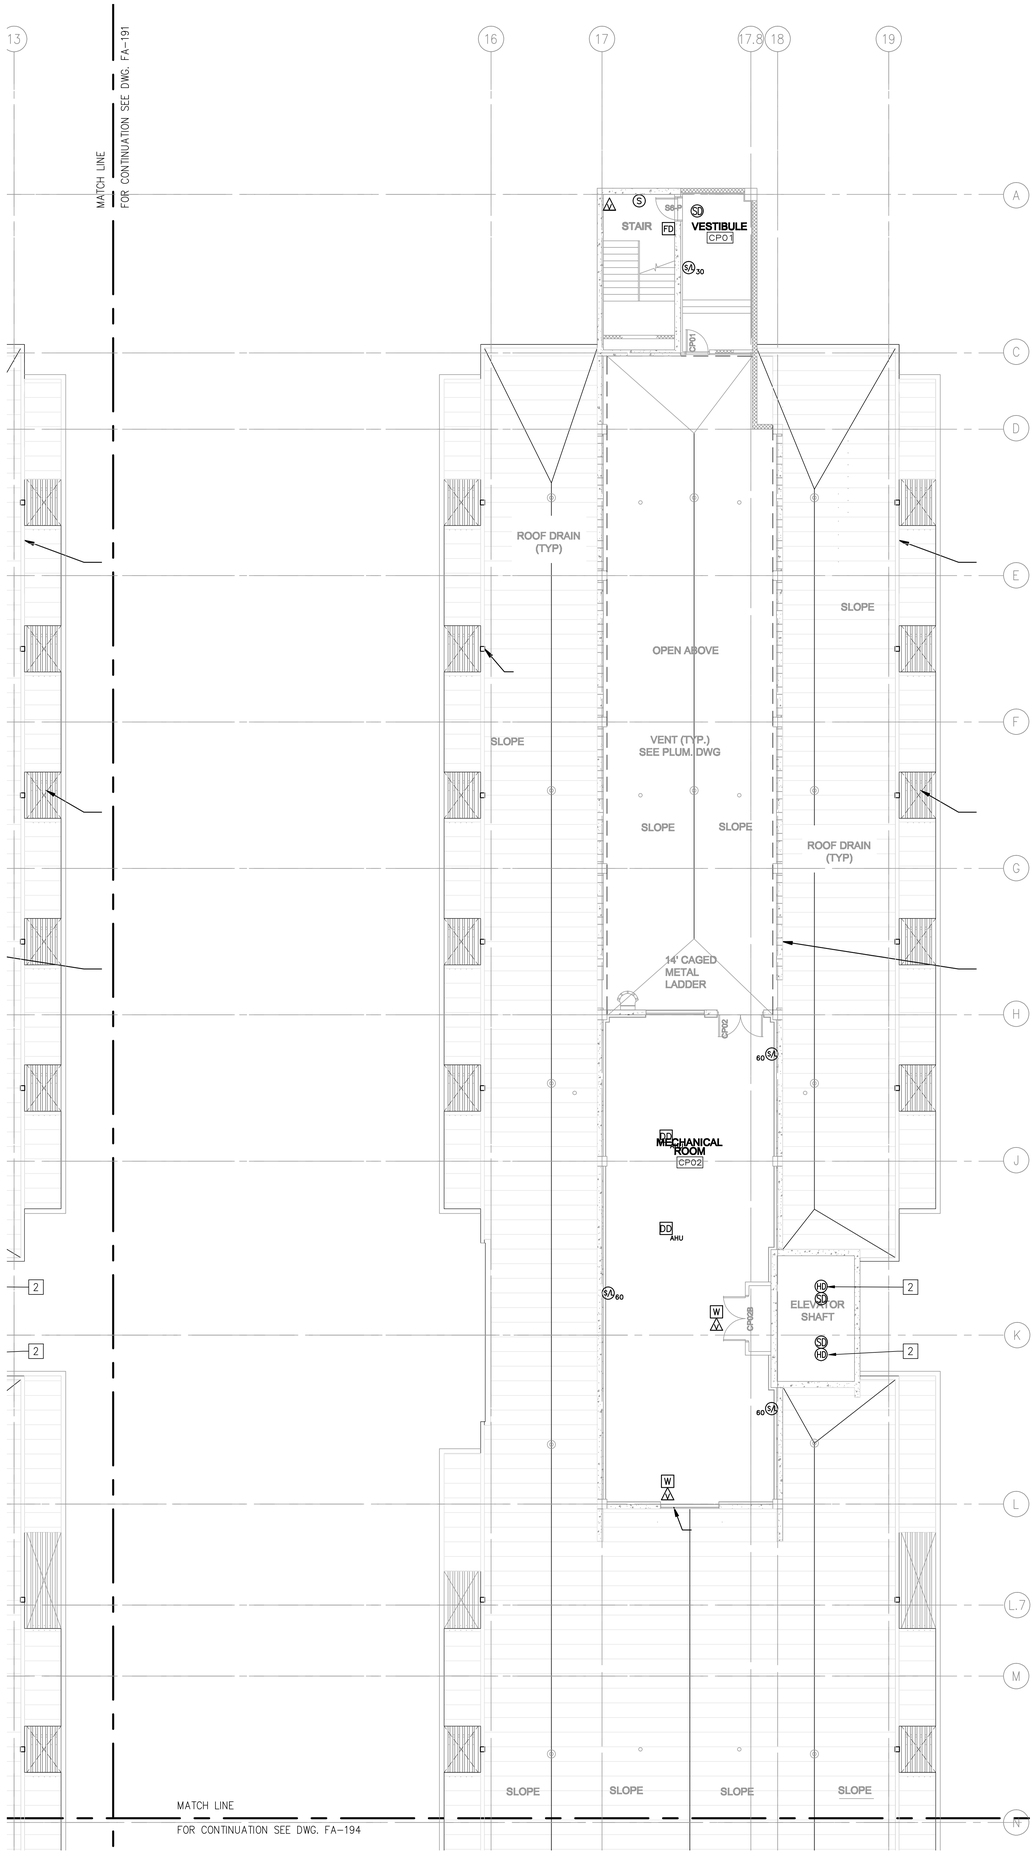

1 FA193/FA193 **PARTIAL ROOF PLAN - AREA 3**

1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

2 HEAT DETECTOR SHALL BE WITHIN 18" OF FIRE SPRINKLER.

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

KEY PLAN

AREA 3
ROOF PLAN

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE

0 4 8 16

1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PARTIAL ROOF PLAN – AREA 3
FILE NAME	FA-193-N0095730.DWG
FLOOR NO.	ROOF PLAN
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	DP/BB SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 93
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

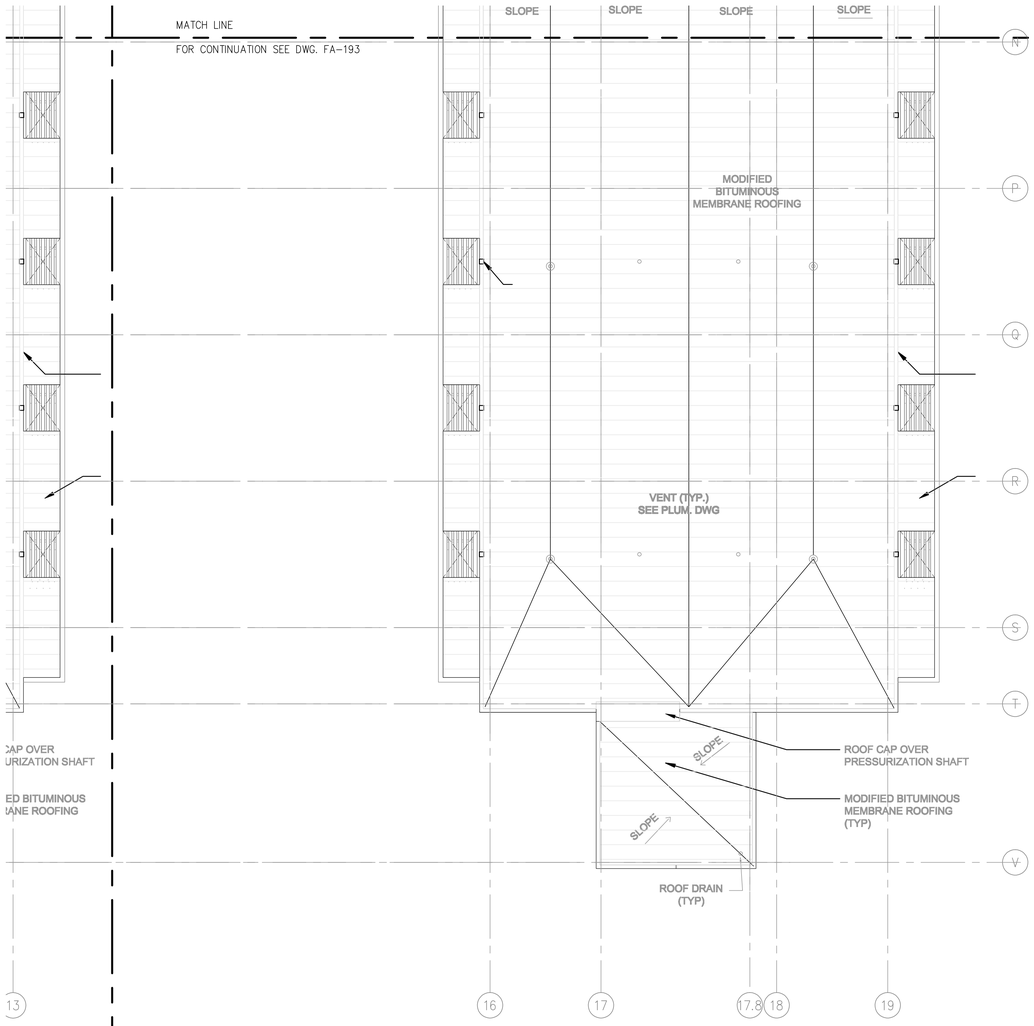

MATCH LINE
FOR CONTINUATION SEE DWG. FA-192

1 FA194 FA194 **PARTIAL ROOF PLAN - AREA 4**
1/8"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

KEY PLAN

AREA 4
ROOF PLAN

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE

0 4 8 16
1/8" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	PARTIAL ROOF PLAN – AREA 4
FILE NAME	FA-194-N0095730.DWG
FLOOR NO.	ROOF FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	DP/BB SHEET SIZE: 34 X 44
DRAWING NO.	FA 1 94
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

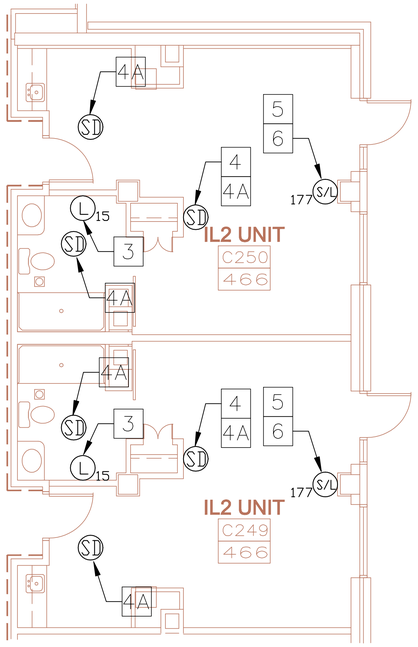

2 FA401 FA401 **TYPICAL IL2 UNIT FIRE ALARM PLAN**
1/4"=1'-0"

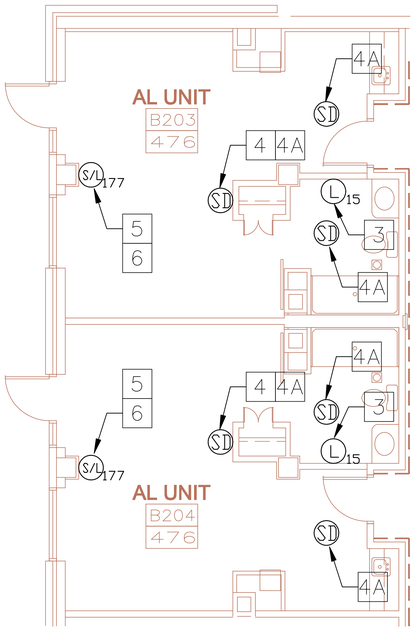

1 FA401 FA401 **TYPICAL AL UNIT FIRE ALARM PLAN**
1/4"=1'-0"

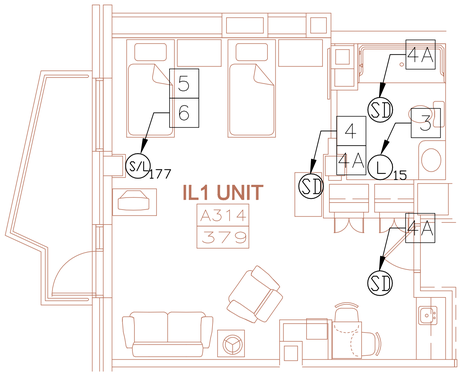

3 FA401 FA401 **TYPICAL IL1 UNIT FIRE ALARM PLAN**
1/4"=1'-0"

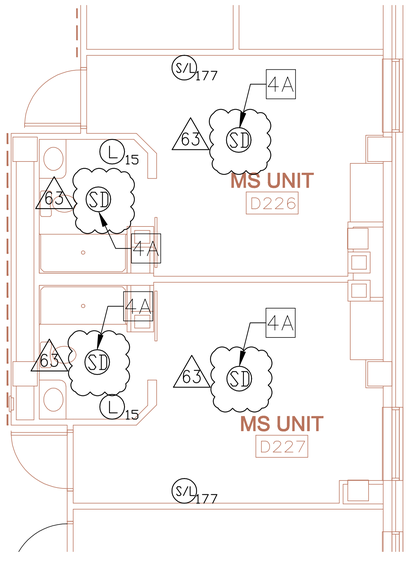

4 FA401 FA401 **TYPICAL MS UNIT FIRE ALARM PLAN**
1/4"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans
JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

3 PROVIDE STROBE IN BATHROOM

4 PROVIDE SIDEWALL MOUNTED SMOKE DETECTOR WITH SOUNDER BASE (CENTER DEVICE ON WALL).

4A ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

5 PROVIDE SIDEWALL MOUNTED SPEAKER/STROBE (CENTER DEVICE ON COLUMN).

6 SPEAKER/STROBE SHALL ANNUNCIATE UPON ACTIVATION OF THE BUILDING FIRE ALARM SYSTEM.

CERTIFICATIONS

KEY PLAN

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION
2	04/17/09	ARCHITECTURAL & MEP REVISIONS

GRAPHIC SCALE

0 2 4 8
1/4" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	TYPICAL UNIT FIRE ALARM PLAN
FILE NAME	FA-401.DWG
FLOOR NO.	
DRAWN BY	INR
DATE DRAFTED:	
CHECKED BY	XX
SHEET SIZE:	34 X 44
DRAWING NO.	FA 4 01
DISCIPLINE SHEET TYPE SEQUENCE	
SHEET	OF –

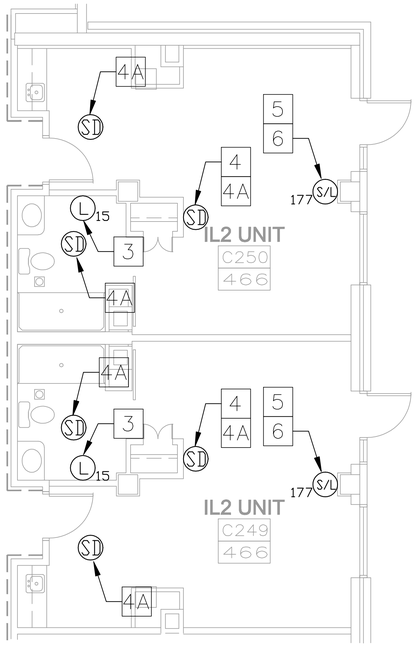

2 FA401 FA401 **TYPICAL IL2 UNIT FIRE ALARM PLAN**
1/4"=1'-0"

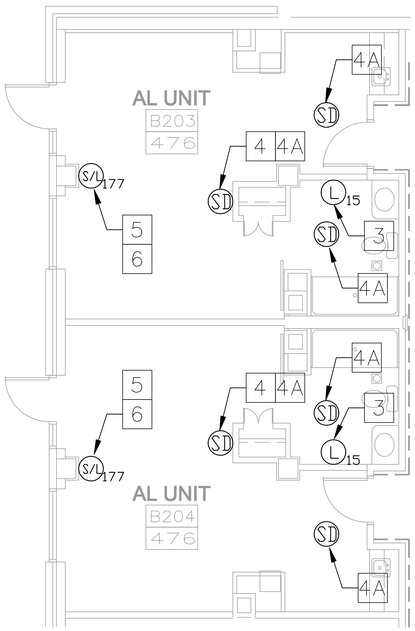

1 FA401 FA401 **TYPICAL AL UNIT FIRE ALARM PLAN**
1/4"=1'-0"

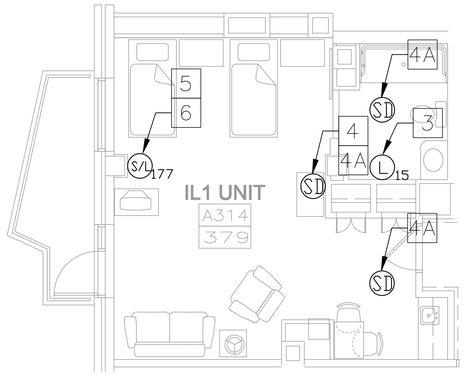

3 FA401 FA401 **TYPICAL IL1 UNIT FIRE ALARM PLAN**
1/4"=1'-0"

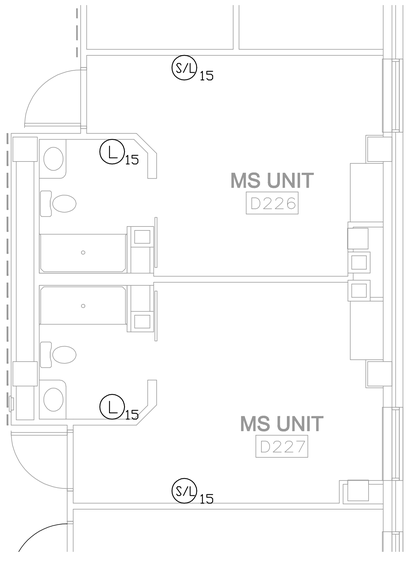

4 FA401 FA401 **TYPICAL MS UNIT FIRE ALARM PLAN**
1/4"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans
JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES:

3 PROVIDE STROBE IN BATHROOM

4 PROVIDE SIDEWALL MOUNTED SMOKE DETECTOR WITH SOUNDER BASE (CENTER DEVICE ON WALL).

4A ACTIVATION OF SMOKE DETECTOR SHALL CLOSE ALL FIRE/SMOKE DAMPERS SERVING THE UNIT (PER SECTION 716.3.2.1(5) OF THE 2006 IBC).

5 PROVIDE SIDEWALL MOUNTED SPEAKER/STROBE (CENTER DEVICE ON COLUMN).

6 SPEAKER/STROBE SHALL ANNUNCIATE UPON ACTIVATION OF THE BUILDING FIRE ALARM SYSTEM.

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

KEY PLAN

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE
0 2 4 8
1/4" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	TYPICAL UNIT FIRE ALARM PLAN
FILE NAME	FA-401.DWG
FLOOR NO.	
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	XX SHEET SIZE: 34 X 44
DRAWING NO.	FA 4 01
	DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

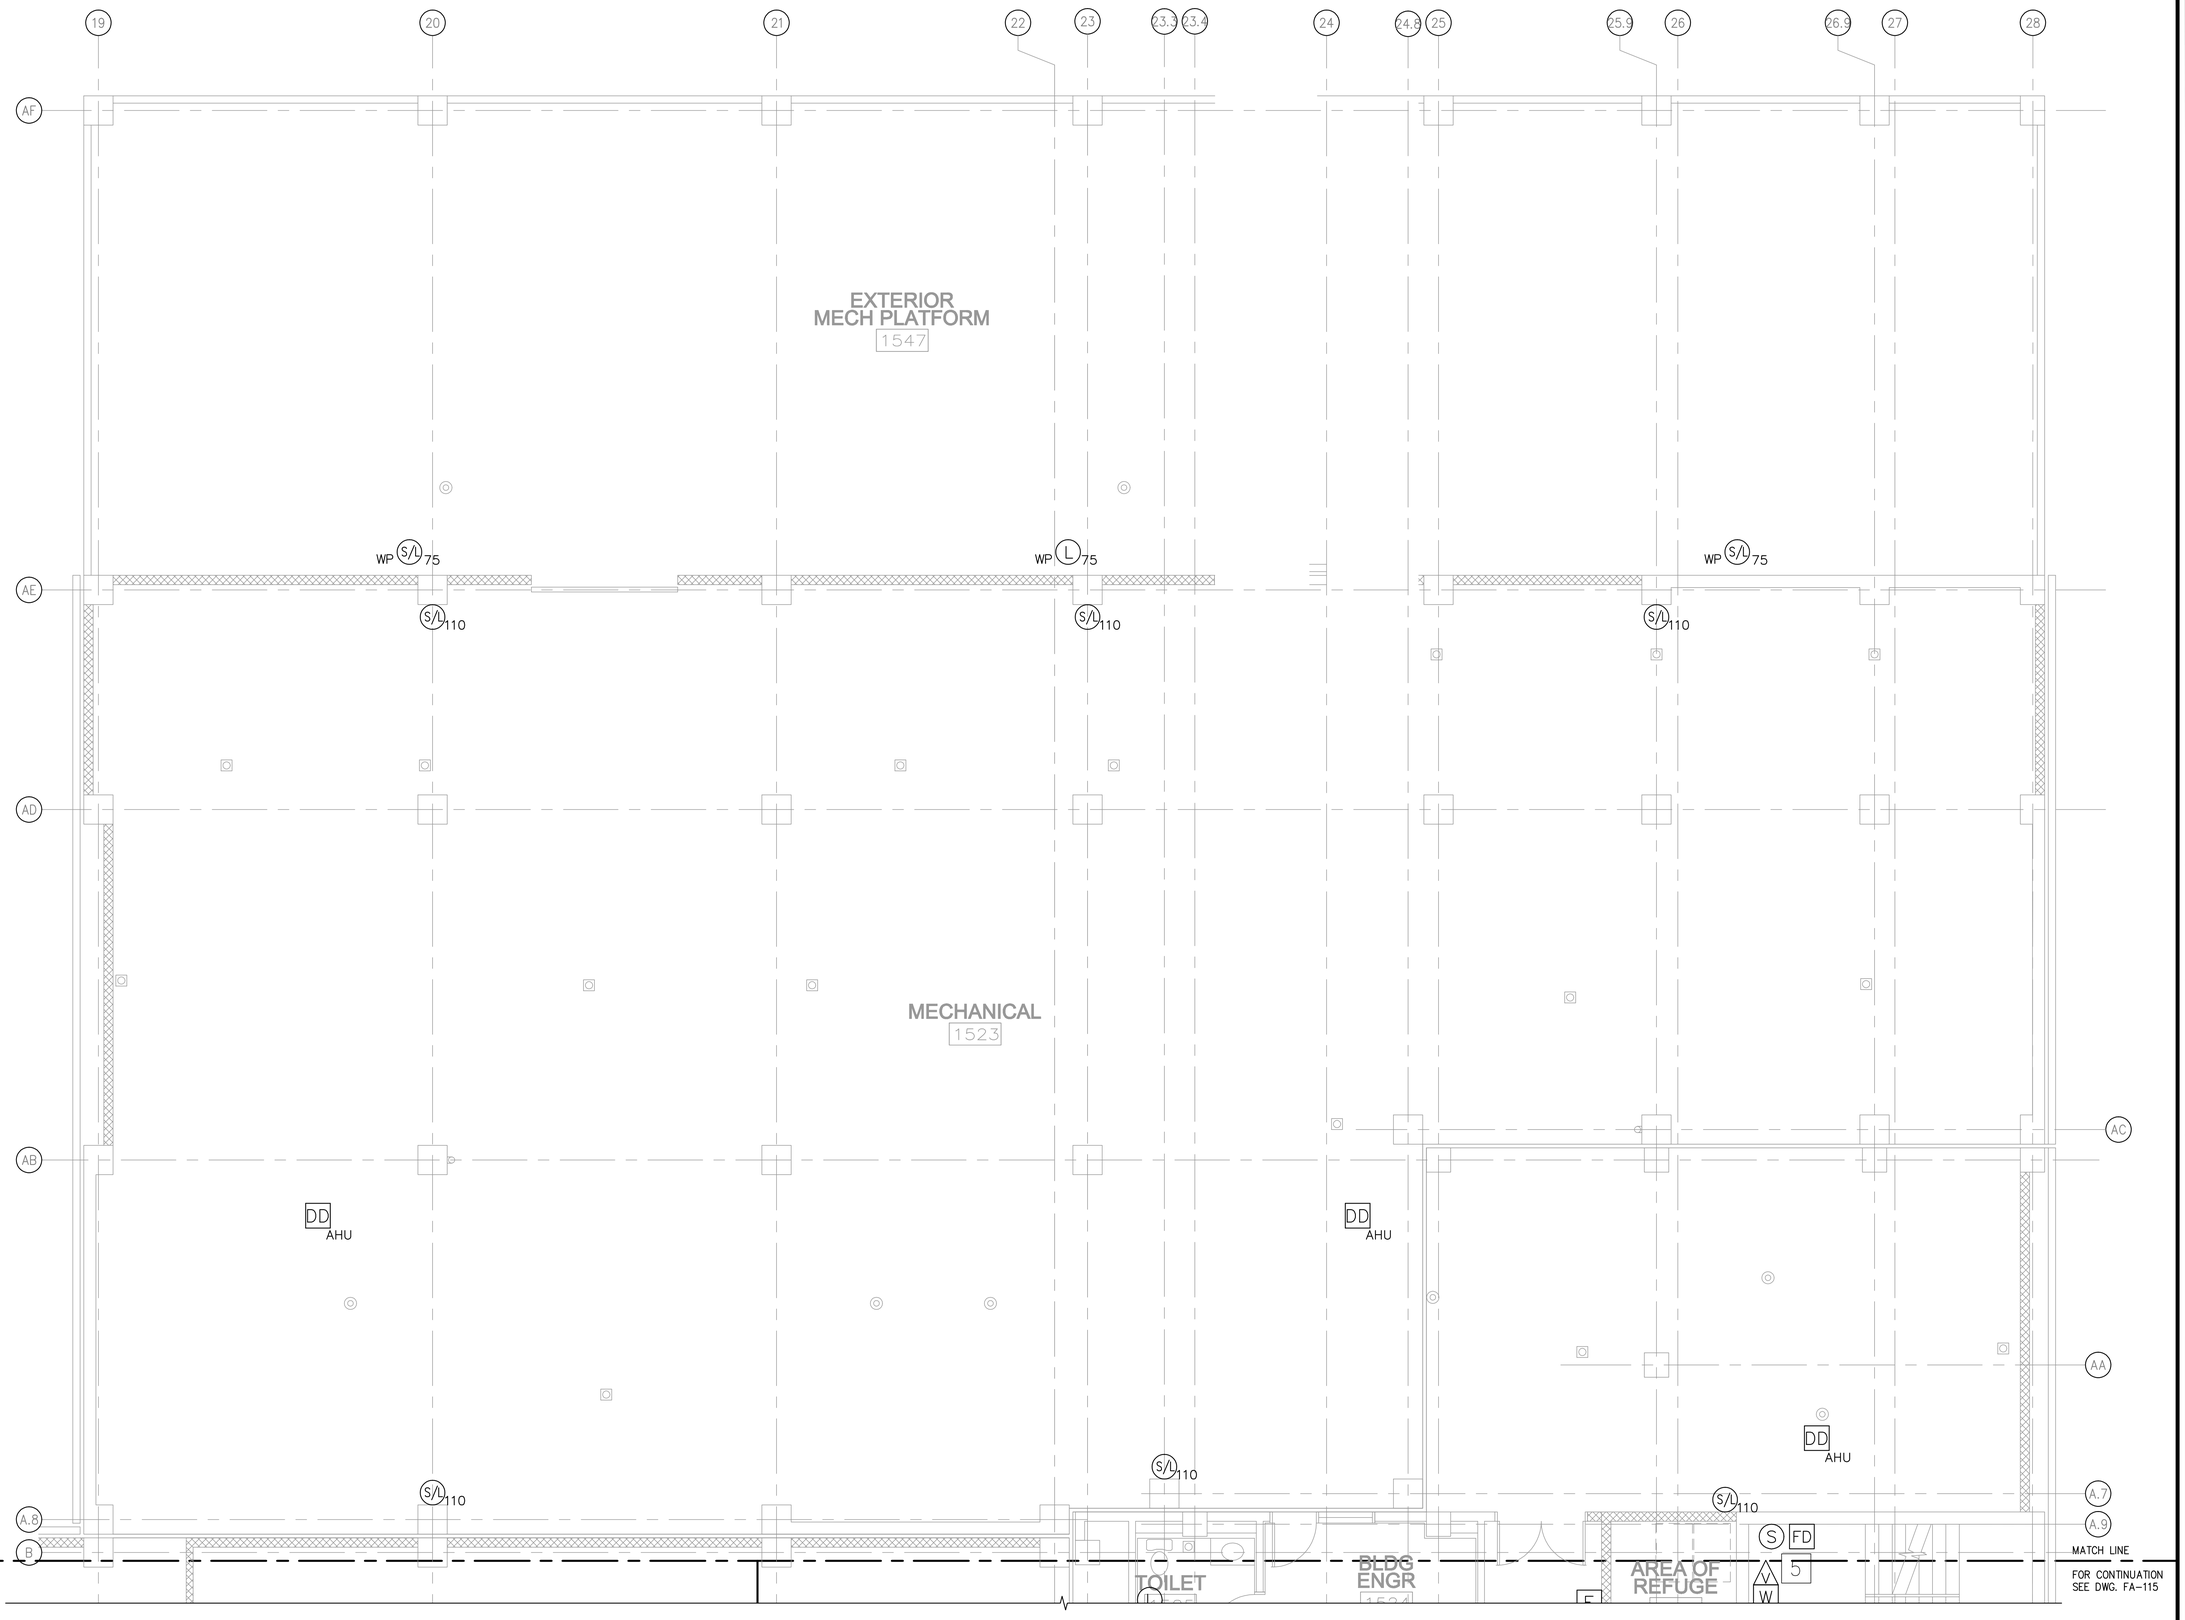

1 FA411 **ENLARGED FIRST FLOOR MECHANICAL ROOM NORTH**

1/4"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

KEY PLAN



NORTH
MECHANICAL ROOM
FIRST FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE

0 2 4 8

1/4" = 1'-0"

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	ENLGD FIRST FLR MECH RM N
FILE NAME	FA-411-N0095730.DWG
FLOOR NO.	FIRST FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	DP/BB SHEET SIZE: 34 X 44
DRAWING NO.	FA 4 11 DISCIPLINE SHEET TYPE SEQUENCE SHEET OF –

1 FA412 FA412 **ENLARGED FIRST FLOOR MECHANICAL ROOM EAST**
1/4"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

KEY PLAN

EAST
MECHANICAL ROOM
FIRST FLOOR

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER	
BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	ENLGD FIRST FLR MECH RM E
FILE NAME	FA-412-M0095730.DWG
FLOOR NO.	FIRST FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	DP/BB SHEET SIZE: 34 X 44
DRAWING NO.	FA 4 12 DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

1 FA413 FA413 **ENLARGED FIRST FLOOR MECHANICAL ROOM WEST**
1/4"=1'-0"

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

CODED NOTES

5 PROVIDE SPEAKERS IN STAIRS ON FLOORS 1,3,5 AND 7 IN THE LOCATION SHOWN. SPEAKER IN STAIR TO ANNUNCIATE "LIVE" MESSAGES MADE FROM FIRE COMMAND CENTER.

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

PAUL D. BRUCE 18055 ENGINEER STATE OF MISSISSIPPI 09.08.08

KEY PLAN



REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	ENLGD FIRST FLR MECH RM W
FILE NAME	FA-413-N0095730.DWG
FLOOR NO.	FIRST FLOOR
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	DP/BB SHEET SIZE: 34 X 44
DRAWING NO.	FA 4 13 DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –

	ALARM SIGNAL AT FIRE ALARM CONTROL PANEL AND ANNUNCIATOR	SUPERVISORY SIGNAL AT FIRE ALARM CONTROL PANEL AND ANNUNCIATOR	TROUBLE SIGNAL AT FIRE ALARM CONTROL PANEL AND ANNUNCIATOR	ACTIVATE COMMON AUDIO/VISUAL'S – PARKING GARAGE	ACTIVATE COMMON AUDIO/VISUAL'S – 1ST FLOOR	ACTIVATE COMMON AUDIO/VISUAL'S – 2ND FLOOR	ACTIVATE COMMON AUDIO/VISUAL'S – 3RD FLOOR	ACTIVATE COMMON AUDIO/VISUAL'S – 4TH FLOOR	ACTIVATE COMMON AUDIO/VISUAL'S – 5TH FLOOR	ACTIVATE COMMON AUDIO/VISUAL'S – 6TH FLOOR	ACTIVATE COMMON AUDIO/VISUAL'S – 7TH FLOOR	ACTIVATE COMMON AUDIO/VISUAL'S – 8TH FLOOR	ACTIVATE COMMON AUDIO/VISUAL'S – PENTHOUSE	ACTIVATE SOUNDER BASE ON SMOKE DETECTOR IN DWELLING UNIT OF AFFECTED FLOORS	ACTIVATE STROBE IN DWELLING UNITS OF AFFECTED FLOORS	DEENERGIZE MAGNETIC LOCKS AND DOOR HOLDERS –PARKING GARAGE	DEENERGIZE MAGNETIC LOCKS AND DOOR HOLDERS –1ST FLOOR	DEENERGIZE MAGNETIC LOCKS AND DOOR HOLDERS –2ND FLOOR	DEENERGIZE MAGNETIC LOCKS AND DOOR HOLDERS –3RD FLOOR	DEENERGIZE MAGNETIC LOCKS AND DOOR HOLDERS –4TH FLOOR	DEENERGIZE MAGNETIC LOCKS AND DOOR HOLDERS –5TH FLOOR	DEENERGIZE MAGNETIC LOCKS AND DOOR HOLDERS –6TH FLOOR	DEENERGIZE MAGNETIC LOCKS AND DOOR HOLDERS –7TH FLOOR	DEENERGIZE MAGNETIC LOCKS AND DOOR HOLDERS –8TH FLOOR	DEENERGIZE AHU	ACTIVATE STAIR PRESSURIZATION SYSTEM	CLOSE ASSOCIATES DAMPER WITH SMOKE DETECTOR	ACTIVATE ELEVATOR RECALL FUNCTION – RESPOND TO PRIMARY FLOOR	ACTIVATE ELEVATOR RECALL FUNCTION – RESPOND TO SECONDARY FLOOR	ACTIVATE ELEVATOR SHUNT-TRIP FUNCTION	ACTIVATE TOP OF ELEVATOR SHAFT DAMPERS
MANUAL PULL STATION – PARKING GARAGE	X			X	X											X	X	X												
MANUAL PULL STATION – 1ST FLOOR	X			X	X	X								X	X	X	X													
MANUAL PULL STATION – 2ND FLOOR	X				X	X	X							X	X		X	X	X											
MANUAL PULL STATION – 3RD FLOOR	X					X	X	X						X	X			X	X	X										
MANUAL PULL STATION – 4TH FLOOR	X						X	X	X					X	X				X	X	X									
MANUAL PULL STATION – 5TH FLOOR	X							X	X	X				X	X					X	X	X								
MANUAL PULL STATION – 6TH FLOOR	X								X	X	X			X	X						X	X	X							
MANUAL PULL STATION – 7TH FLOOR	X									X	X	X		X	X							X	X	X						
MANUAL PULL STATION – 8TH FLOOR	X										X	X	X	X	X								X	X						
COMMON AREA SYSTEM SMOKE DETECTOR – PARKING GARAGE	X			X	X											X	X								X	X				
COMMON AREA SYSTEM SMOKE DETECTOR – 1ST FLOOR	X			X	X	X								X	X	X	X								X	X				
COMMON AREA SYSTEM SMOKE DETECTOR – 2ND FLOOR	X				X	X	X							X	X		X	X	X						X	X				
COMMON AREA SYSTEM SMOKE DETECTOR – 3RD FLOOR	X					X	X	X						X	X			X	X	X					X	X				
COMMON AREA SYSTEM SMOKE DETECTOR – 4TH FLOOR	X						X	X	X					X	X				X	X	X				X	X				
COMMON AREA SYSTEM SMOKE DETECTOR – 5TH FLOOR	X							X	X	X				X	X					X	X	X			X	X				
COMMON AREA SYSTEM SMOKE DETECTOR – 6TH FLOOR	X								X	X	X			X	X						X	X	X		X	X				
COMMON AREA SYSTEM SMOKE DETECTOR – 7TH FLOOR	X									X	X	X		X	X							X	X	X	X	X				
COMMON AREA SYSTEM SMOKE DETECTOR – 8TH FLOOR	X										X	X	X	X	X								X	X	X	X				
ELEVATOR LOBBY SYSTEM SMOKE DETECTOR – PARKING GARAGE	X			X	X											X	X								X	X		X		X
ELEVATOR LOBBY SYSTEM SMOKE DETECTOR – 1ST FLOOR	X			X	X	X								X	X	X	X								X	X			X	X
ELEVATOR LOBBY SYSTEM SMOKE DETECTOR – 2ND FLOOR	X				X	X	X							X	X		X	X	X						X	X		X		X
ELEVATOR LOBBY SYSTEM SMOKE DETECTOR – 3RD FLOOR	X					X	X	X						X	X			X	X	X					X	X		X		X
ELEVATOR LOBBY SYSTEM SMOKE DETECTOR – 4TH FLOOR	X						X	X	X					X	X				X	X	X				X	X		X		X
ELEVATOR LOBBY SYSTEM SMOKE DETECTOR – 5TH FLOOR	X							X	X	X				X	X					X	X	X			X	X		X		X
ELEVATOR LOBBY SYSTEM SMOKE DETECTOR – 6TH FLOOR	X								X	X	X			X	X						X	X	X		X	X		X		X
ELEVATOR LOBBY SYSTEM SMOKE DETECTOR – 7TH FLOOR	X									X	X	X		X	X							X	X	X	X	X		X		X
ELEVATOR LOBBY SYSTEM SMOKE DETECTOR – 8TH FLOOR	X										X	X	X	X	X								X	X	X	X		X		X
SMOKE DETECTOR IN DWELLING UNIT		X												X	X															
AHU SMOKE DETECTORS		X																								X				
SMOKE DETECTOR AT FIRE/SMOKE DAMPER																											X			
HEAT DETECTORS IN ELEVATOR SHAFT & MACHINE ROOM		X																											X	
SMOKE DETECTORS IN ELEVATOR SHAFT & MACHINE ROOM																														X
FIRE SPRINKLER WATERFLOW SWITCH – 1ST FLOOR	X			X	X	X								X	X	X	X	X							X					
FIRE SPRINKLER WATERFLOW SWITCH – 2ND FLOOR	X				X	X	X							X	X		X	X	X						X					
FIRE SPRINKLER WATERFLOW SWITCH – 3RD FLOOR	X					X	X	X						X	X			X	X	X					X					
FIRE SPRINKLER WATERFLOW SWITCH – 4TH FLOOR	X						X	X	X					X	X				X	X	X				X					
FIRE SPRINKLER WATERFLOW SWITCH – 5TH FLOOR	X							X	X	X				X	X					X	X	X			X					
FIRE SPRINKLER WATERFLOW SWITCH – 6TH FLOOR	X								X	X	X			X	X						X	X	X		X					
FIRE SPRINKLER WATERFLOW SWITCH – 7TH FLOOR	X									X	X	X		X	X							X	X	X	X					
FIRE SPRINKLER WATERFLOW SWITCH – 8TH FLOOR	X										X	X	X	X	X								X	X	X					
FIRE SPRINKLER WATERFLOW SWITCH – PENTHOUSE	X											X	X	X	X									X	X					
SPRINKLER VALVE SUPERVISION SWITCH		X																												
DRY PIPE SPRINKLER PRESSURE TYPE WATERFLOW SWITCH IN GARAGE	X			X	X											X	X								X					
DRY PIPE SPRINKLER HI/LOW ALARM		X																												
FIRE PUMP RUNNING		X																												
FIRE PUMP PHASE REVERSAL		X																												
FIRE PUMP LOSE OF POWER			X																											

1 **FIRE ALARM SYSTEM OPERATIONS MATRIX**
FA-601|FA-601 SCALE: NONE

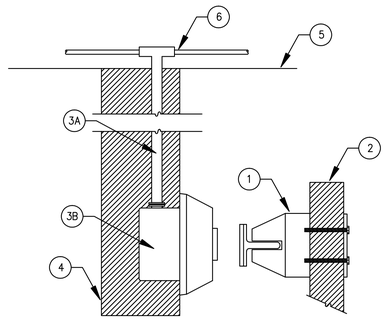

DETAIL NOTES:

1. DOOR ARMATURE ATTACHED TO BACKSIDE OF DOOR.
2. DOOR TO BE HELD IN THE OPEN POSITION. SEE FIRE ALARM PLANS AND DOOR SCHEDULE.
3A. FIRE ALARM CONDUIT, WIRE, JUNCTION BOXES AND BACKBOXES CONCEALED IN THE WALL. PROVIDE BACKBOX AT PROPER ELEVATION.
3B. FOR FLOOR MOUNTED DOOR HOLDERS, PROVIDE CONDUIT, WIRE AND BACKBOX AT PROPER ELEVATION. PROVIDE REQUIRED RELAY/MONITOR MODULE.
4. SEE WALL SCHEDULE FOR WALL TYPE.
5. SEE ARCHITECTURAL PLAN FOR CEILING TYPE.
6. PROVIDE FIRE ALARM CONDUIT, WIRE AND JUNCTION BOXES CONCEALED ABOVE CEILING.

2 **ELECTROMAGNETIC DOOR HOLDER**
FA-601|FA-601 SCALE: NONE

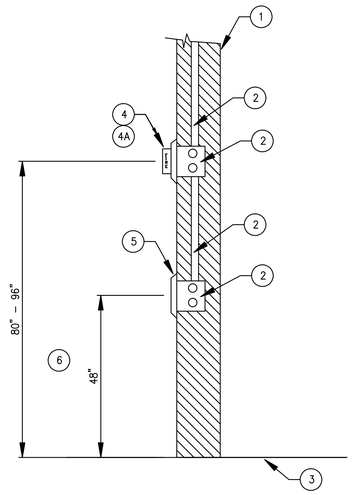

DETAIL NOTES:

1. SEE ARCHITECTURAL PLAN FOR CEILING TYPE.
2. FIRE ALARM CONDUIT, WIRE, JUNCTION BOXES AND BACKBOXES CONCEALED IN THE WALL.
3. FLOOR LEVEL.
4. PROVIDE FLUSH MOUNTED (OR SURFACE MOUNTED AS REQUIRED BY THE ROOM SCHEDULE) SPEAKER/STROBE AS REQUIRED BY THE ROOM SCHEDULE.
4A. LOCATE STROBE LENS BETWEEN 80" AND 96" ABOVE THE FLOOR. NOTE USE OF 177 CANDELA STROBES IN DWELLING UNITS WHEN STROBE LOCATED LESS THAN 24" BELOW THE CEILING.
5. PROVIDE RECESSED MOUNTED (OR SURFACE MOUNTED AS REQUIRED BY THE ROOM SCHEDULE) MANUAL FIRE ALARM PULL STATION.
6. INSTALL DEVICES AT ELEVATIONS SPECIFIED.

3 **MANUAL FIRE ALARM PULL STATION & SPEAKER/STROBE**
FA-601|FA-601 SCALE: NONE

PROPERTY OF THE UNITED STATES GOVERNMENT – FOR OFFICIAL USE ONLY. Do not remove this notice. Properly destroy documents when no longer needed.

GSA
GENERAL SERVICES ADMINISTRATION
77 FORSYTH STREET
SUITE 600
ATLANTA, GA 30303
TEL: (404)331-3200

AFRH The Premier Retirement Community for America's Veterans

JE JACOBS
PROJECT MANAGEMENT CONSULTANT TO THE GENERAL SERVICES ADMINISTRATION

YATES CONSTRUCTION

SFCS Architecture Engineering Planning Interiors

URS
URS CORPORATION
2020 K ST, NW
SUITE 300
WASHINGTON D.C. 20006

ISSUED FOR CONSTRUCTION

CERTIFICATIONS

KEY PLAN

REVISION NOTES

MARK	DATE	DESCRIPTION
1	09/08/08	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE

CONTRACTORS

A/E CON. NO.	GS-04P-07-EX-C-0099
A/E TASK NO.	
CONS. CONTR.	
CONS. WORK	
PRIME A/E	
SUB A/E	
CONSTR. CON.	

BUILDING

NAME	ARMED FORCES RETIREMENT HOME
STREET	1800 BEACH DRIVE
CITY/ST./ZIP	GULFPORT, MS 39507
BUILDING NO.	
OTHER BUILDING NOs.	
FACILITY CODE	

PROJECT

PROJECT TITLE	ARMED FORCES RETIREMENT HOME GULFPORT, MISSISSIPPI
PROJECT DESCRIPTION	NEW CONSTRUCTION
PROJECT NO.	31942982
GSA PM	STEVEN SMITH
SUBMISSION	ISSUED FOR CONSTRUCTION
SUB. DATE	09/08/2008

DRAWING

DRAWING TITLE	SCHEDULES
FILE NAME	FA-601-N0095730.DWG
FLOOR NO.	
DRAWN BY	INR DATE DRAFTED:
CHECKED BY	DP/BB SHEET SIZE: 34 X 44
DRAWING NO.	FA 6 01 DISCIPLINE SHEET TYPE SEQUENCE
	SHEET OF –